




PROBLEM SUMMARY

Sample Rating Trend

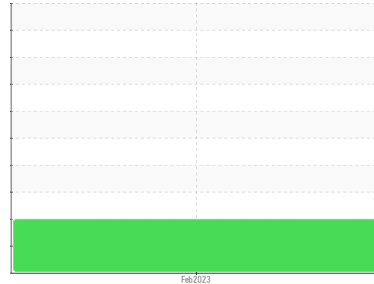

VISUAL METAL




Machine Id
KMGP UNIT 1

Component
Inboard Pump

Fluid
ROYAL PURPLE SYNFILM GT 32 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Non-ferrous Metals

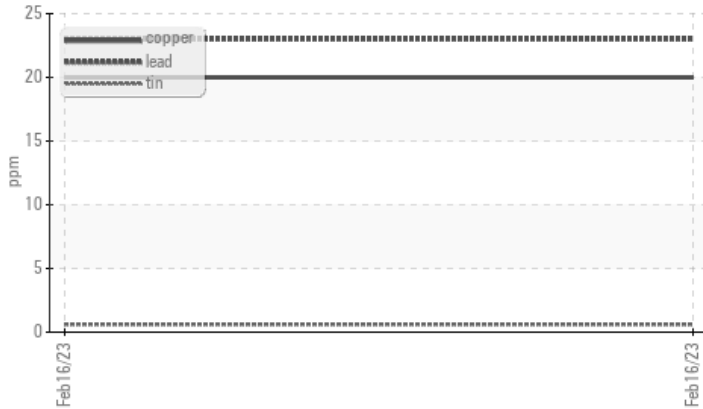

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ABNORMAL	---	---			
Lead	ppm	ASTM D5185m	>12	▲ 23	---	---
White Metal	scalar	*Visual	NONE	▲ MODER	---	---

Customer Id: MAGHOU
Sample No.: RP0028247
Lab Number: 05797613
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend



VISUAL METAL



Machine Id
KMGP UNIT 1

Component
Inboard Pump

Fluid
ROYAL PURPLE SYNFILM GT 32 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

The lead level is abnormal. Moderate concentration of visible metal present. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0028247	---	---
Sample Date	Client Info	16 Feb 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>90	2	---	---
Chromium ppm ASTM D5185m	>5	0	---	---
Nickel ppm ASTM D5185m	>5	0	---	---
Titanium ppm ASTM D5185m	>3	<1	---	---
Silver ppm ASTM D5185m	>3	0	---	---
Aluminum ppm ASTM D5185m	>7	<1	---	---
Lead ppm ASTM D5185m	>12	▲ 23	---	---
Copper ppm ASTM D5185m	>30	20	---	---
Tin ppm ASTM D5185m	>9	<1	---	---
Vanadium ppm ASTM D5185m		<1	---	---
Cadmium ppm ASTM D5185m		<1	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		<1	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m		25	---	---
Calcium ppm ASTM D5185m		0	---	---
Phosphorus ppm ASTM D5185m		<1	---	---
Zinc ppm ASTM D5185m		10	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>60	3	---	---
Sodium ppm ASTM D5185m		<1	---	---
Potassium ppm ASTM D5185m	>20	0	---	---
Water % ASTM D6304		0.004	---	---
ppm Water ppm ASTM D6304	>.1	42.0	---	---





FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		0.37	---	---

VISUAL

method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	▲ MODER	---	---
Yellow Metal scalar *Visual	NONE	NONE	---	---
Precipitate scalar *Visual	NONE	NONE	---	---
Silt scalar *Visual	NONE	NONE	---	---
Debris scalar *Visual	NONE	LIGHT	---	---
Sand/Dirt scalar *Visual	NONE	NONE	---	---
Appearance scalar *Visual	NORML	NORML	---	---
Odor scalar *Visual	NORML	NORML	---	---
Emulsified Water scalar *Visual		NEG	---	---
Free Water scalar *Visual		NEG	---	---

OIL ANALYSIS REPORT

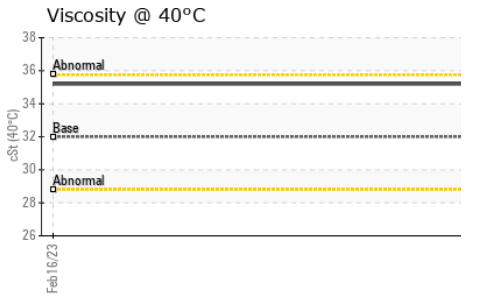
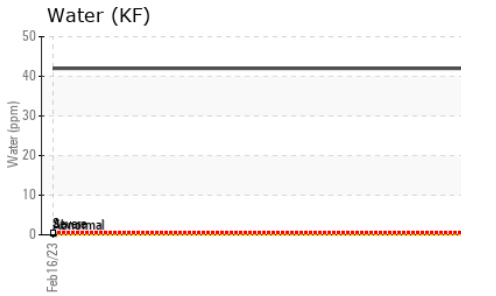
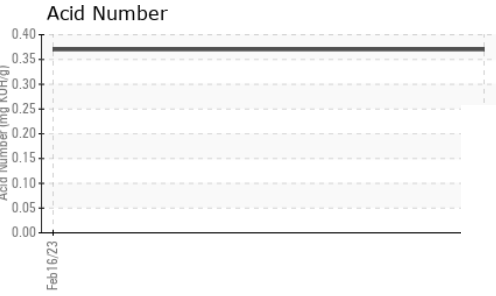
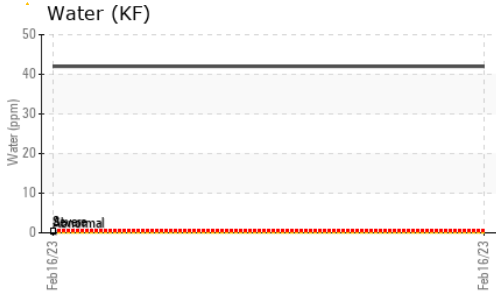


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	35.2	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color					no image	no image
Bottom					no image	no image

GRAPHS

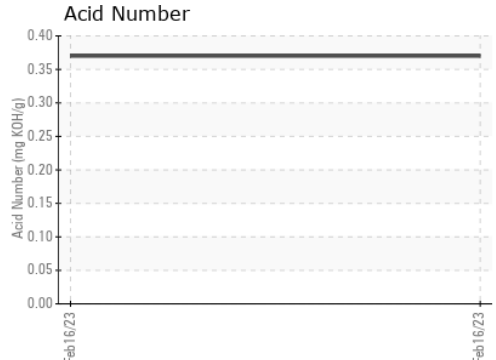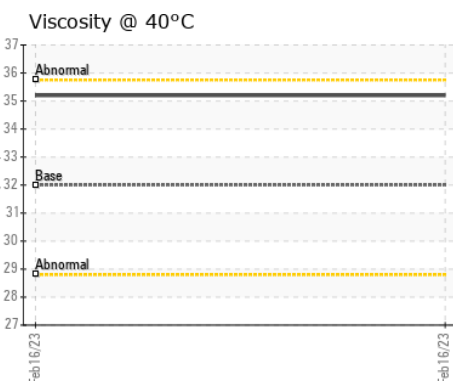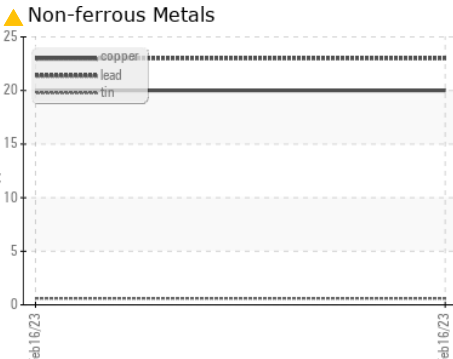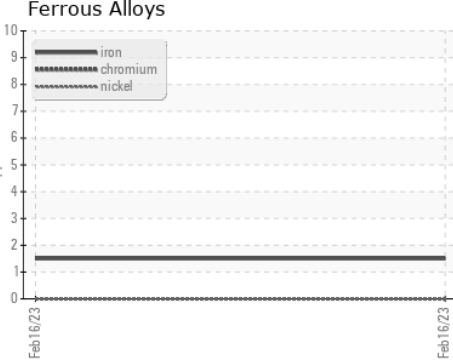

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0028247 **Received** : 21 Mar 2023
Lab Number : **05797613** **Diagnosed** : 23 Mar 2023
Unique Number : 10387297 **Diagnostician** : Don Baldridge
Test Package : IND 2

MAGELLAN MIDSTREAM - EH TERMINAL
 7901 WALLISVILLE RD
 HOUSTON, TX
 US 77029
 Contact: LOGAN SEYL
 logan.seyl@magellanlp.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)