

PROBLEM SUMMARY

Sample Rating Trend

WEAR



Machine Id
KMGP UNIT 2


Component
Inboard Bearing

Fluid
ROYAL PURPLE SYNFILM GT 32 (--- GAL)



COMPONENT CONDITION SUMMARY

Non-ferrous Metals

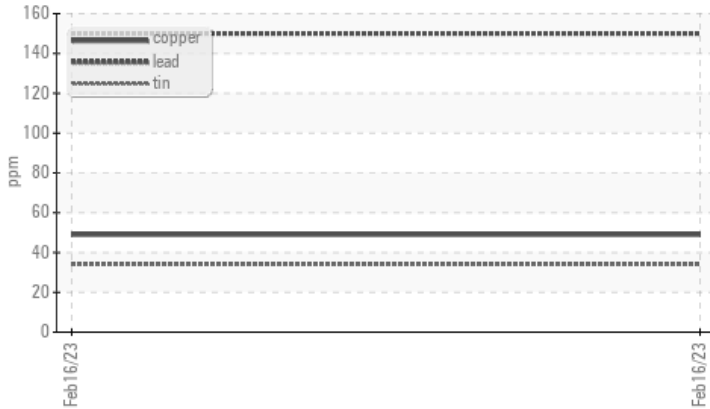

RECOMMENDATION

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	---	---
Lead	ppm	ASTM D5185m	>20	150	---	---
Copper	ppm	ASTM D5185m	>20	49	---	---
Tin	ppm	ASTM D5185m	>20	34	---	---

Customer Id: MAGHOU
Sample No.: RP0028244
Lab Number: 05797617
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Inspect Wear Source	---	---	?	We advise that you inspect for the source(s) of wear.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Machine Id
KMGP UNIT 2

Component
Inboard Bearing

Fluid
ROYAL PURPLE SYNFILM GT 32 (--- GAL)



DIAGNOSIS

Recommendation

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

Wear

Bearing and/or bushing wear is indicated.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0028244	---	---
Sample Date	Client Info		16 Feb 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			SEVERE	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<1	---	---
Chromium	ppm	ASTM D5185m >20	0	---	---
Nickel	ppm	ASTM D5185m >20	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	<1	---	---
Aluminum	ppm	ASTM D5185m >20	<1	---	---
Lead	ppm	ASTM D5185m >20	150	---	---
Copper	ppm	ASTM D5185m >20	49	---	---
Tin	ppm	ASTM D5185m >20	34	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	55	---	---
Calcium	ppm	ASTM D5185m	4	---	---
Phosphorus	ppm	ASTM D5185m	0	---	---
Zinc	ppm	ASTM D5185m	11	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	14	---	---
Sodium	ppm	ASTM D5185m	<1	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---
Water	%	ASTM D6304 >2	0.010	---	---
ppm Water	ppm	ASTM D6304	101.8	---	---





FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.41	---	---

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	LIGHT	---	---
Yellow Metal	scalar	*Visual NONE	NONE	---	---
Precipitate	scalar	*Visual NONE	NONE	---	---
Silt	scalar	*Visual NONE	NONE	---	---
Debris	scalar	*Visual NONE	VLITE	---	---
Sand/Dirt	scalar	*Visual NONE	NONE	---	---
Appearance	scalar	*Visual NORML	NORML	---	---
Odor	scalar	*Visual NORML	NORML	---	---
Emulsified Water	scalar	*Visual >2	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---





OIL ANALYSIS REPORT

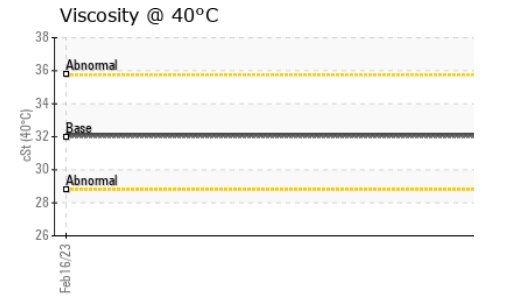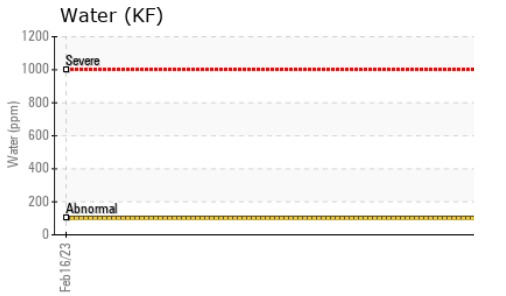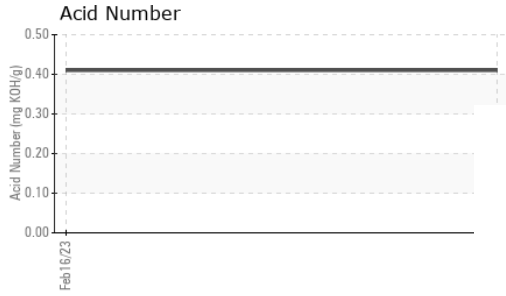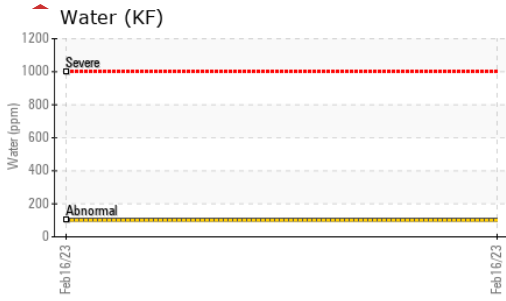

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	32.1	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image

GRAPHS

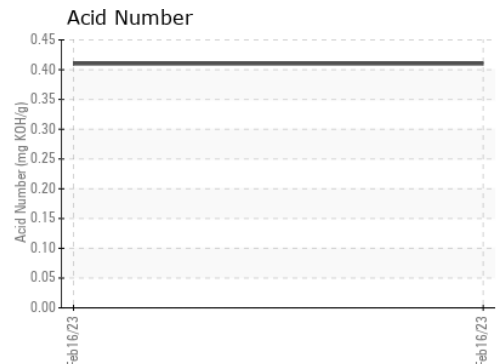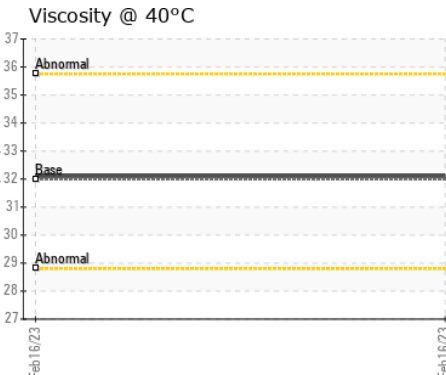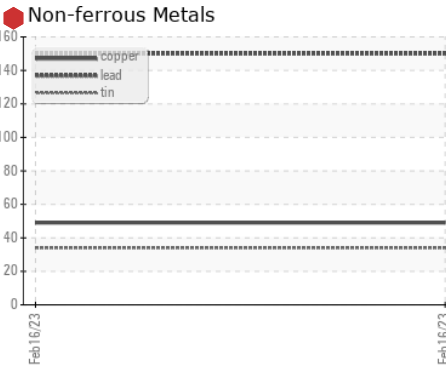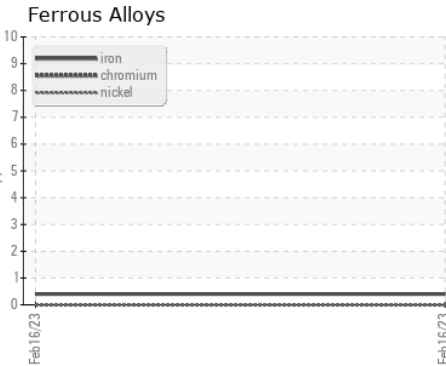

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0028244 **Received** : 21 Mar 2023
Lab Number : **05797617** **Diagnosed** : 27 Mar 2023
Unique Number : 10387301 **Diagnostician** : Doug Bogart
Test Package : IND 2

MAGELLAN MIDSTREAM - EH TERMINAL
 7901 WALLISVILLE RD
 HOUSTON, TX
 US 77029
 Contact: LOGAN SEYL
 logan.seyl@magellanlp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: