


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

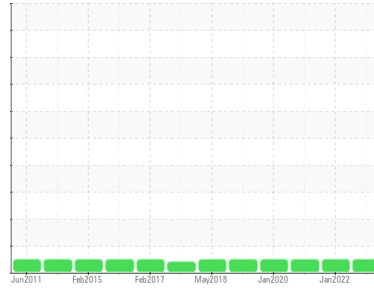

Machine Id
D303 (S/N 6411-10)

Component
Wind Turbine Gearbox

Fluid
MOBIL MOBILGEAR SHC XMP 320 (74 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		MHI026244	MHI017607	MHI017481
Sample Date	Client Info		13 Feb 2023	05 Jan 2022	07 Jan 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	89462	82901	76583
Oil Changed	Client Info		Not Changed	Not Changed	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>200	13	17	14	
Iron	ppm	ASTM D5185m	>200	25	22	13
Chromium	ppm	ASTM D5185m	>3	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>10	0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>30	0	0	0
Lead	ppm	ASTM D5185m	>15	0	0	0
Copper	ppm	ASTM D5185m	>75	1	1	<1
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m	>5	---	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	2	2
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	3	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m	0	0	5	0
Phosphorus	ppm	ASTM D5185m	485	410	466	372
Zinc	ppm	ASTM D5185m	0	3	0	<1
Sulfur	ppm	ASTM D5185m		5063	4060	3549






CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>+30	<1	1	1
Sodium	ppm	ASTM D5185m	>15	0	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.1	0.008	0.006	0.005
ppm Water	ppm	ASTM D6304	>1000	89.0	62.3	57.8

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2730	7510	1095
Particles >6µm	ASTM D7647	>5000	390	664	404
Particles >14µm	ASTM D7647	>640	22	10	75
Particles >21µm	ASTM D7647	>160	7	3	25
Particles >38µm	ASTM D7647	>40	0	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	19/16/12	20/17/10	17/16/13

OIL ANALYSIS REPORT

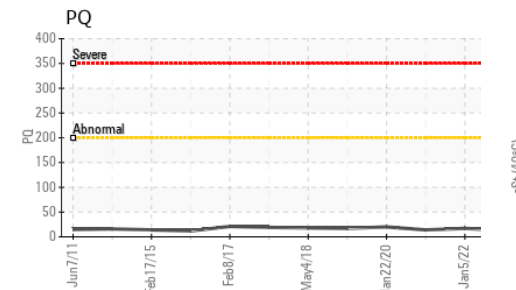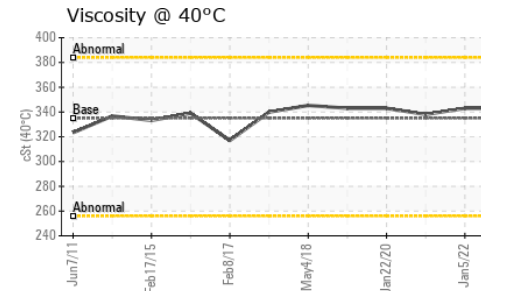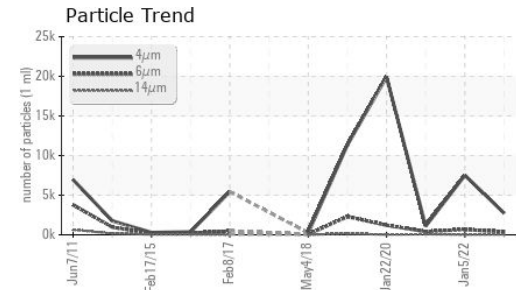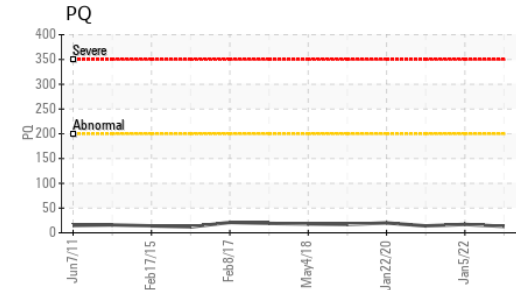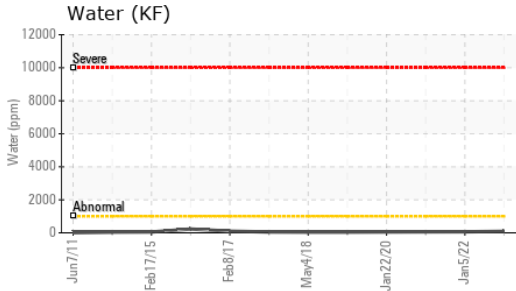

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.94	0.94	0.805





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	343	343	338

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------



GRAPHS

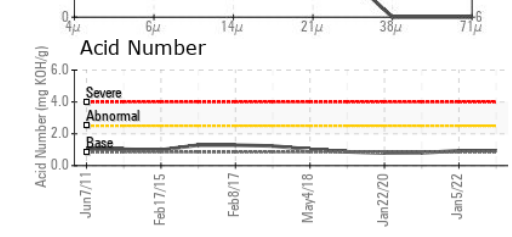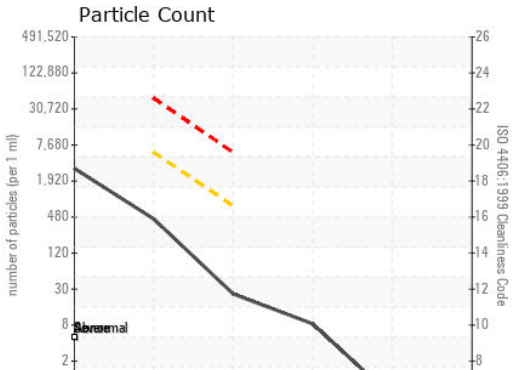

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MH1026244 **Received** : 21 Mar 2023
Lab Number : **05798290** **Diagnosed** : 24 Mar 2023
Unique Number : 10387974 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

DIAMOND WTG - DILLON
P.O. BOX 880
DESERT HOT SPRINGS, CA
US 92240
Contact: DANIEL BOYD
daniel.boyd@diamondwtg.com
T: (760)329-7171
F: (760)329-7122

Certificate L2367
To discuss this sample report, contact Customer Service at 1-800-237-1369.
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)