




OIL ANALYSIS REPORT

Sample Rating Trend

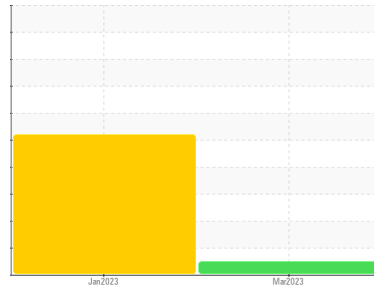

NORMAL



Machine Id
CATES FG1
 Component
Compressor
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

MPC (Membrane Patch Colorimetry) test indicates acceptable levels of varnish present. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. Linear Sweep Voltammetry (RULER – ASTM D6971) testing indicates normal levels of anti-oxidants present in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0782171	WC0782416	---
Sample Date	Client Info		21 Mar 2023	19 Jan 2023	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	SEVERE	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	12	---
Chromium	ppm	ASTM D5185m >5	0	0	---
Nickel	ppm	ASTM D5185m	0	0	---
Titanium	ppm	ASTM D5185m	0	<1	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >15	0	0	---
Lead	ppm	ASTM D5185m >65	0	0	---
Copper	ppm	ASTM D5185m >65	0	<1	---
Tin	ppm	ASTM D5185m >10	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	<1	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	6	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	0	1	---
Calcium	ppm	ASTM D5185m	0	7	---
Phosphorus	ppm	ASTM D5185m	153	160	---
Zinc	ppm	ASTM D5185m	0	8	---
Sulfur	ppm	ASTM D5185m	371	314	---

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	0	3	---
Sodium	ppm	ASTM D5185m	0	10	---
Potassium	ppm	ASTM D5185m >20	0	1	---
Water	%	ASTM D6304 >0.1	0.003	▲ 1.07	---
ppm Water	ppm	ASTM D6304 >1000	32.0	▲ 10700	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	2179	---	---
Particles >6µm	ASTM D7647	>2500	569	---	---
Particles >14µm	ASTM D7647	>320	36	---	---
Particles >21µm	ASTM D7647	>80	7	---	---
Particles >38µm	ASTM D7647	>20	0	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	18/16/12	---	---



OIL ANALYSIS REPORT

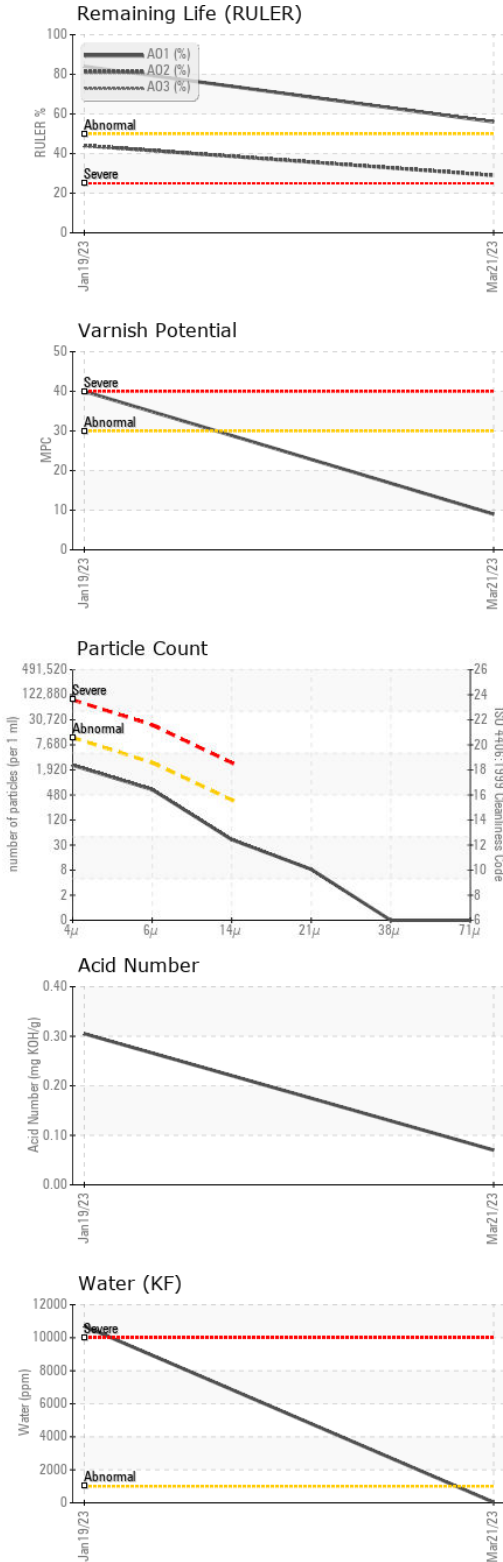


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.07	0.305	---
Anti-Oxidant 1	%	ASTM D6971	<25	84	---
Anti-Oxidant 2	%	ASTM D6971	<25	44	---
MPC Varnish Potential	Scale	ASTM D7843	9	▲ 40	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	● MILKY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	118	119	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image
MPC					no image



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0782171
Lab Number : **05798298**
Unique Number : 10387982
Test Package : AOM 1 (Additional Tests: KF)

Received : 21 Mar 2023
Tested : 31 Mar 2023
Diagnosed : 31 Mar 2023 - Doug Bogart


NORTH CAROLINA STATE UNIVERSITY
 621 MOTOR POOL DR, FACILITIES DIVISION WAREHOUSE
 RALEIGH, NC
 US 27607

Contact: PAUL WALKER
 apwalke3@ncsu.edu
 T: (919)513-3646

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

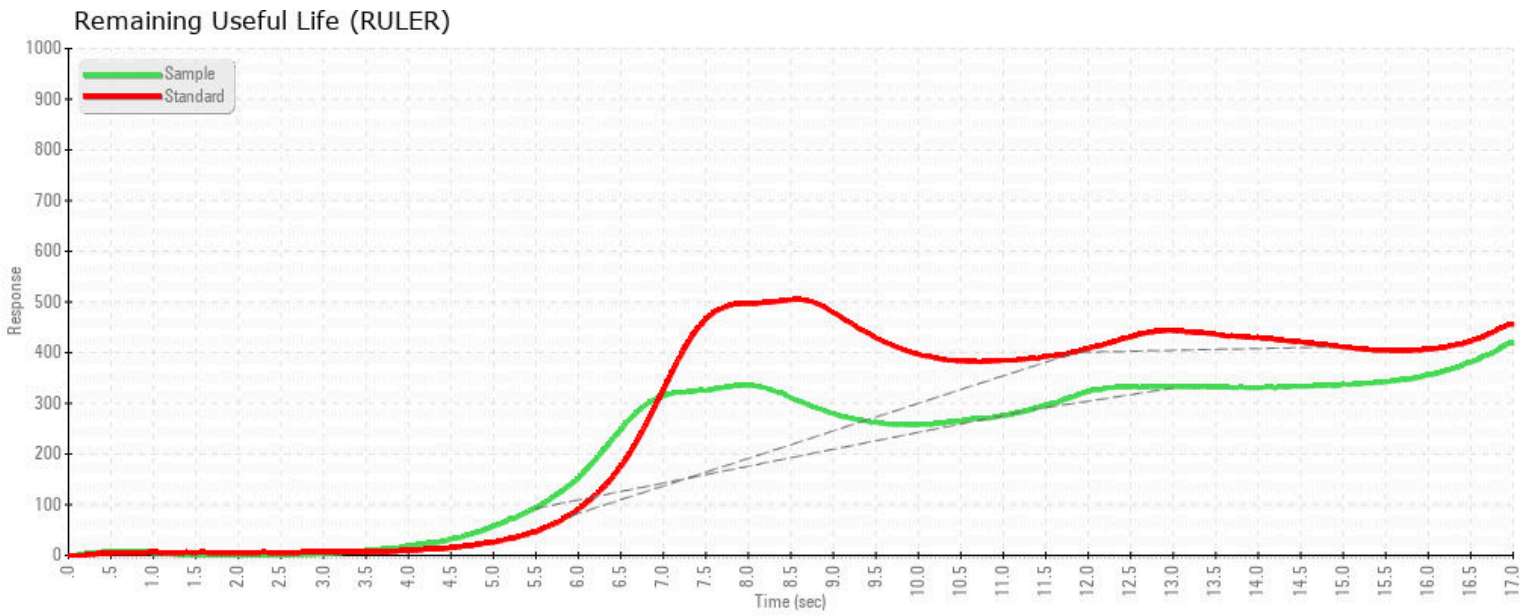

MPC (Varnish Test)



Sample Color & Clarity



This page left intentionally blank