


OIL ANALYSIS REPORT

Sample Rating Trend



CARRIER Travelers 1 Ch 3 0894J47372

Reservoir Centrifugal Compressor

400CA (8 GAL)

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please submit a sample of the new (unused) oil to establish a baseline. (Customer Sample Comment: Routine maintenance)

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Mar2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0758331		
Sample Date		Client Info		17 Mar 2023		
Machine Age	hrs	Client Info		19125		
Oil Age	hrs	Client Info		19125		
Oil Changed	1110	Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m		0		
Nickel	ppm	ASTM D5185m	, , 0	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead		ASTM D5185m	>25	0		
	ppm			-		
Copper Tin	ppm	ASTM D5185m		<1		
	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		1930		
Zinc	ppm	ASTM D5185m		<1		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	20		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.1	0.004		
opm Water	ppm	ASTM D6304	>1000	40.0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	3667		
Particles >6µm		ASTM D7647	>2500	513		
Particles >14μm		ASTM D7647	>320	19		
Particles >21µm		ASTM D7647	>80	8		
Particles >38μm		ASTM D7647	>20	2		
Particles >71μm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/16/11		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

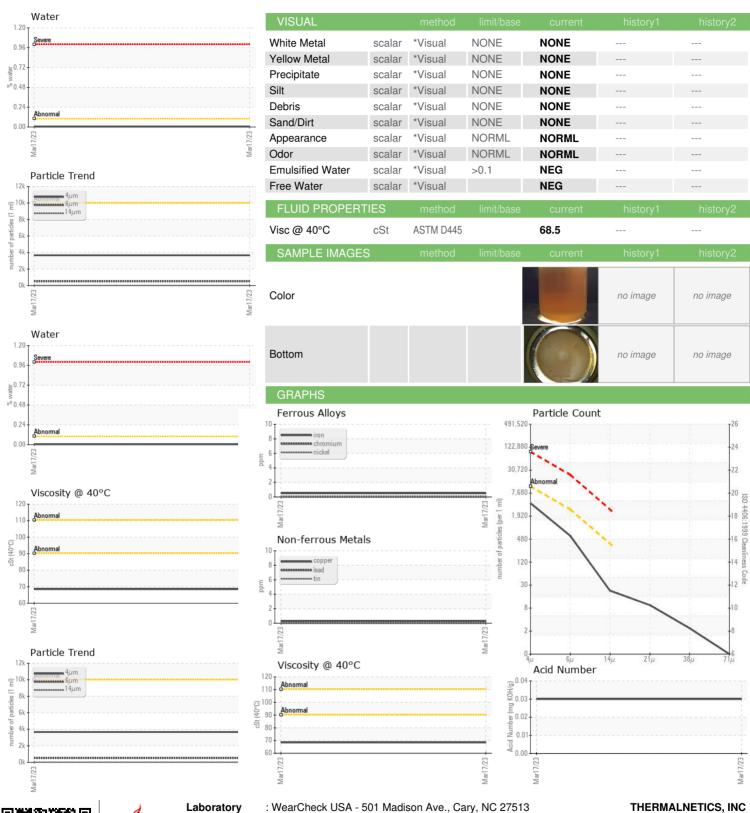



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 05799769 : 10389453

Received : 23 Mar 2023 : WC0758331 Diagnosed : 29 Mar 2023 Diagnostician : Doug Bogart Test Package : PLANT

3955 PINNACLE COURT SUITE 200 AUBURN HILLS, MI US 48326

Contact: GARY WATSON garyw@thermalnetics.com T: (248)276-3351

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: