


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# KAESER DSD 150 6912499 (S/N 1074)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Sep 202	Jun2021	Nov2021 Ma	72023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000439	KCP43055	KCP34575
Sample Date		Client Info		13 Mar 2023	26 Nov 2021	25 Jun 2021
Machine Age	hrs	Client Info		21081	18062	14379
Oil Age	hrs	Client Info		0	3600	6830
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	13	21
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	0	4	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	4	8
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		18468	13786	12688
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		<1	0	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.05	0.008	0.003	0.018
ppm Water	ppm	ASTM D6304	>500	80.0	34.6	181.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		858	3090	1720
Particles >6µm		ASTM D7647	>1300	152	1371	466
Particles >14µm		ASTM D7647	>80	11	42	20
Particles >21µm		ASTM D7647	>20	3	11	4
Particles >38µm		ASTM D7647	>4	0	2	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/14/11	18/13	16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## OIL ANALYSIS REPORT

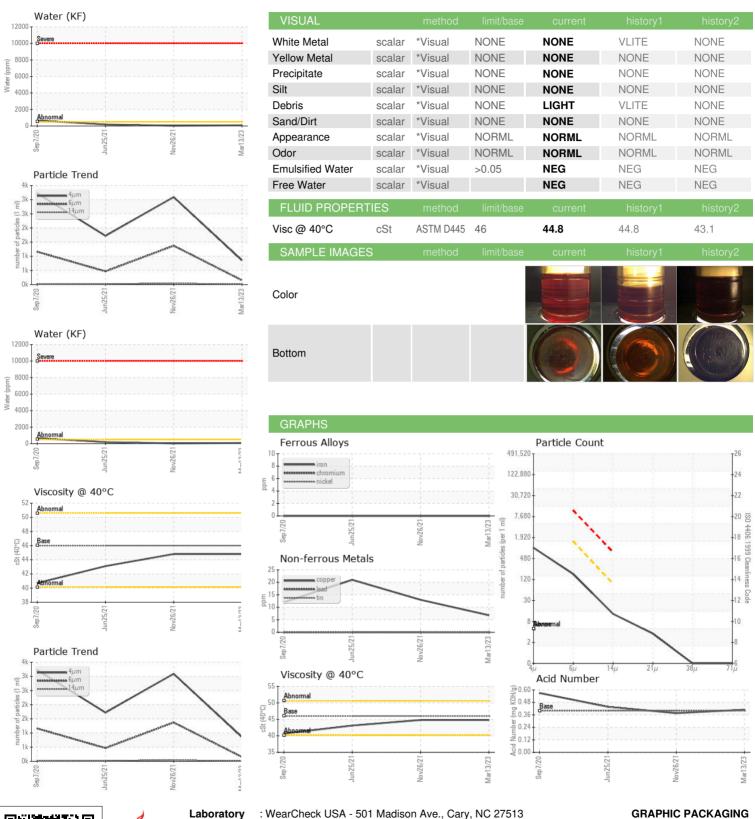





Sample No. Lab Number

: KCPA000439 : 05803478 Unique Number : 10401007

Received **Tested** Diagnosed

: 30 Mar 2023 - Jonathan Hester Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 27 Mar 2023

: 29 Mar 2023

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**GRAPHIC PACKAGING** 

5853 E PONCE DE LEON AVE STONE MOUNTAIN, GA US 30083

Contact: STAFTON BYNOE stafton.bynoe@graphicpkg.com

T:

F: