




# PROBLEM SUMMARY


Sample Rating Trend

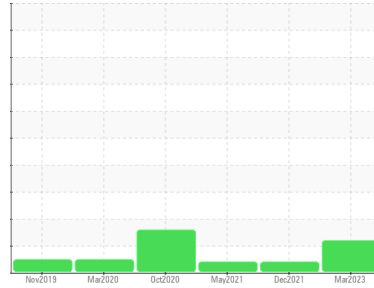

Machine Id  
**KAESER AS 40S 6895341 (S/N 1070)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

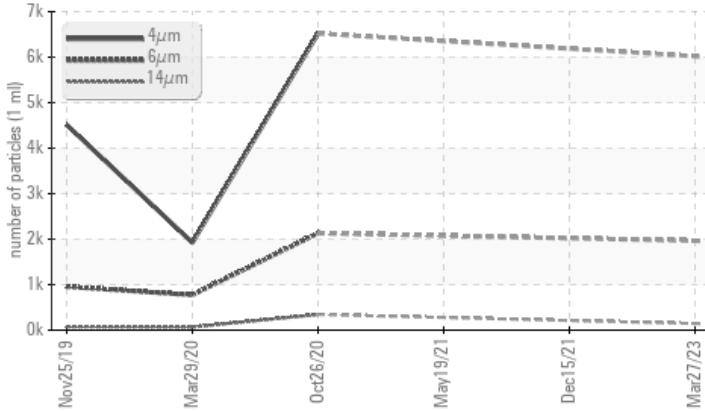

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1965	---	---
Particles >14µm	ASTM D7647	>80	▲ 145	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	---	---

Customer Id: CONBELMA  
 Sample No.: KC111066  
 Lab Number: 05814626  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 15 Dec 2021 Diag: Don Baldrige

#### VIS DEBRIS



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 19 May 2021 Diag: Angela Borella

#### VIS DEBRIS



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 26 Oct 2020 Diag: Angela Borella

#### ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



# OIL ANALYSIS REPORT

## Sample Rating Trend

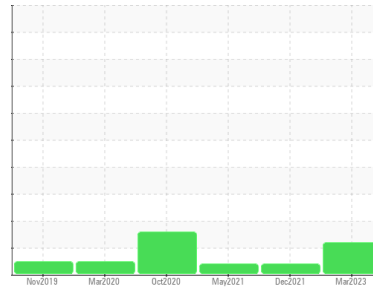

ISO



Machine Id  
**KAESER AS 40S 6895341 (S/N 1070)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC111066</b>	KC85598	KCP32657
Sample Date	Client Info		<b>27 Mar 2023</b>	15 Dec 2021	19 May 2021
Machine Age	hrs	Client Info	<b>16330</b>	10888	8532
Oil Age	hrs	Client Info	<b>5442</b>	2944	588
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>2</b>	6	8
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	20
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>4</b>	10	24
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>2</b>	2	3
Zinc	ppm	ASTM D5185m	<b>0</b>	19	20

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	2	1
Sodium	ppm	ASTM D5185m	<b>2</b>	9	14
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	2
Water	%	ASTM D6304 >0.05	<b>0.008</b>	0.010	0.026
ppm Water	ppm	ASTM D6304 >500	<b>84.1</b>	100.9	260.5

### FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>6019</b>	---	---
Particles >6µm	ASTM D7647 >1300		▲ <b>1965</b>	---	---
Particles >14µm	ASTM D7647 >80		▲ <b>145</b>	---	---
Particles >21µm	ASTM D7647 >20		<b>28</b>	---	---
Particles >38µm	ASTM D7647 >4		<b>1</b>	---	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ <b>20/18/14</b>	---	---

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.37</b>	0.391	0.411


# OIL ANALYSIS REPORT

## ▲ Particle Trend

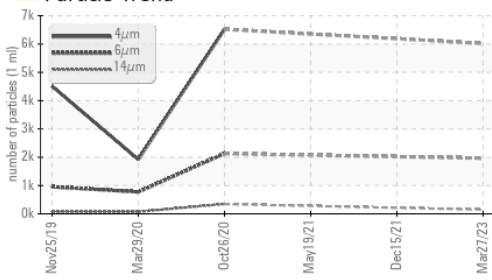

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b> ▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

## Water (KF)

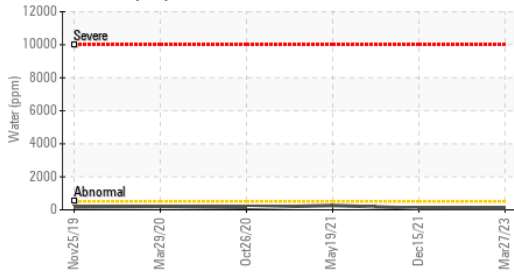

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>44.6</b>	44.7	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color



Bottom




## Acid Number

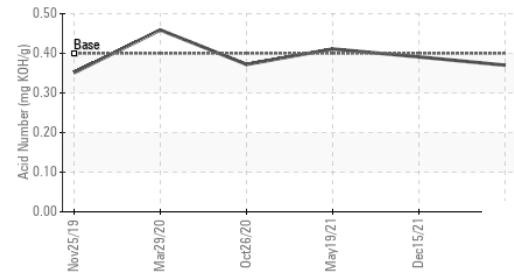


## GRAPHS


### Ferrous Alloys

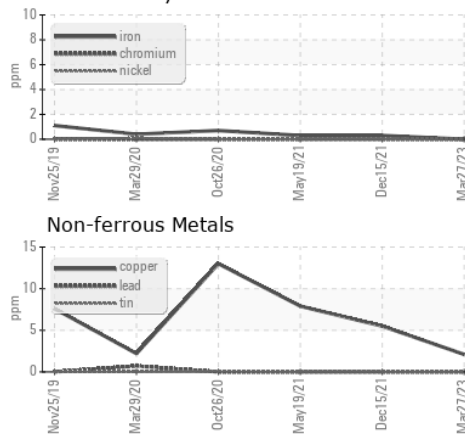


### Non-ferrous Metals

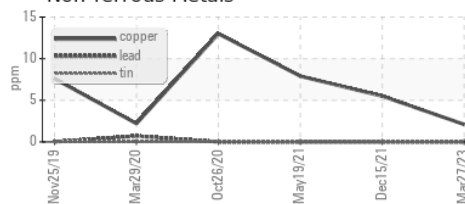


### Viscosity @ 40°C

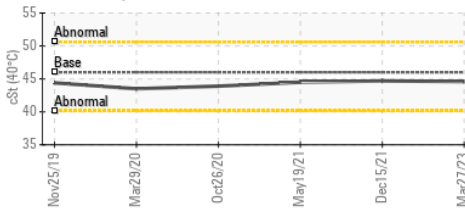

### ▲ Particle Count

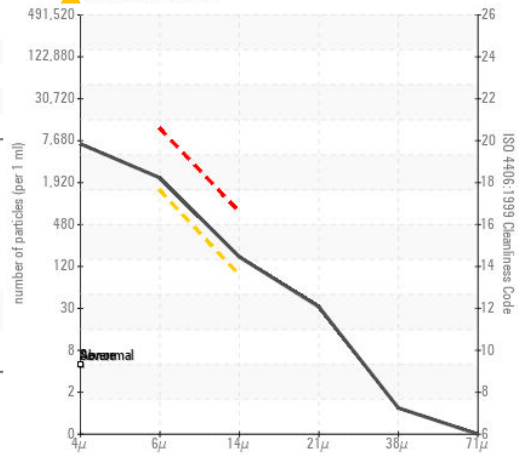

### Acid Number

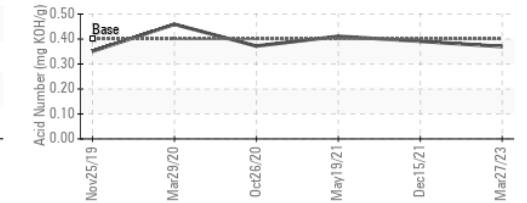

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC111066 **Received** : 07 Apr 2023  
**Lab Number** : 05814626 **Diagnosed** : 12 Apr 2023  
**Unique Number** : 10417418 **Diagnostician** : Angela Borella  
**Test Package** : IND 2

**CONSOLIDATED COATING CO INC**  
 5 WILLIAMS WAY  
 BELLINGHAM, MA  
 US 02019  
 Contact: BOB  
 bob@consolidatedcoating.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: