




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

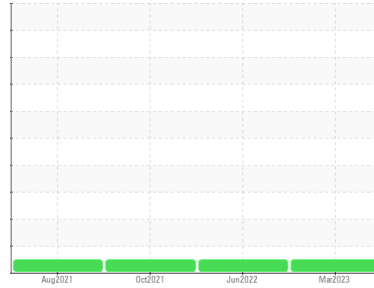

Area
FRONTIER II [20006776]
 Machine Id
04WEA86936
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN CLP ISO 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	NX05818244	NX05565461	NX05391878
Sample Date	Client Info	30 Mar 2023	09 Jun 2022	07 Oct 2021
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184 >80	10	20	12
Iron	ppm ASTM D5185m >150	17	13	7
Chromium	ppm ASTM D5185m >5	0	0	<1
Nickel	ppm ASTM D5185m >10	0	<1	<1
Titanium	ppm ASTM D5185m >10	0	0	0
Silver	ppm ASTM D5185m	0	<1	0
Aluminum	ppm ASTM D5185m >10	0	<1	0
Lead	ppm ASTM D5185m >20	<1	2	1
Copper	ppm ASTM D5185m >50	0	<1	0
Tin	ppm ASTM D5185m >10	0	0	0
Antimony	ppm ASTM D5185m >5	---	---	0
Vanadium	ppm ASTM D5185m	0	0	<1
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	4	6	8
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	<1	0	0
Manganese	ppm ASTM D5185m	1	<1	<1
Magnesium	ppm ASTM D5185m	3	<1	<1
Calcium	ppm ASTM D5185m	17	19	25
Phosphorus	ppm ASTM D5185m	207	218	176
Zinc	ppm ASTM D5185m	0	4	4
Sulfur	ppm ASTM D5185m	5546	4864	5348

CONTAMINANTS






method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	5	5	5
Sodium	ppm ASTM D5185m >20	3	2	2
Potassium	ppm ASTM D5185m >20	<1	<1	9
Water	% ASTM D6304 >0.05	0.004	0.004	0.006
ppm Water	ppm ASTM D6304 >500	42.4	44.2	61.9

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	12778	6141	2038
Particles >6µm	ASTM D7647 >2500	903	1227	410
Particles >14µm	ASTM D7647 >320	61	86	34
Particles >21µm	ASTM D7647 >80	10	12	4
Particles >38µm	ASTM D7647 >20	0	0	0
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	21/17/13	20/17/14	18/16/12



OIL ANALYSIS REPORT

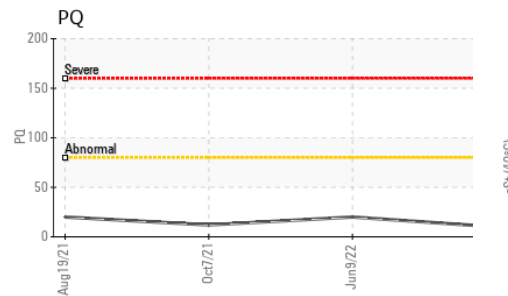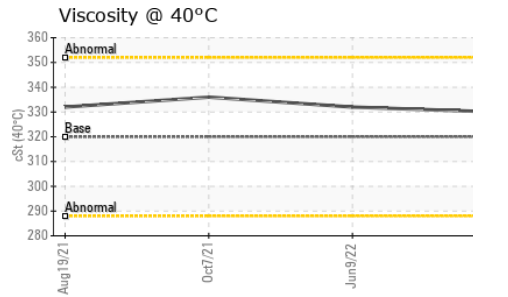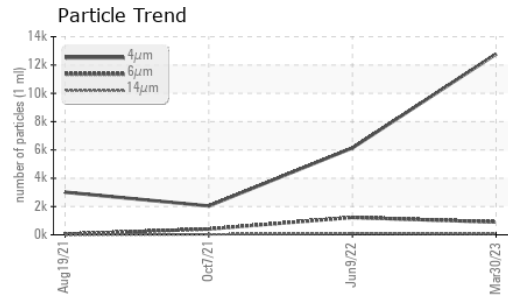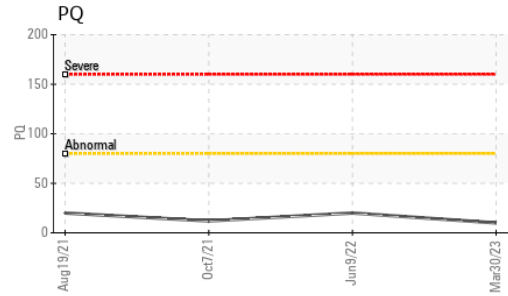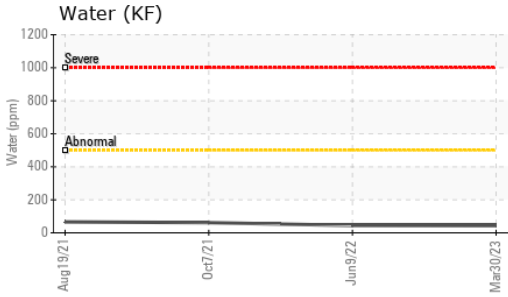


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.41	0.45	0.416






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	330	332	336

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

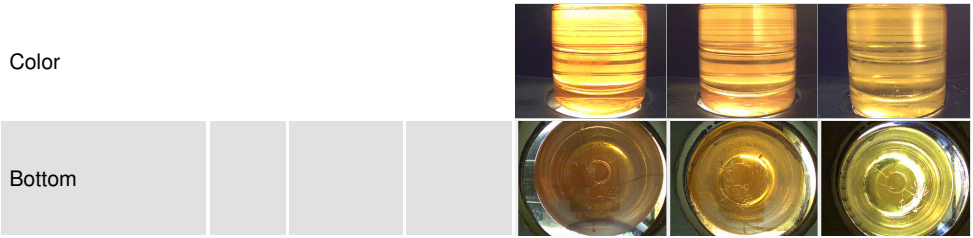

GRAPHS

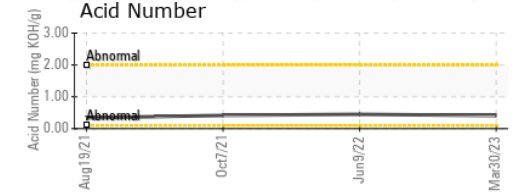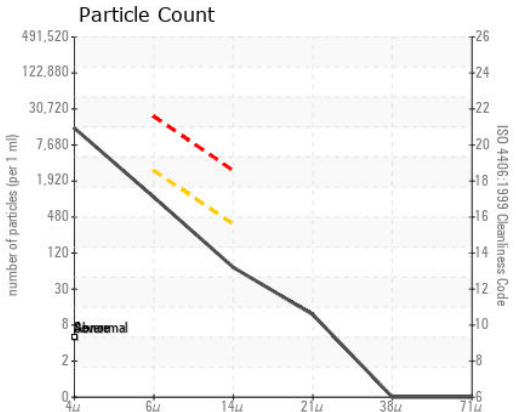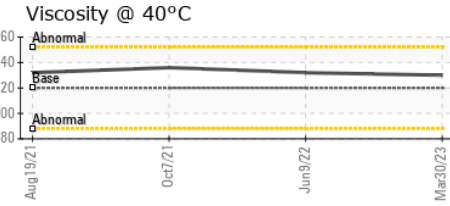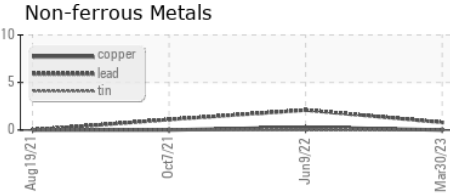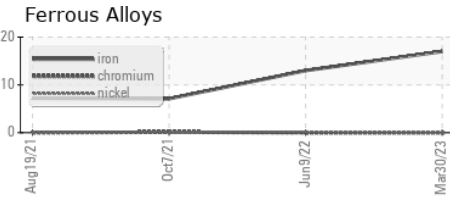

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX05818244 **Received** : 12 Apr 2023
Lab Number : 05818244 **Diagnosed** : 15 Apr 2023
Unique Number : 10426327 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)