



FUEL REPORT


Sample Rating Trend

NORMAL



Machine Id
MOFFETT 11020378B

Component
Diesel Fuel
Fluid
{not provided} (--- GAL)

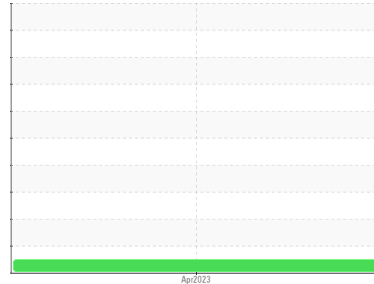

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0716895	---	---
Sample Date	Client Info	12 Apr 2023	---	---
Machine Age	hrs	Client Info	428	---
Sample Status			NORMAL	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	2.95	---

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	0	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1
Sodium	ppm	ASTM D5185m	<0.1	0
Potassium	ppm	ASTM D5185m	<0.1	<1
Water	%	ASTM D6304	<0.05	0.005
ppm Water	ppm	ASTM D6304	<500	54.2

HEAVY METALS

method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0
Nickel	ppm	ASTM D5185m	<0.1	0
Lead	ppm	ASTM D5185m	<0.1	0
Vanadium	ppm	ASTM D5185m	<0.1	0
Iron	ppm	ASTM D5185m	<0.1	0
Calcium	ppm	ASTM D5185m	<0.1	1
Magnesium	ppm	ASTM D5185m	<0.1	0
Phosphorus	ppm	ASTM D5185m	<0.1	6
Zinc	ppm	ASTM D5185m	<0.1	0






SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image



FUEL REPORT

GRAPHS

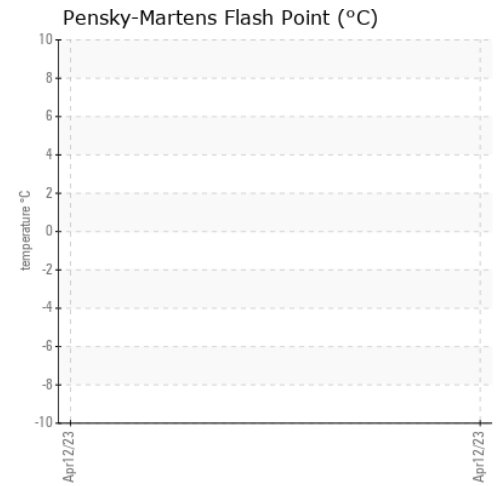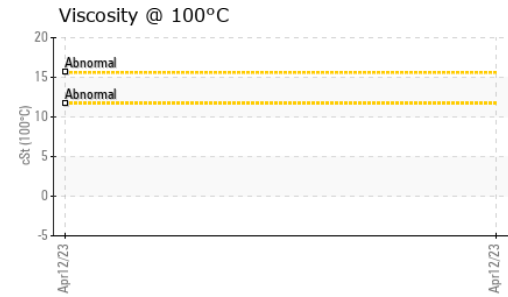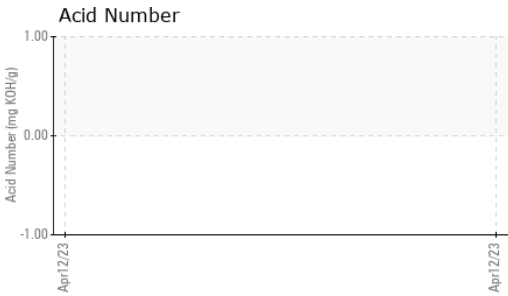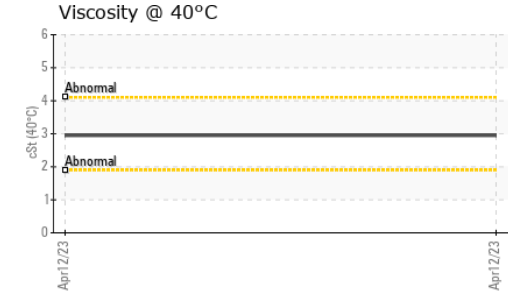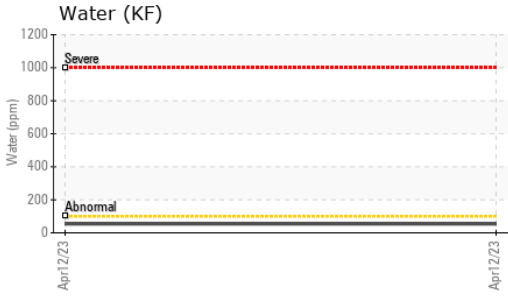

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0716895 **Received** : 14 Apr 2023
Lab Number : **05821224** **Diagnosed** : 19 Apr 2023
Unique Number : 10429307 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: KF, KV100)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HIAB USA - SOUTHWEST
 3600 VALLEY VISTA DR
 HURST, TX
 US 76053

Contact: BEN PROFFITT
 ben.proffitt@hiab.com
 T: (972)506-9664
 F: (972)506-9674