




FUEL REPORT

Sample Rating Trend

NORMAL



Area
[20230592]
 Machine Id
Kohler 1701 Rhode Island 360kw
 Component
Diesel Fuel
 Fluid
NOT GIVEN (--- GAL)

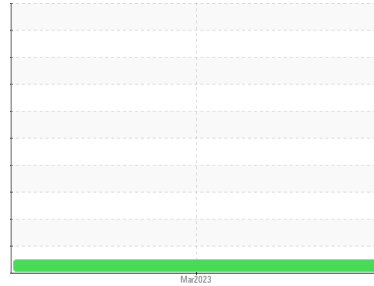

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel. (Customer Sample Comment: 1701 Rhode Island fluid sample)

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			DC0024957	---	---
Sample Date	Client Info			09 Mar 2023	---	---
Machine Age	yrs	Client Info		0	---	---
Sample Status				NORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		1.5	---	---
Visc @ 40°C	cSt	ASTM D445		2.46	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	---	---
Sulfur (UVF)	ppm	ASTM D5453		13	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		36.7	---	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	---	---
Sodium	ppm	ASTM D5185m	<0.1	0	---	---
Potassium	ppm	ASTM D5185m	<0.1	<1	---	---
Water	%	ASTM D6304	<0.05	0.003	---	---
ppm Water	ppm	ASTM D6304	<500	32.7	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	73009	---	---
Particles >6µm		ASTM D7647	>640	33216	---	---
Particles >14µm		ASTM D7647	>80	4658	---	---
Particles >21µm		ASTM D7647	>20	1004	---	---
Particles >38µm		ASTM D7647	>4	8	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	23/22/19	---	---


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	0	---	---
Vanadium	ppm	ASTM D5185m	<0.1	0	---	---
Iron	ppm	ASTM D5185m	<0.1	0	---	---
Calcium	ppm	ASTM D5185m	<0.1	0	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<1	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---



FUEL REPORT

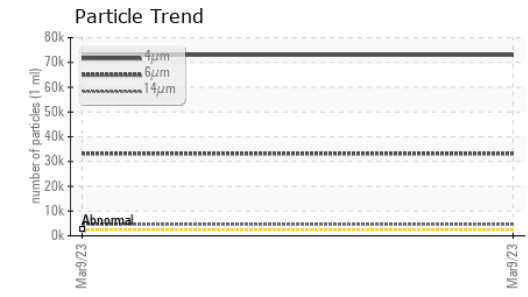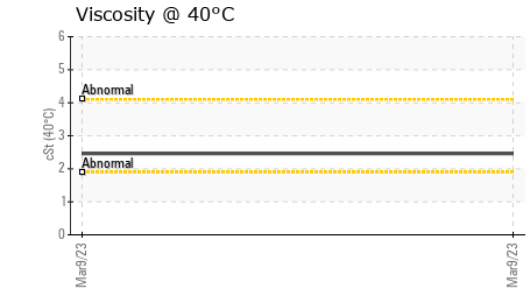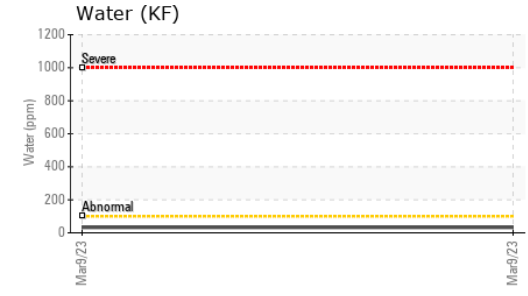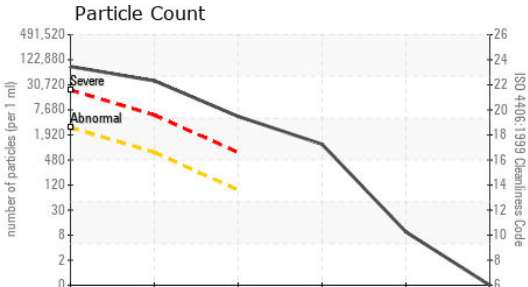

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

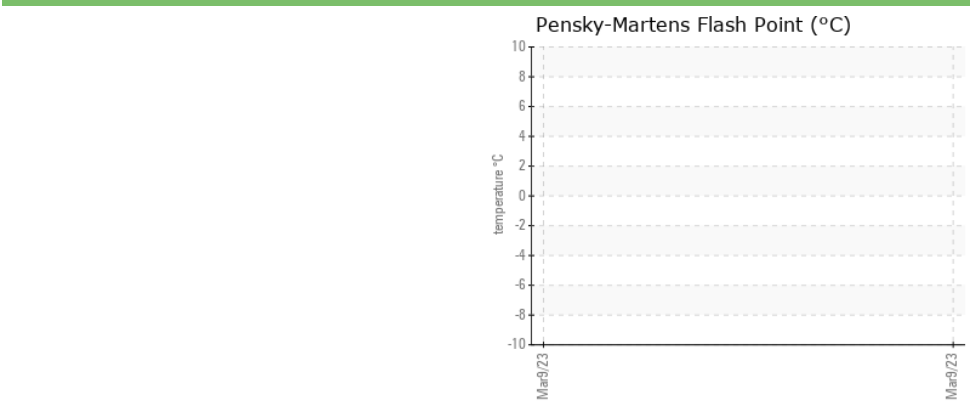

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0024957 **Received** : 21 Apr 2023
Lab Number : 05827103 **Diagnosed** : 26 Apr 2023
Unique Number : 10440596 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JE RICHARDS
 4600 HARGROVE DR
 LANHAM, MD
 US 20706
 Contact: E. NOEL
 enoel@phalconusa.com
 T: (240)623-4398
 F: