




OIL ANALYSIS REPORT

Sample Rating Trend

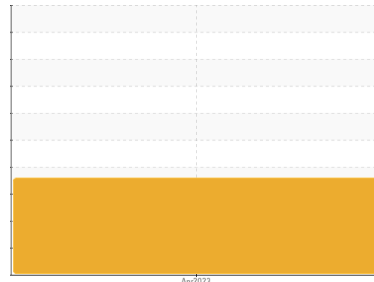

WEAR



Area
M&R FRESNO LPR [FA-J8620]
 Machine Id
MYCOM RC02 (S/N 411661)
 Component
Refrigeration Compressor
 Fluid
SHT-68 (4 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

The iron, aluminum, and tin levels are abnormal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0807662	---	---
Sample Date	Client Info		20 Apr 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	1	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	▲ 157	---	---
Chromium	ppm	ASTM D5185m >10	2	---	---
Nickel	ppm	ASTM D5185m	7	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >10	▲ 45	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	8	---	---
Tin	ppm	ASTM D5185m >10	▲ 11	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	<1	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	3	---	---
Magnesium	ppm	ASTM D5185m	9	---	---
Calcium	ppm	ASTM D5185m	55	---	---
Phosphorus	ppm	ASTM D5185m	8	---	---
Zinc	ppm	ASTM D5185m	72	---	---
Sulfur	ppm	ASTM D5185m	0	---	---






CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	14	---	---
Sodium	ppm	ASTM D5185m	6	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304 >0.01	0.001	---	---
ppm Water	ppm	ASTM D6304 >100	7.9	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 211279	---	---
Particles >6µm	ASTM D7647	>2500	▲ 42032	---	---
Particles >14µm	ASTM D7647	>320	147	---	---
Particles >21µm	ASTM D7647	>80	16	---	---
Particles >38µm	ASTM D7647	>20	0	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 25/23/14	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.053	---	---



OIL ANALYSIS REPORT

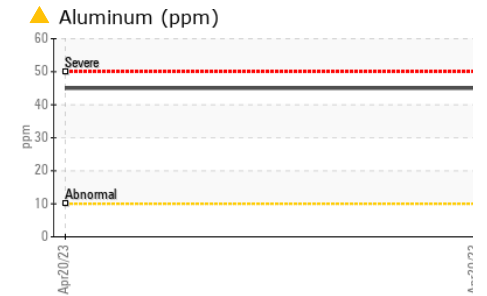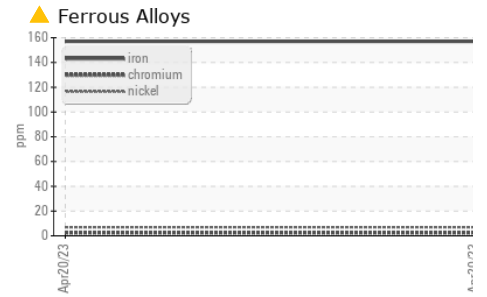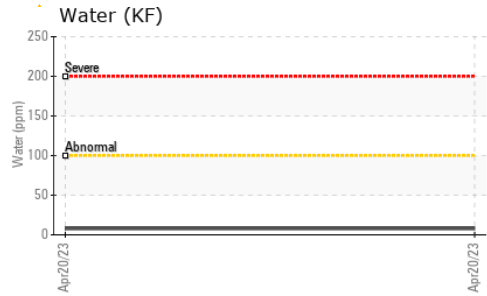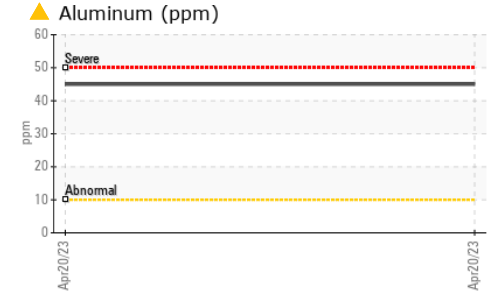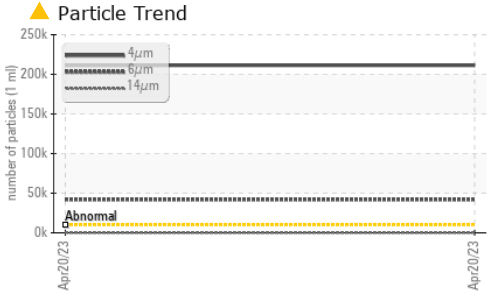






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	62.2	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

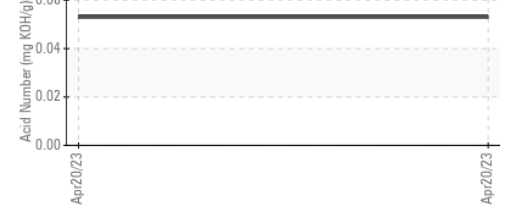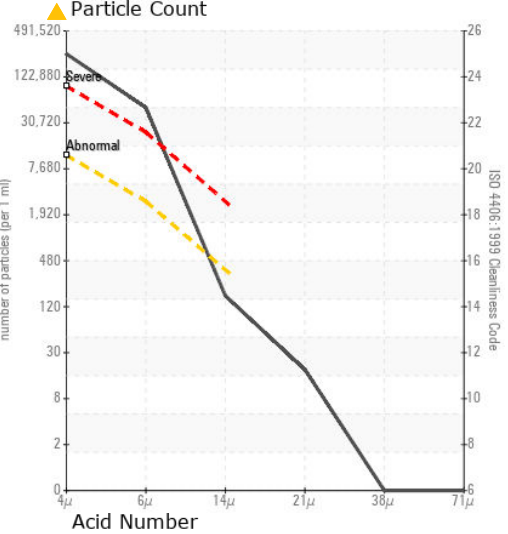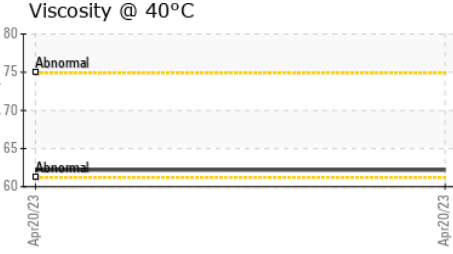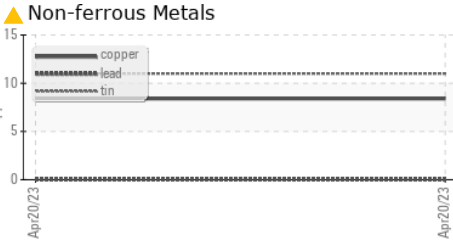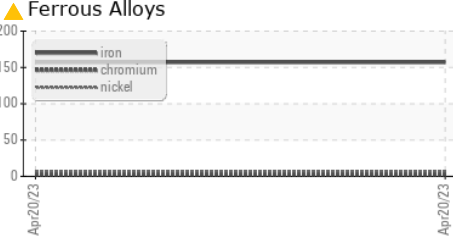

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807662 **Received** : 24 Apr 2023
Lab Number : 05828403 **Tested** : 26 Apr 2023
Unique Number : 10441896 **Diagnosed** : 26 Apr 2023 - Doug Bogart
Test Package : PLANT

SCHRADER MECHANICAL
 1015 BLACK DIAMOND WAY
 LODI PROVINCE, CA
 US 95240
 Contact: Schrader Mechanical
 amanda.h@smiwest.com
 T: (209)369-6888
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)