




# OIL ANALYSIS REPORT

Sample Rating Trend

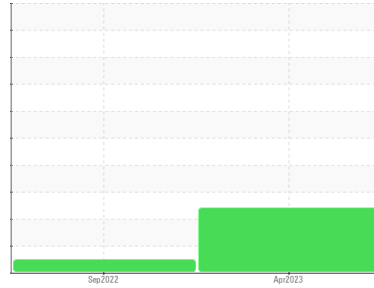

Machine Id  
**KAESER BSV 100 3558648 (S/N 1003)**

Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA002771</b>	KCP50192	---
Sample Date	Client Info		<b>24 Apr 2023</b>	07 Sep 2022	---
Machine Age	hrs	Client Info	<b>82337</b>	78665	---
Oil Age	hrs	Client Info	<b>0</b>	3000	---
Oil Changed	Client Info		<b>N/A</b>	Not Changd	---
Sample Status			<b>ABNORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>1</b>	2	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>116</b>	111	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m 90	<b>128</b>	106	---
Calcium	ppm	ASTM D5185m 2	<b>4</b>	4	---
Phosphorus	ppm	ASTM D5185m	<b>2</b>	4	---
Zinc	ppm	ASTM D5185m	<b>0</b>	2	---
Sulfur	ppm	ASTM D5185m	<b>16240</b>	14770	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<b>20</b>	18	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.013</b>	0.030	---
ppm Water	ppm	ASTM D6304 >500	<b>137.6</b>	300.9	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>14806</b>	3242	---
Particles >6µm	ASTM D7647 >1300		<b>▲ 8274</b>	772	---
Particles >14µm	ASTM D7647 >80		<b>▲ 2345</b>	47	---
Particles >21µm	ASTM D7647 >20		<b>▲ 852</b>	10	---
Particles >38µm	ASTM D7647 >4		<b>▲ 86</b>	1	---
Particles >71µm	ASTM D7647 >3		<b>▲ 2</b>	1	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 21/20/18</b>	19/17/13	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.46</b>	0.40	---


# OIL ANALYSIS REPORT

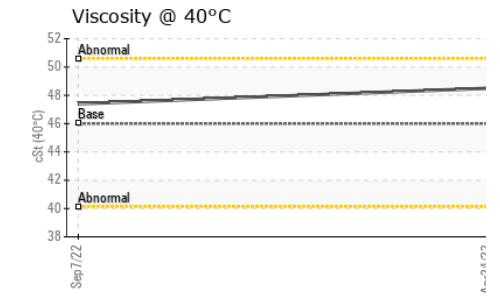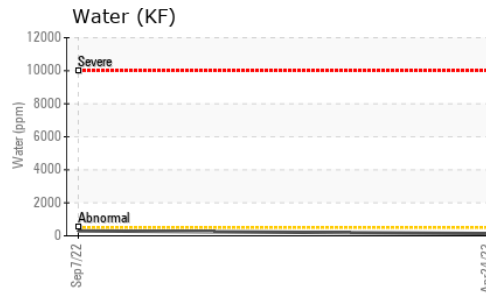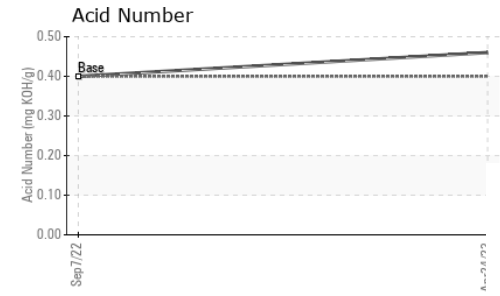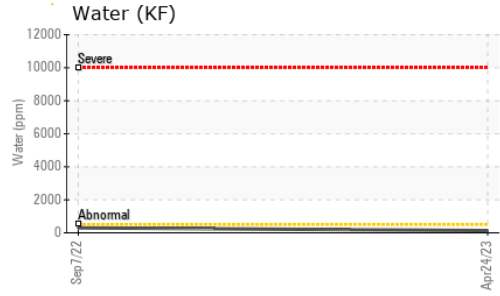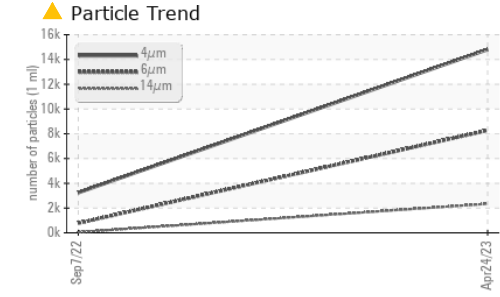





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	48.5	47.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

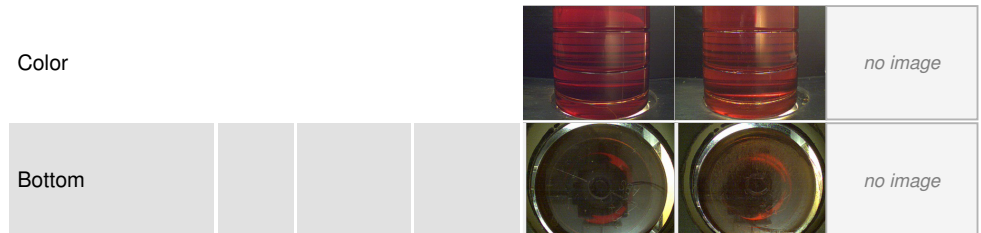

## GRAPHS

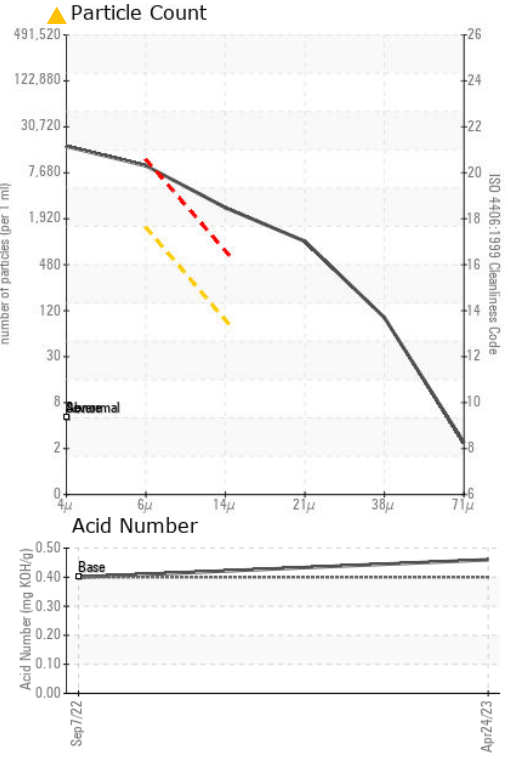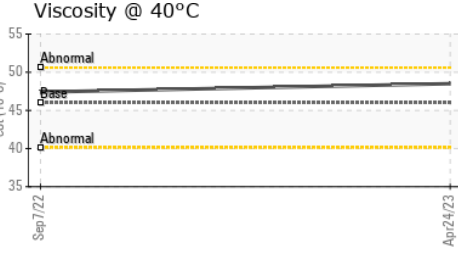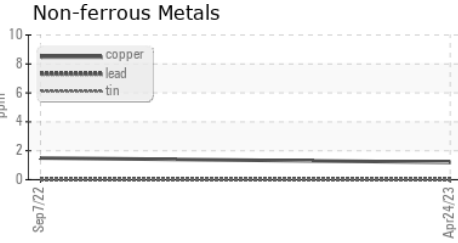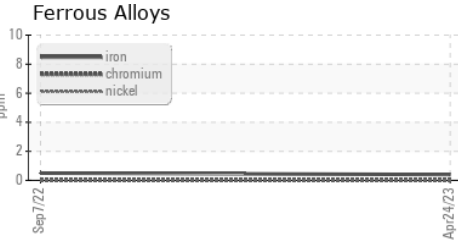

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA002771 **Received** : 24 Apr 2023  
**Lab Number** : 05828476 **Tested** : 25 Apr 2023  
**Unique Number** : 10441969 **Diagnosed** : 27 Apr 2023 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**GREINER BIO-ONE**  
 4238 CAPITOL DR.  
 MONROE, NC  
 US 28112  
 Contact: CHRISTOPHER BYRNE  
 christopher.byrne@gbo.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)