


PROBLEM SUMMARY

Area
EBAY
Machine Id
CD6MGB
Component
Main Gearbox
Fluid
MOBIL MOBILGEAR 600 XP ISO100 (40 GAL)

Sample Rating Trend

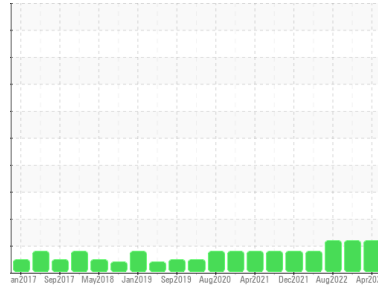


ISO



COMPONENT CONDITION SUMMARY

▲ Particle Trend

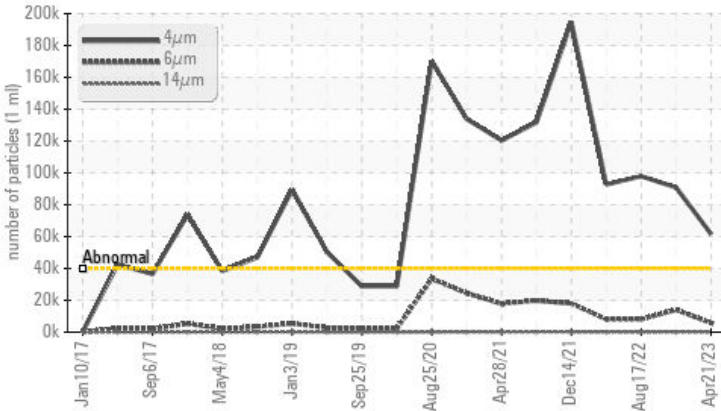

RECOMMENDATION

Resample at the next service interval to monitor.
Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>40000	▲ 61621	▲ 90837	▲ 97898
Particles >6µm	ASTM D7647	>5000	▲ 5814	▲ 14077	▲ 8070
Oil Cleanliness	ISO 4406 (c)	>22/19/16	▲ 23/20/12	▲ 24/21/14	▲ 24/20/13

Customer Id: KOBPIN
Sample No.: ST44453
Lab Number: 05830718
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Contact Required	---	---	?	Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

HISTORICAL DIAGNOSIS

19 Jan 2023 Diag: Jonathan Hester



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



17 Aug 2022 Diag: Doug Bogart



Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



20 Apr 2022 Diag: Jonathan Hester




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Area
EBAY
Machine Id
CD6MGB

Component
Main Gearbox
Fluid
MOBIL MOBILGEAR 600 XP ISO100 (40 GAL)

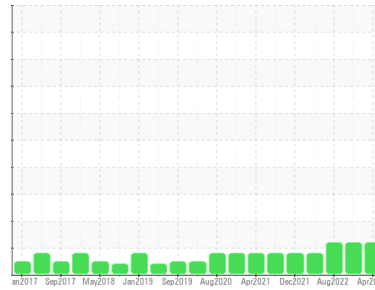

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		ST44453	ST44837	ST44248
Sample Date	Client Info		21 Apr 2023	19 Jan 2023	17 Aug 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	58	58	53
Chromium	ppm	ASTM D5185m >15	<1	<1	<1
Nickel	ppm	ASTM D5185m >15	0	0	<1
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	<1	<1	0
Lead	ppm	ASTM D5185m >100	0	1	1
Copper	ppm	ASTM D5185m >200	2	2	<1
Tin	ppm	ASTM D5185m >25	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	16	16	13
Barium	ppm	ASTM D5185m	0	1	0
Molybdenum	ppm	ASTM D5185m	<1	<1	0
Manganese	ppm	ASTM D5185m	1	<1	<1
Magnesium	ppm	ASTM D5185m	2	2	0
Calcium	ppm	ASTM D5185m	6	9	4
Phosphorus	ppm	ASTM D5185m	319	357	323
Zinc	ppm	ASTM D5185m	16	33	<1
Sulfur	ppm	ASTM D5185m	15202	14900	14875

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	7	9	9
Sodium	ppm	ASTM D5185m	1	2	1
Potassium	ppm	ASTM D5185m >20	0	0	<1
Water	%	ASTM D6304 >0.2	0.008	0.004	0.011
ppm Water	ppm	ASTM D6304 >2000	86.5	42.0	115.8






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>40000	▲ 61621	▲ 90837	▲ 97898
Particles >6µm	ASTM D7647	>5000	▲ 5814	▲ 14077	▲ 8070
Particles >14µm	ASTM D7647	>640	34	111	72
Particles >21µm	ASTM D7647	>160	3	8	12
Particles >38µm	ASTM D7647	>40	0	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>22/19/16	▲ 23/20/12	▲ 24/21/14	▲ 24/20/13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.70	0.67	0.69


OIL ANALYSIS REPORT

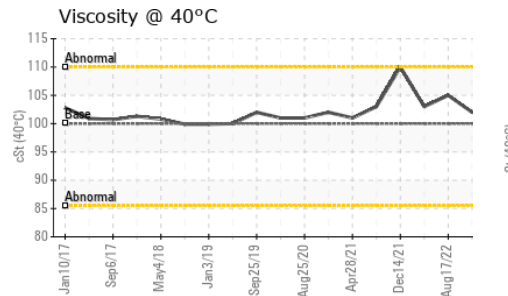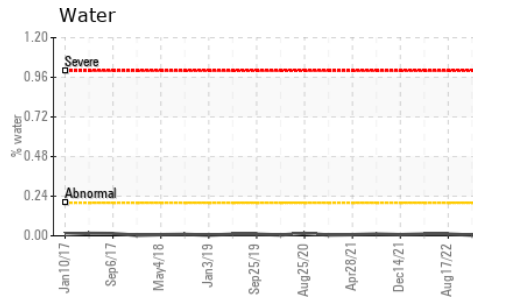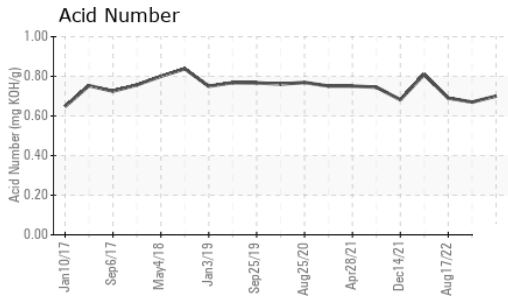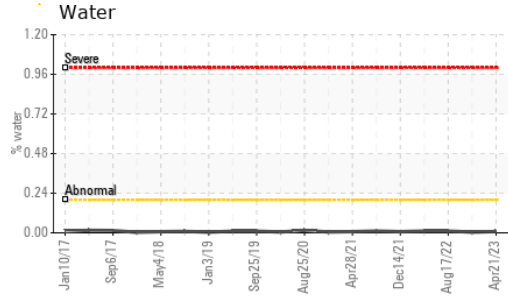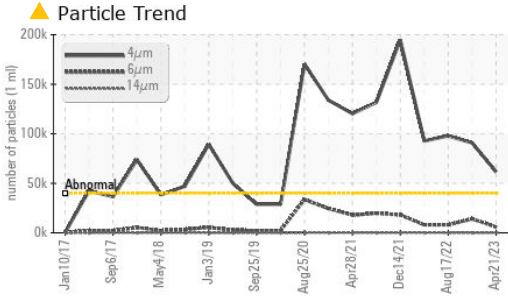





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	103	102

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

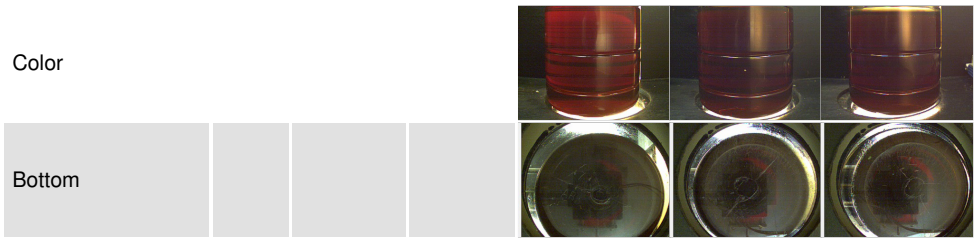

GRAPHS

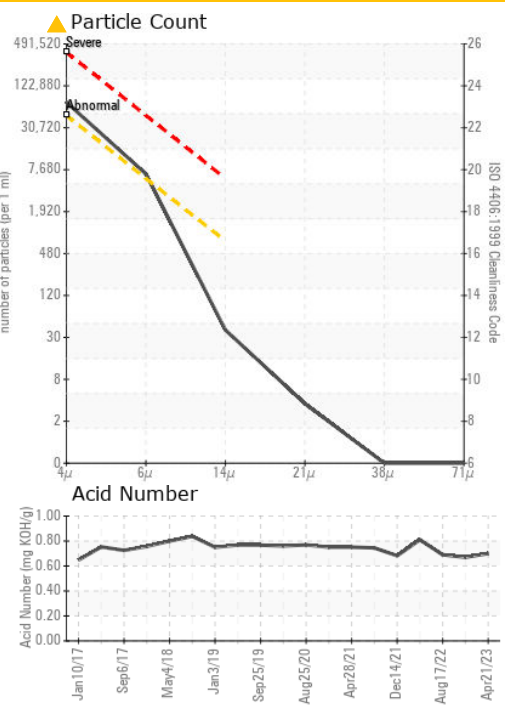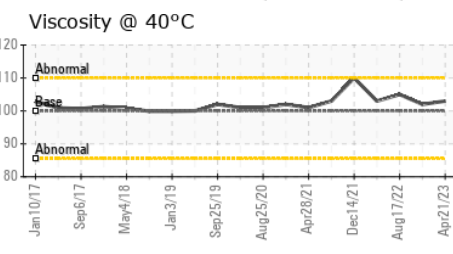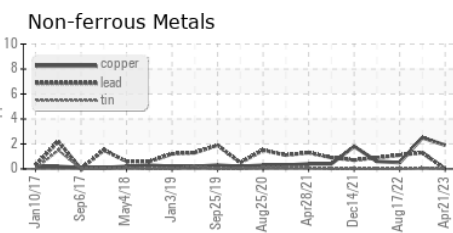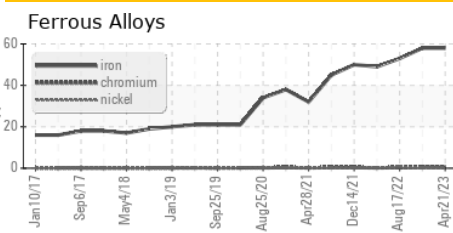

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : ST44453 **Received** : 26 Apr 2023
Lab Number : 05830718 **Diagnosed** : 28 Apr 2023
Unique Number : 10444211 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KOBE WIELAND COPPER PRODUCTS
 3990 HWY. 311
 PINE HALL, NC
 US 27042
 Contact: NEAL SHINAULT
 NEAL.SHINAULT@WIELAND.COM
 T: (336)604-1498
 F: