




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

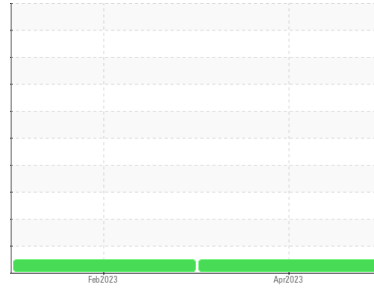

Area  
**[183825-N2STV4W]**  
 Machine Id  
**TS03-08**  
 Component  
**Hydraulic System**  
 Fluid  
**DURACLEAN (330 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PH05831115</b>	PH05773864	---
Sample Date	Client Info	<b>18 Apr 2023</b>	15 Feb 2023	---
Machine Age	hrs Client Info	<b>0</b>	0	---
Oil Age	hrs Client Info	<b>0</b>	0	---
Oil Changed	Client Info	<b>N/A</b>	N/A	---
Sample Status		<b>NORMAL</b>	NORMAL	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>20	<b>&lt;1</b>	<1	---
Chromium ppm ASTM D5185m	>20	<b>0</b>	0	---
Nickel ppm ASTM D5185m	>20	<b>0</b>	0	---
Titanium ppm ASTM D5185m		<b>0</b>	0	---
Silver ppm ASTM D5185m		<b>0</b>	0	---
Aluminum ppm ASTM D5185m	>20	<b>0</b>	0	---
Lead ppm ASTM D5185m	>20	<b>0</b>	0	---
Copper ppm ASTM D5185m	>20	<b>16</b>	16	---
Tin ppm ASTM D5185m	>20	<b>0</b>	0	---
Vanadium ppm ASTM D5185m		<b>0</b>	0	---
Cadmium ppm ASTM D5185m		<b>0</b>	0	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	0	---
Barium ppm ASTM D5185m		<b>0</b>	0	---
Molybdenum ppm ASTM D5185m		<b>0</b>	0	---
Manganese ppm ASTM D5185m		<b>0</b>	0	---
Magnesium ppm ASTM D5185m		<b>&lt;1</b>	0	---
Calcium ppm ASTM D5185m		<b>22</b>	20	---
Phosphorus ppm ASTM D5185m		<b>442</b>	421	---
Zinc ppm ASTM D5185m		<b>640</b>	562	---
Sulfur ppm ASTM D5185m		<b>1155</b>	1285	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	<b>0</b>	<1	---
Sodium ppm ASTM D5185m		<b>0</b>	3	---
Potassium ppm ASTM D5185m	>20	<b>&lt;1</b>	0	---

## FLUID CLEANLINESS





method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>10000	<b>896</b>	2428	---
Particles >6µm ASTM D7647	>2500	<b>173</b>	459	---
Particles >14µm ASTM D7647	>320	<b>8</b>	17	---
Particles >21µm ASTM D7647	>80	<b>2</b>	2	---
Particles >38µm ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness ISO 4406 (c)	>20/18/15	<b>17/15/10</b>	18/16/11	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.55</b>	0.52	---



# OIL ANALYSIS REPORT

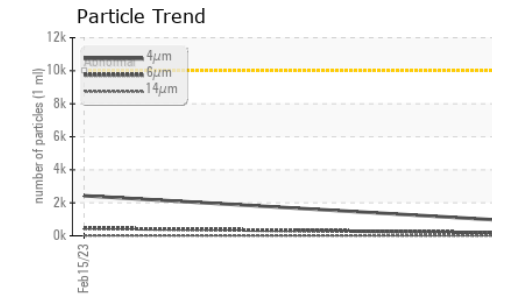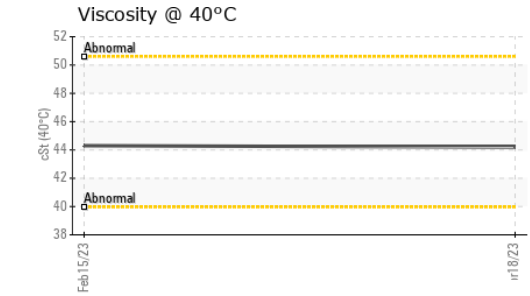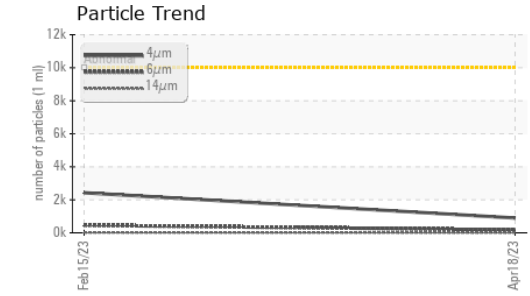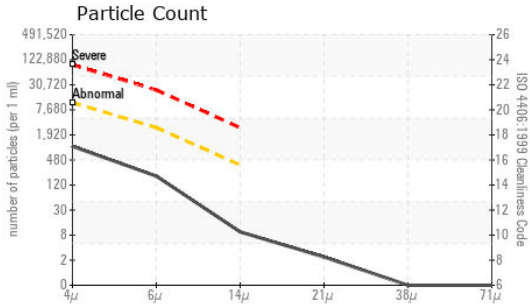

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PH05831115 **Received** : 27 Apr 2023  
**Lab Number** : 05831115 **Diagnosed** : 01 May 2023  
**Unique Number** : 10444608 **Diagnostician** : Don Baldrige  
**Test Package** : PLANT

**PARKER HANNIFIN CORPORATION**  
 221 HELICOPTER CIR  
 CORONA, CA  
 US 92878  
 Contact: ALEX ALVAREZ  
 alex.alvarez@parker.com  
 T: (951)475-6106  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	44.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image
PrtFilter				no image	no image

## GRAPHS

