




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

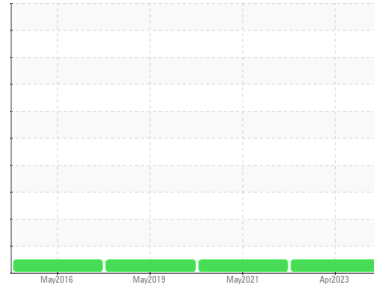

Area  
**WHEY**  
 Machine Id  
**SL23AG21**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL SHC 630 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0797224</b>	WC0579331	WC04712512
Sample Date	Client Info	<b>21 Apr 2023</b>	29 May 2021	03 May 2019
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >200	<b>87</b>	70	102
Chromium	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	1
Nickel	ppm	ASTM D5185m >15	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>1</b>	0	2
Lead	ppm	ASTM D5185m >100	<b>0</b>	7	0
Copper	ppm	ASTM D5185m >200	<b>0</b>	4	0
Tin	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m >5	<b>---</b>	0	3
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	14	<1
Barium	ppm	ASTM D5185m	<b>0</b>	7	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m	<b>476</b>	355	393
Zinc	ppm	ASTM D5185m	<b>4</b>	11	9
Sulfur	ppm	ASTM D5185m	<b>274</b>	7602	112

## CONTAMINANTS


method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	<b>22</b>	18	28
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	16

## VISUAL

method	limit/base	current	history1	history2	
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	MODER	LIGHT
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG




# OIL ANALYSIS REPORT



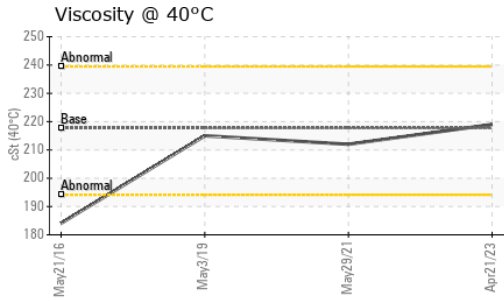


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	217.7	<b>219</b>	212	215

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

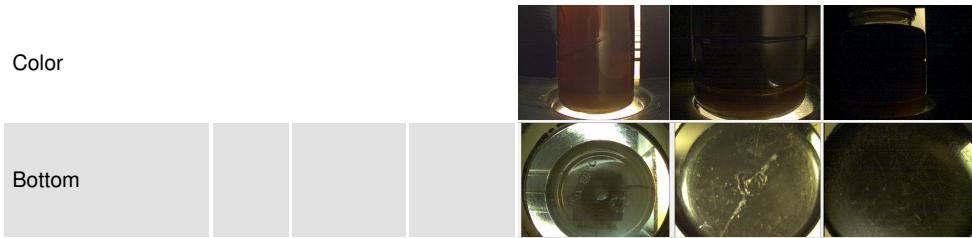

## GRAPHS

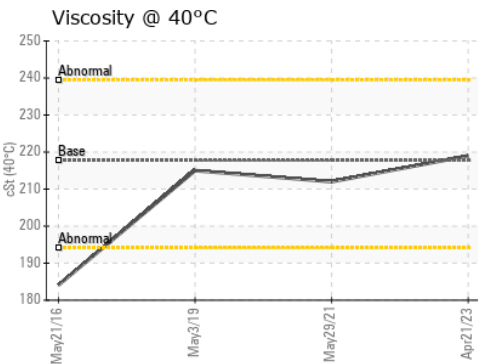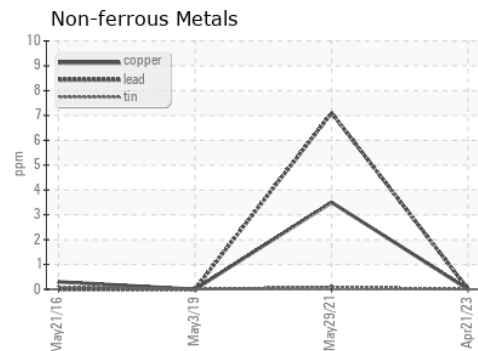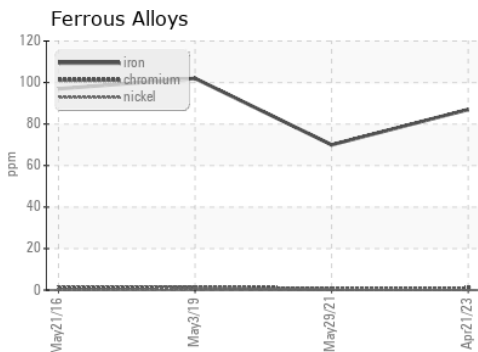

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0797224      **Received** : 28 Apr 2023  
**Lab Number** : 05833327      **Diagnosed** : 01 May 2023  
**Unique Number** : 10446820      **Diagnostician** : Wes Davis  
**Test Package** : IND 1

**LEPRINO FOODS-GREELEY**  
 1302 1ST AVE  
 GREELEY, CO  
 US 80631-5909  
 Contact: ERIC KLINE  
 EKLIN@LEPRINOFODS.COM  
 T:  
 F: (970)347-5190

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)