




FUEL REPORT

Sample Rating Trend

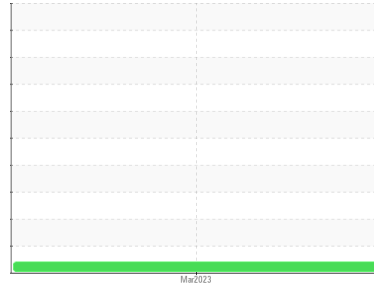

VIS DEBRIS



Machine Id
HARNETT GEN

Component
Diesel Fuel

Fluid
DIESEL FUEL No. 1 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

Moderate concentration of visible dirt/debris present in the fuel. There is no bacteria or fungus (yeast and/or mold) present in the sample. The water content is negligible.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0798097	---	---
Sample Date	Client Info			22 Mar 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				ABNORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.840	---	---
Fuel Color	text	*Visual Screen		Red	---	---
ASTM Color	scalar	*ASTM D1500		L4.0	---	---
Visc @ 40°C	cSt	ASTM D445	2.4	2.34	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		57	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	---	---
Sulfur (UVF)	ppm	ASTM D5453		9	---	---


DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		160	---	---
5% Distillation Point	°C	ASTM D86		186	---	---
10% Distill Point	°C	ASTM D86		197	---	---
15% Distillation Point	°C	ASTM D86		206	---	---
20% Distill Point	°C	ASTM D86		213	---	---
30% Distill Point	°C	ASTM D86		227	---	---
40% Distill Point	°C	ASTM D86		242	---	---
50% Distill Point	°C	ASTM D86		257	---	---
60% Distill Point	°C	ASTM D86		272	---	---
70% Distill Point	°C	ASTM D86		289	---	---
80% Distill Point	°C	ASTM D86		307	---	---
85% Distillation Point	°C	ASTM D86		317	---	---
90% Distill Point	°C	ASTM D86		328	---	---
95% Distillation Point	°C	ASTM D86		344	---	---
Final Boiling Point	°C	ASTM D86		352	---	---
Distillation Residue	%	ASTM D86		1.4	---	---
Distillation Loss	%	ASTM D86		0.9	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		37.0	---	---
Cetane Index		ASTM D4737	<40.0	47.7	---	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	---	---
Sodium	ppm	ASTM D5185m	<0.1	0	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	0.005	---	---
ppm Water	ppm	ASTM D6304	<500	50.6	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	2.4	---	---






FUEL REPORT

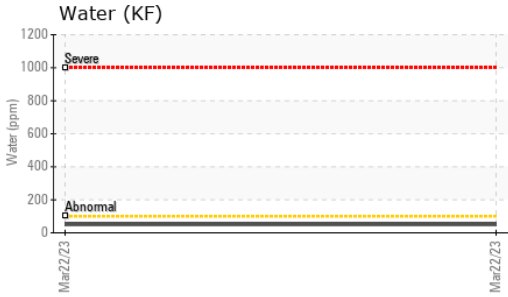



HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	0	---	---
Vanadium	ppm	ASTM D5185m	<0.1	0	---	---
Iron	ppm	ASTM D5185m	<0.1	0	---	---
Calcium	ppm	ASTM D5185m	<0.1	0	---	---
Magnesium	ppm	ASTM D5185m	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---

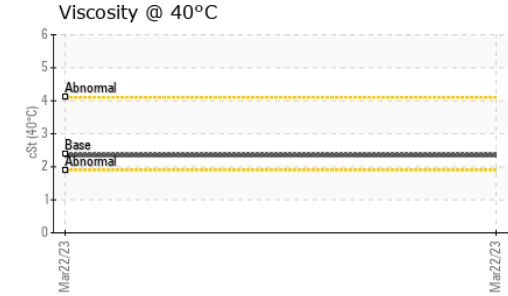

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color				no image	no image	no image
Bottom				no image	no image	no image

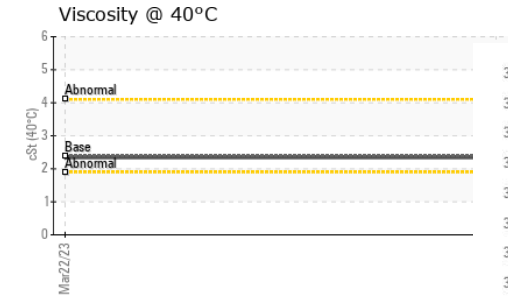

GRAPHS

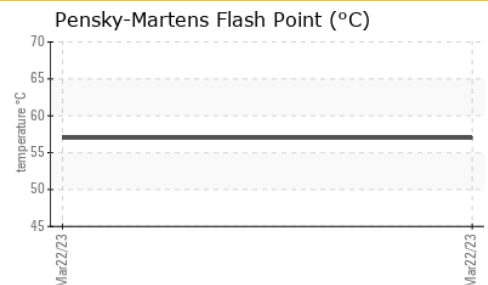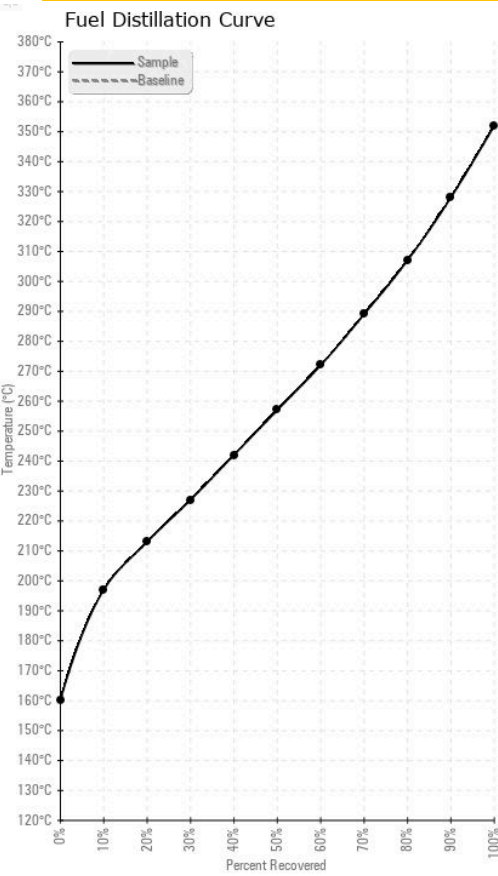

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0798097 **Received** : 28 Apr 2023
Lab Number : **05833378** **Diagnosed** : 12 May 2023
Unique Number : 10446871 **Diagnostician** : Doug Bogart
Test Package : DF-2 (Additional Tests: Screen)

KB POWER SYSTEMS LLC
 738 Old Buies Creek Rd
 Lillington, NC
 US 27546
 Contact: DWAYNE REGISTER
 dwayne@kbpowersystemsnc.com
 T: (919)577-9136
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)