



FUEL REPORT

Sample Rating Trend



ISO



Machine Id
833 - PARMELE UNIT 2

Component
Diesel Fuel
Fluid
DIESEL FUEL No. 1 (--- GAL)

DIAGNOSIS

▲ Recommendation

Recommend pre-filtering before use. All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

▲ Contaminants

There is a high amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0798137	---	---
Sample Date	Client Info			11 Apr 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				ABNORMAL	---	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.844	---	---
Fuel Color	text	*Visual Screen		Red	---	---
ASTM Color	scalar	*ASTM D1500		L4.0	---	---
Visc @ 40°C	cSt	ASTM D445	2.4	2.6	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated		63	---	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	---	---
Sulfur (UVF)	ppm	ASTM D5453		89	---	---






DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		172	---	---
5% Distillation Point	°C	ASTM D86		195	---	---
10% Distill Point	°C	ASTM D86		205	---	---
15% Distillation Point	°C	ASTM D86		213	---	---
20% Distill Point	°C	ASTM D86		220	---	---
30% Distill Point	°C	ASTM D86		235	---	---
40% Distill Point	°C	ASTM D86		249	---	---
50% Distill Point	°C	ASTM D86		262	---	---
60% Distill Point	°C	ASTM D86		276	---	---
70% Distill Point	°C	ASTM D86		291	---	---
80% Distill Point	°C	ASTM D86		307	---	---
85% Distillation Point	°C	ASTM D86		316	---	---
90% Distill Point	°C	ASTM D86		327	---	---
95% Distillation Point	°C	ASTM D86		342	---	---
Final Boiling Point	°C	ASTM D86		350	---	---
Distillation Residue	%	ASTM D86		1.4	---	---
Distillation Loss	%	ASTM D86		0.7	---	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777		36.2	---	---
Cetane Index		ASTM D4737	<40.0	47.4	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	---	---
Sodium	ppm	ASTM D5185m	<0.1	0	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	0.004	---	---
ppm Water	ppm	ASTM D6304	<500	44.5	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	1.6	---	---



FUEL REPORT

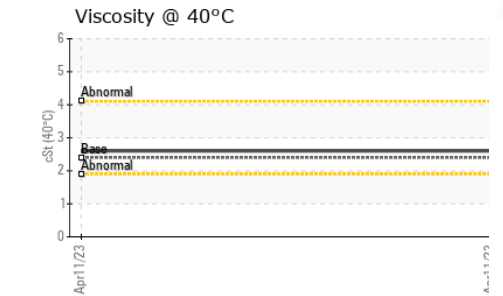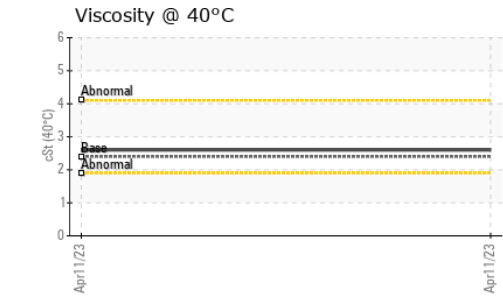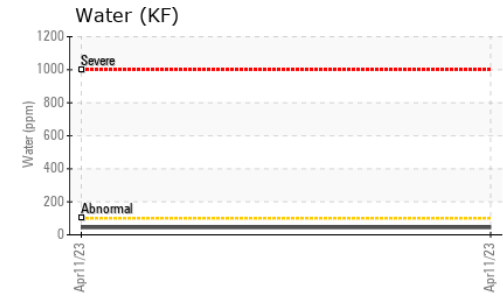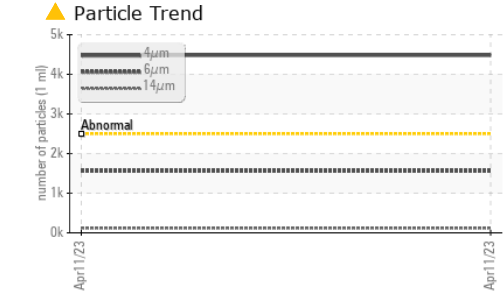
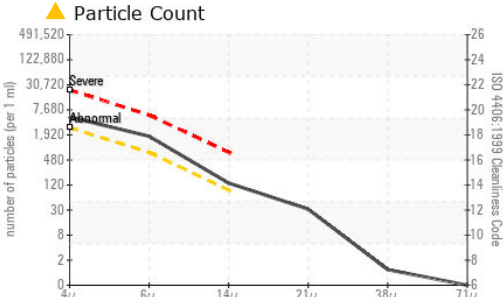


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	▲ 4481	---	---
Particles >6µm	ASTM D7647	>640	▲ 1560	---	---
Particles >14µm	ASTM D7647	>80	▲ 118	---	---
Particles >21µm	ASTM D7647	>20	▲ 28	---	---
Particles >38µm	ASTM D7647	>4	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 19/18/14	---	---

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	---	---
Nickel	ppm	ASTM D5185m <0.1	0	---	---
Lead	ppm	ASTM D5185m <0.1	0	---	---
Vanadium	ppm	ASTM D5185m <0.1	0	---	---
Iron	ppm	ASTM D5185m <0.1	0	---	---
Calcium	ppm	ASTM D5185m <0.1	0	---	---
Magnesium	ppm	ASTM D5185m <0.1	0	---	---
Phosphorus	ppm	ASTM D5185m <0.1	0	---	---
Zinc	ppm	ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

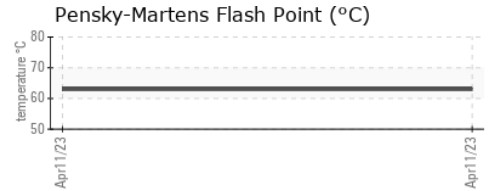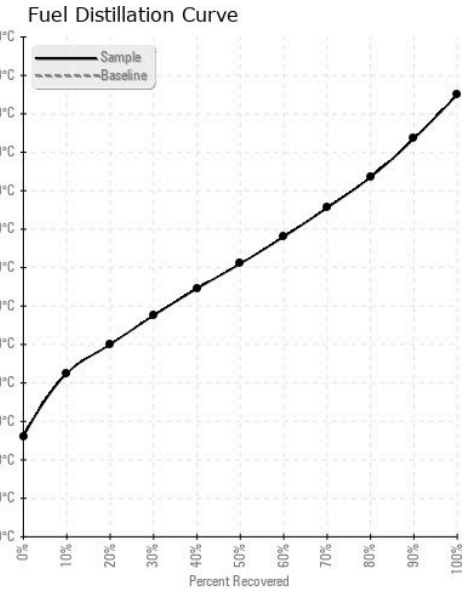

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0798137 **Received** : 28 Apr 2023
Lab Number : 05833385 **Tested** : 10 May 2023
Unique Number : 10446878 **Diagnosed** : 12 May 2023 - Doug Bogart
Test Package : DF-2 (Additional Tests: Screen)

KB POWER SYSTEMS LLC
 738 Old Buies Creek Rd
 Lillington, NC
 US 27546
 Contact: DWAYNE REGISTER
 dwayne@kbpowersystemsnc.com
 T: (919)577-9136
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)