




# OIL ANALYSIS REPORT

Sample Rating Trend

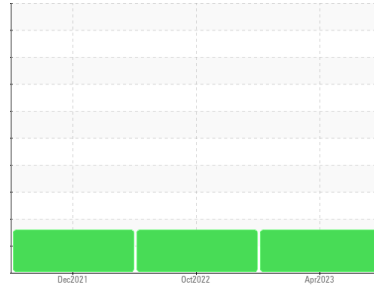

ISO



Machine Id  
**KAESER 5887817**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCP53241</b>	KCP46323	KCP43323
Sample Date	Client Info			<b>17 Apr 2023</b>	05 Oct 2022	21 Dec 2021
Machine Age	hrs	Client Info		<b>54145</b>	49496	42596
Oil Age	hrs	Client Info		<b>0</b>	6934	0
Oil Changed	Client Info			<b>Changed</b>	N/A	Changed
Sample Status				<b>ABNORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	1	<1
Copper	ppm	ASTM D5185m	>50	<b>4</b>	8	14
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>31</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>77</b>	29	6
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	14	3
Zinc	ppm	ASTM D5185m	0	<b>18</b>	23	32
Sulfur	ppm	ASTM D5185m	23500	<b>23542</b>	22391	17172

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	2	2
Sodium	ppm	ASTM D5185m		<b>39</b>	10	<1
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	2	0
Water	%	ASTM D6304	>0.05	<b>0.019</b>	0.016	0.003
ppm Water	ppm	ASTM D6304	>500	<b>196.1</b>	162.5	33.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>16308</b>	7453	8888
Particles >6µm		ASTM D7647	>1300	<b>▲ 4190</b>	▲ 1895	▲ 2492
Particles >14µm		ASTM D7647	>80	<b>▲ 174</b>	▲ 127	▲ 184
Particles >21µm		ASTM D7647	>20	<b>▲ 31</b>	▲ 31	▲ 38
Particles >38µm		ASTM D7647	>4	<b>2</b>	1	▲ 5
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 21/19/15</b>	▲ 20/18/14	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.49</b>	0.40	0.401


# OIL ANALYSIS REPORT

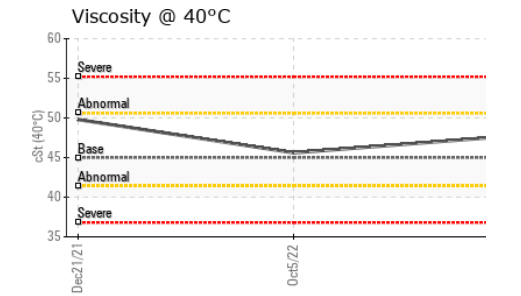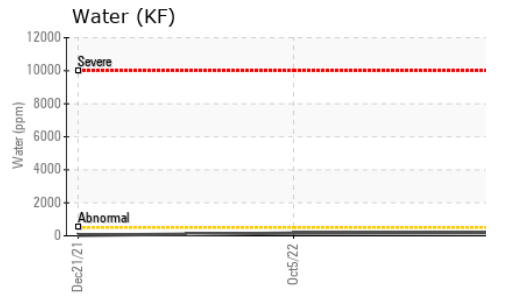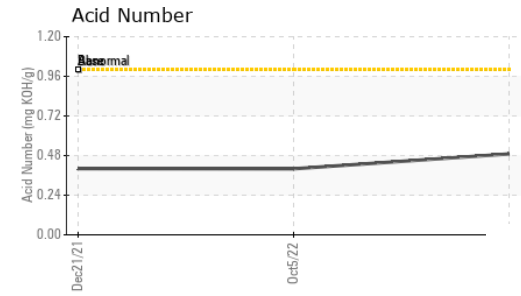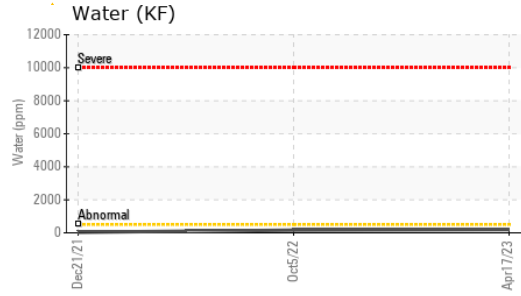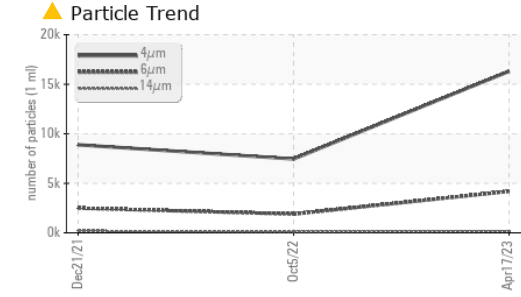






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.7	45.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

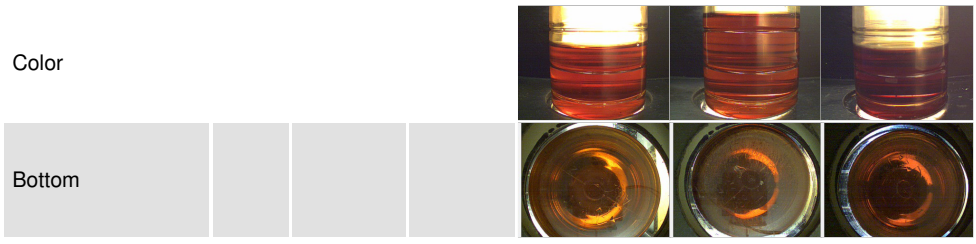

## GRAPHS

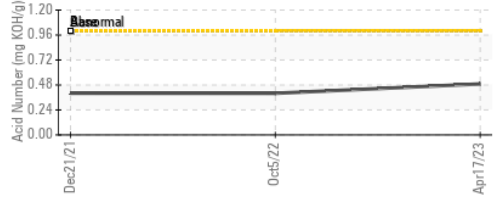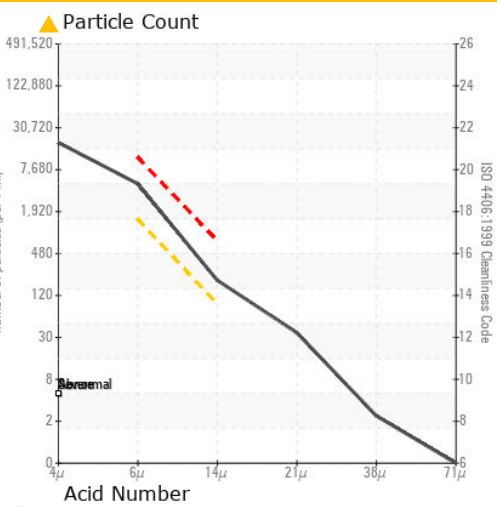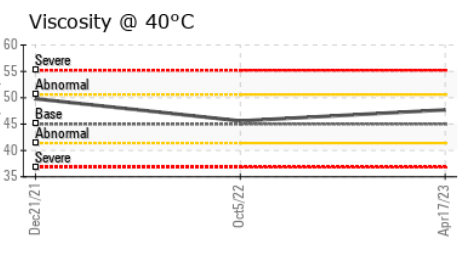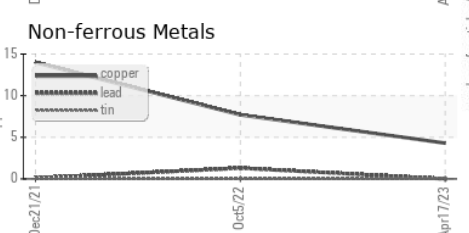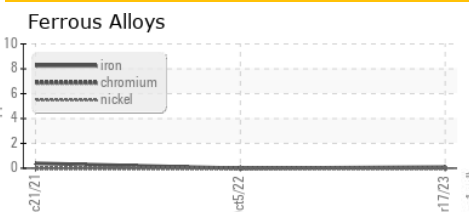

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP53241 **Recieved** : 01 May 2023  
**Lab Number** : 05834563 **Diagnosed** : 03 May 2023  
**Unique Number** : 10453366 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CHAPMAN FORD SERVICES**  
 9371 ROOSEVELT BLVD  
 PHILADELPHIA, PA  
 US 19114  
 Contact: J. EYER  
 jeyer@chapmanautogroup.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)