

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id 8296519 (S/N 1587) Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111218	KC90718	
Sample Date		Client Info		18 Apr 2023	18 Jul 2022	
Machine Age	hrs	Client Info		8523	3570	
Oil Age	hrs	Client Info		5000	3570	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m		6	5	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m	~10	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	2	
Barium	ppm	ASTM D5185m	90	33	55	
Molybdenum	ppm	ASTM D5185m	00	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	50	67	
Calcium	ppm	ASTM D5185m		2	5	
Phosphorus	ppm	ASTM D5185m	L	3	37	
Zinc	ppm	ASTM D5185m		6	4	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	4	
Sodium	ppm	ASTM D5185m	220	20	18	
Potassium	ppm	ASTM D5185m	>20	7	17	
Water	%	ASTM D5103III		0.012	0.030	
ppm Water	ppm	ASTM D6304	>500	123.5	302.3	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9980	2308	
Particles >6µm		ASTM D7647	>1300	<u> </u>	451	
Particles >14µm		ASTM D7647	>80	A 159	20	
Particles >21µm		ASTM D7647	>20	<u> </u>	5	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/19/14	18/16/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOH/a	ASTM D8045		0.28	0.34	
				0.20		





Built for a lifetime


OIL ANALYSIS REPORT





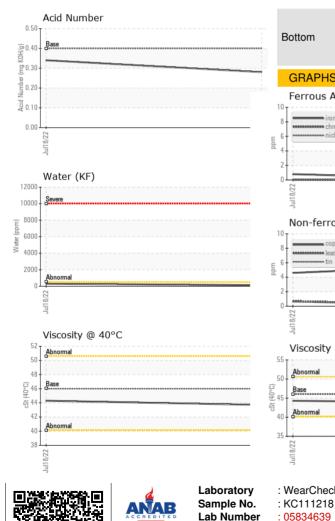

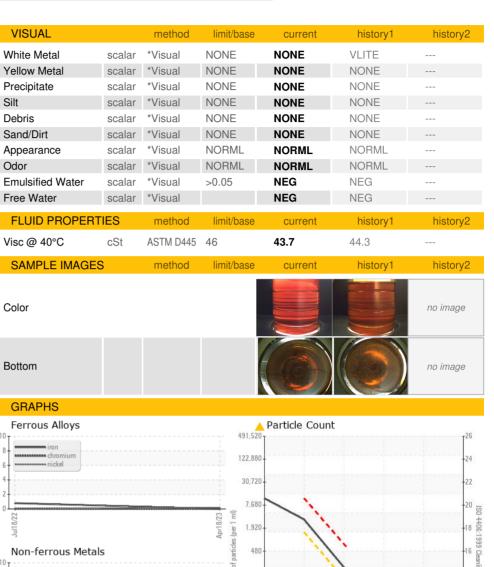

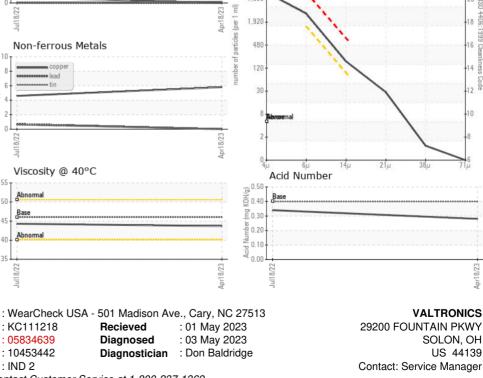

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: 10453442

: IND 2

Unique Number

Test Package

Abnorma

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

14

Certificate L2367

Contact/Location: Service Manager - VALSOL