




# OIL ANALYSIS REPORT

Sample Rating Trend

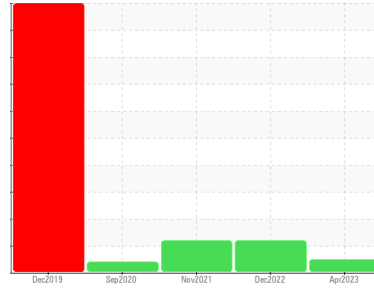

Machine Id  
**KAESER ASD 25 5747171 (S/N 1164)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCP53314</b>	KCP55699	KCP43581
Sample Date	Client Info		<b>28 Apr 2023</b>	09 Dec 2022	17 Nov 2021
Machine Age	hrs	Client Info	<b>19540</b>	18404	15197
Oil Age	hrs	Client Info	<b>2000</b>	2000	3100
Oil Changed	Client Info		<b>Not Chngd</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>2</b>	2	3
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	13
Barium	ppm	ASTM D5185m 90	<b>3</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 100	<b>67</b>	58	46
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185m 0	<b>&lt;1</b>	4	0
Zinc	ppm	ASTM D5185m 0	<b>20</b>	29	43
Sulfur	ppm	ASTM D5185m 23500	<b>21732</b>	21672	17995

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>17</b>	13	15
Potassium	ppm	ASTM D5185m >20	<b>4</b>	2	3
Water	%	ASTM D6304 >0.05	<b>0.021</b>	0.030	0.020
ppm Water	ppm	ASTM D6304 >500	<b>219.4</b>	309.4	209.7






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>3816</b>	3347	23102
Particles >6µm	ASTM D7647	>1300	<b>1041</b>	1133	▲ 6141
Particles >14µm	ASTM D7647	>80	<b>71</b>	▲ 130	▲ 245
Particles >21µm	ASTM D7647	>20	<b>17</b>	▲ 35	▲ 31
Particles >38µm	ASTM D7647	>4	<b>1</b>	2	2
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>19/17/13</b>	▲ 19/17/14	▲ 20/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.59</b>	0.41	0.369


# OIL ANALYSIS REPORT

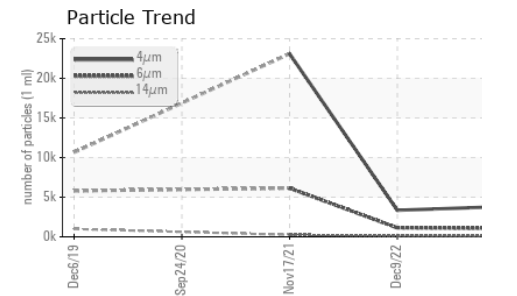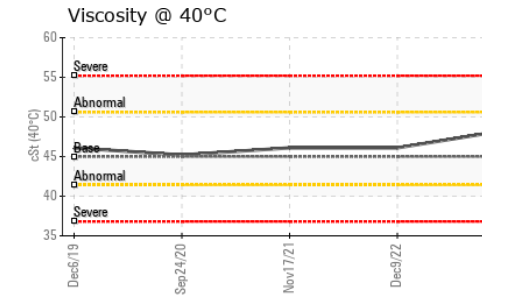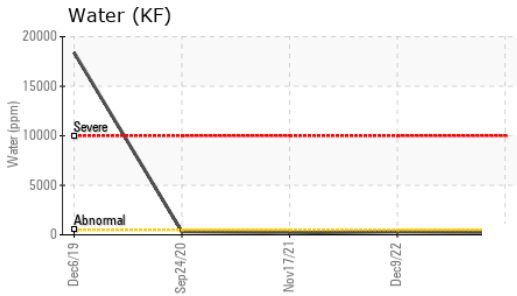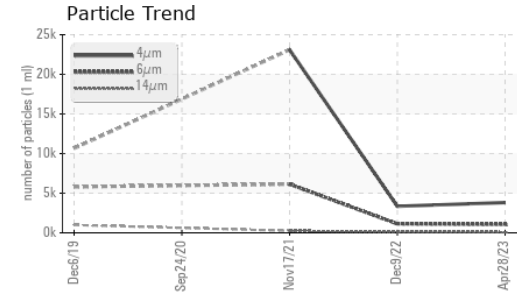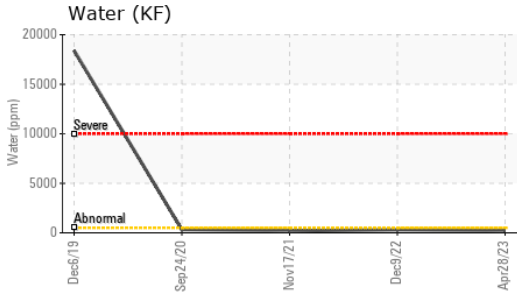






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.3	46.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

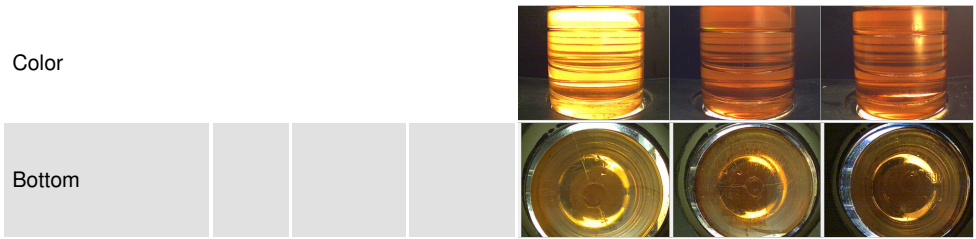

## GRAPHS

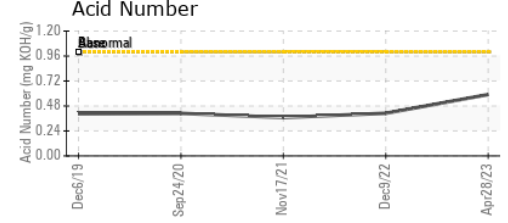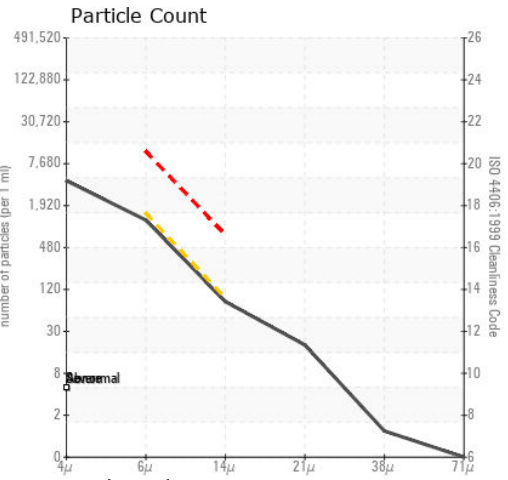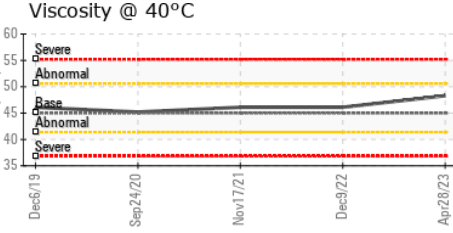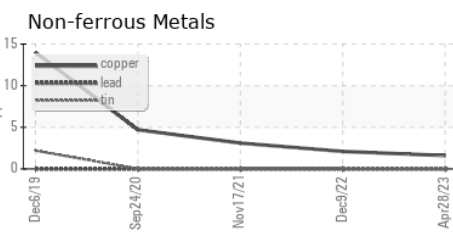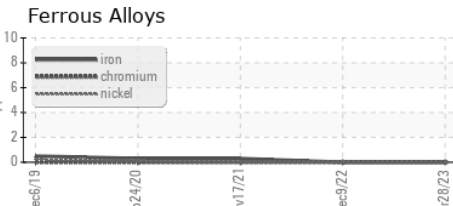

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP53314 **Received** : 02 May 2023  
**Lab Number** : 05836014 **Diagnosed** : 04 May 2023  
**Unique Number** : 10454817 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**IMAGEFIRST HP**  
 639 ALTON PL  
 HIGH POINT, NC  
 US 27263  
 Contact: J. SPREADBURY  
 jspreadbury@imagefirst.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)