



# PROBLEM SUMMARY

Sample Rating Trend

DEGRADATION

Area  
**[SV2304200200/1]**  
 Machine Id  
**TRANE Y & S CANDY CHILLER 4 (S/N L93H08342)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**TRANE 0022 (8 GAL)**



## COMPONENT CONDITION SUMMARY

### ▲ Acid Number



## RECOMMENDATION

The oil is near the end of its useful service life, recommend schedule an oil change. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	mg KOH/g	ASTM D974	ABNORMAL	---	---
Acid Number (AN)	0.119		▲	---	---

Customer Id: MCQUPP  
 Sample No.: WC0664531  
 Lab Number: 05842192  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Service/change Fluid	---	---	?	The oil is near the end of it's useful service life, recommend schedule an oil change.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

DEGRADATION

Area  
**[SV2304200200/1]**  
 Machine Id  
**TRANE Y & S CANDY CHILLER 4 (S/N L93H08342)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**TRANE 0022 (8 GAL)**



## DIAGNOSIS

### ▲ Recommendation

The oil is near the end of its useful service life, recommend schedule an oil change. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### ▲ Fluid Condition

The AN level is at the top-end of the recommended limit.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0664531</b>	---	---
Sample Date	Client Info		<b>27 Apr 2023</b>	---	---
Machine Age	hrs	Client Info	<b>107293</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>10</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>12</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>1</b>	---	---
Zinc	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>12</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>8</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304 >0.01	<b>0.001</b>	---	---
ppm Water	ppm	ASTM D6304 >100	<b>8.5</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>▲ 0.119</b>	---	---





# OIL ANALYSIS REPORT

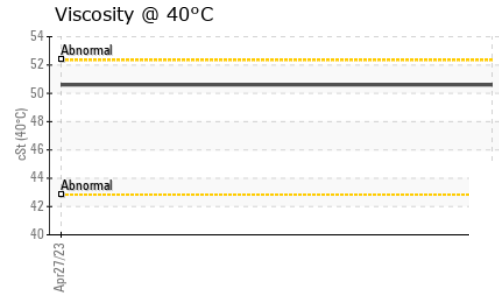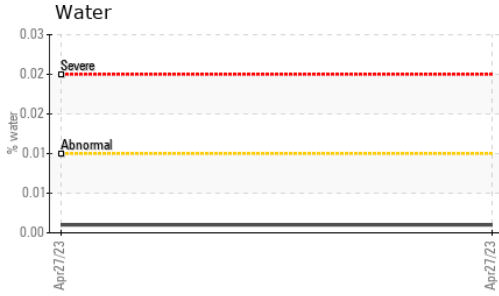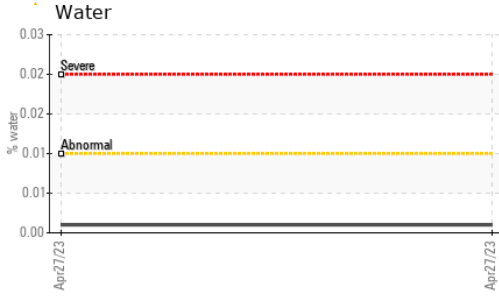





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	50.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

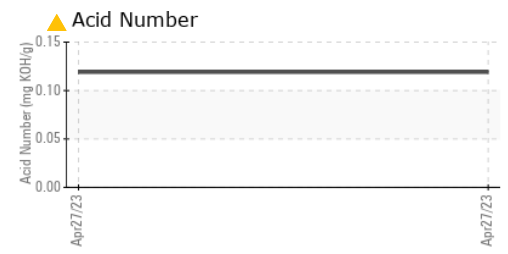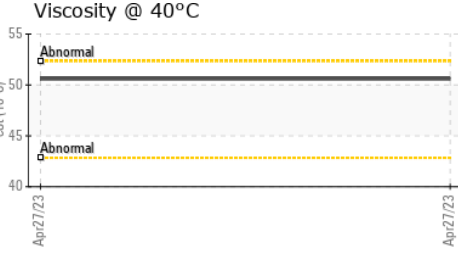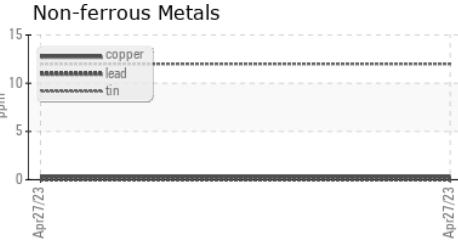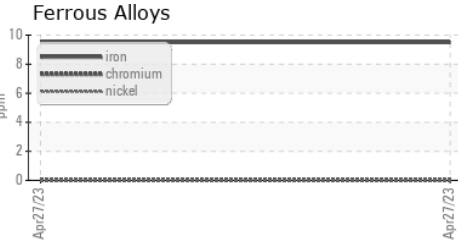

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0664531 **Received** : 09 May 2023  
**Lab Number** : 05842192 **Diagnosed** : 12 May 2023  
**Unique Number** : 10466299 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT

**DAIKIN APPLIED**  
 5021 HOWERTON WAY SUITE P  
 BOWIE, MD  
 US 20715  
 Contact: ANDREW TURLINGTON  
 andrew.turlington@daikinapplied.com  
 T: (301)735-1440  
 F: (301)735-1838

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)