




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

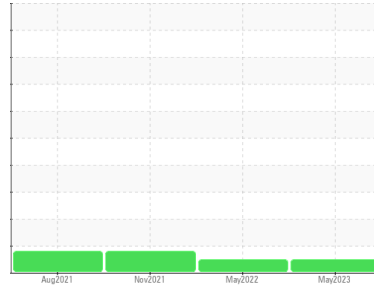

Area  
**VACUUM PUMP**  
 Machine Id  
**B68619 - BATCHING SYSTEM VACUUM MIXER 2**  
 Component  
**Vacuum Pump**  
 Fluid  
**BUSCH R530S (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0755364</b>	WC0691588	WC0580130
Sample Date	Client Info	<b>05 May 2023</b>	10 May 2022	01 Nov 2021
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>Not Changed</b>	Not Changed	Not Changed
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>20	<b>0</b>	0	<1
Chromium ppm ASTM D5185m	>20	<b>0</b>	0	0
Nickel ppm ASTM D5185m	>20	<b>0</b>	0	0
Titanium ppm ASTM D5185m		<b>0</b>	0	0
Silver ppm ASTM D5185m		<b>0</b>	0	0
Aluminum ppm ASTM D5185m	>20	<b>0</b>	0	0
Lead ppm ASTM D5185m	>20	<b>0</b>	<1	0
Copper ppm ASTM D5185m	>20	<b>0</b>	<1	0
Tin ppm ASTM D5185m	>20	<b>0</b>	0	0
Antimony ppm ASTM D5185m		<b>---</b>	---	0
Vanadium ppm ASTM D5185m		<b>0</b>	0	0
Cadmium ppm ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	<1	0
Barium ppm ASTM D5185m		<b>0</b>	1	0
Molybdenum ppm ASTM D5185m		<b>0</b>	<1	0
Manganese ppm ASTM D5185m		<b>0</b>	0	0
Magnesium ppm ASTM D5185m		<b>0</b>	1	0
Calcium ppm ASTM D5185m		<b>0</b>	2	0
Phosphorus ppm ASTM D5185m		<b>3</b>	7	12
Zinc ppm ASTM D5185m		<b>0</b>	<1	0
Sulfur ppm ASTM D5185m		<b>183</b>	57	14

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	<b>5</b>	5	2
Sodium ppm ASTM D5185m		<b>0</b>	0	0
Potassium ppm ASTM D5185m	>20	<b>&lt;1</b>	<1	0

## FLUID CLEANLINESS





method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>5000	<b>3309</b>	3287	▲ 21633
Particles >6µm ASTM D7647	>1300	<b>737</b>	673	▲ 3760
Particles >14µm ASTM D7647	>160	<b>13</b>	28	115
Particles >21µm ASTM D7647	>40	<b>3</b>	6	18
Particles >38µm ASTM D7647	>10	<b>0</b>	0	1
Particles >71µm ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness ISO 4406 (c)	>19/17/14	<b>19/17/11</b>	19/17/12	▲ 22/19/14

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.066</b>	0.054	0.062




# OIL ANALYSIS REPORT

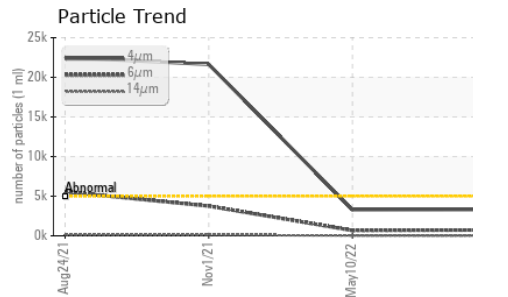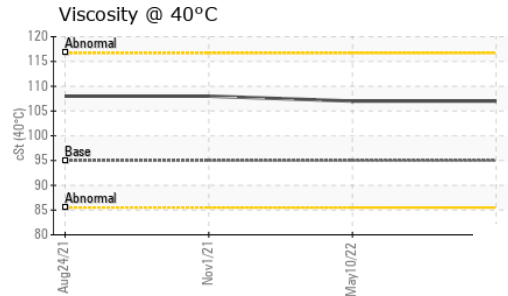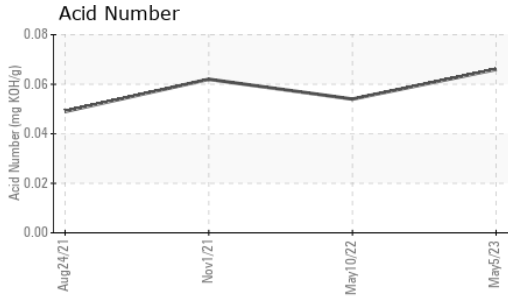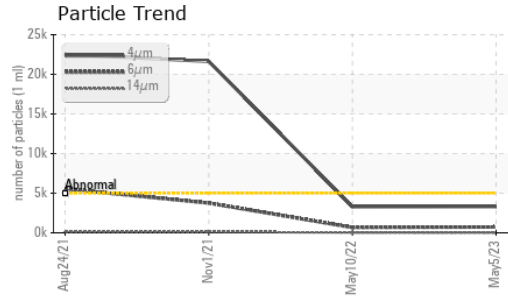






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 95.0	107	107	108

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

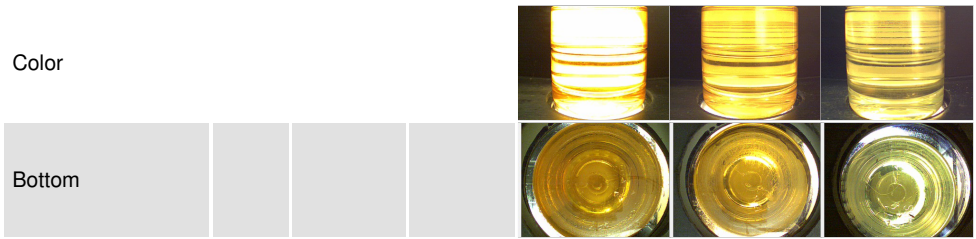

## GRAPHS

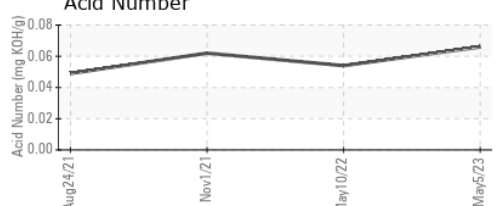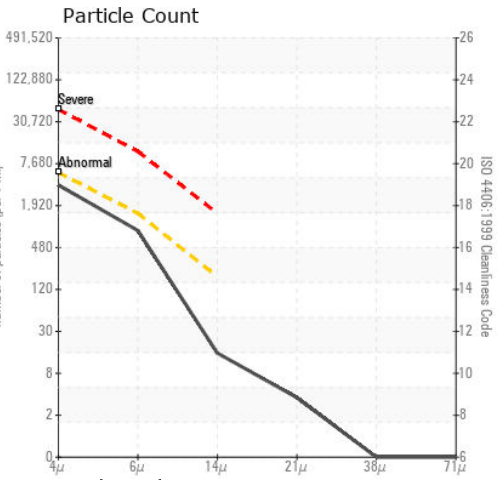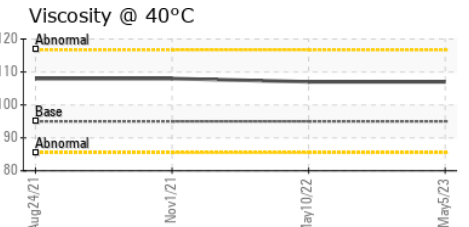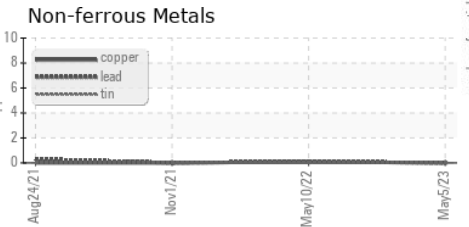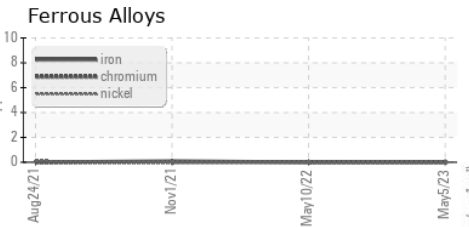

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0755364 **Received** : 11 May 2023  
**Lab Number** : 05844422 **Diagnosed** : 14 May 2023  
**Unique Number** : 10468529 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**PAPILLION FOODS**  
 10808 S 132ND ST  
 OMAHA, NE  
 US 68138  
 Contact: NEIL ARIANO  
 njariano@hormel.com

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)