


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



# Machine Id KAESER BSD 50 4388313 (S/N 1140)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2019	Apr2020 Nov2020	Apr2021 Dec2021 Aug2022	May2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP55320	KCP50036	KCP39170
Sample Date		Client Info		09 May 2023	08 Aug 2022	13 Dec 2021
Machine Age	hrs	Client Info		54380	53393	50917
Oil Age	hrs	Client Info		6000	3000	3000
Oil Changed		Client Info		Changed	Not Changd	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	15	4	25
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	16
Barium	ppm	ASTM D5185m	90	0	43	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	6	50	0
Calcium	ppm	ASTM D5185m	0	0	2	0
Phosphorus	ppm	ASTM D5185m	0	4	<1	3
Zinc	ppm	ASTM D5185m	0	112	31	150
Sulfur	ppm	ASTM D5185m	23500	24705	16343	16450
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	1
Sodium	ppm	ASTM D5185m		3	3	<1
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.007	0.028	0.008
ppm Water	ppm	ASTM D6304	>500	76.4	286.3	81.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3532	21330	
Particles >6µm		ASTM D7647	>1300	888	<b>△</b> 6071	
Particles >14µm		ASTM D7647	>80	46	<b>△</b> 645	
Particles >21µm		ASTM D7647	>20	7	<b>▲</b> 174	
Particles >38µm		ASTM D7647	>4	1	<u> </u>	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	<u>22/20/17</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

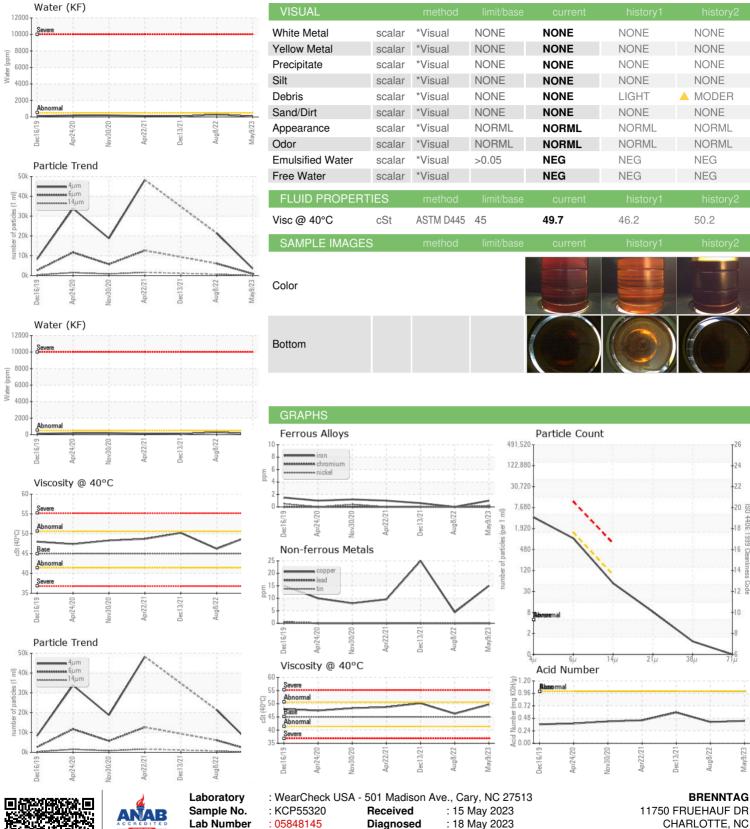





Certificate L2367

Report Id: BRECHANC [WUSCAR] 05848145 (Generated: 11/19/2023 21:37:57) Rev: 1

Lab Number **Unique Number** 

: 05848145 : 10472252

Diagnosed

: 18 May 2023

Diagnostician : Jonathan Hester

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Service Manager PITTMANBEACH2016@GMAIL.COM T:

US 28273

F: