



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER BSD 50 8714003 (S/N 1471)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

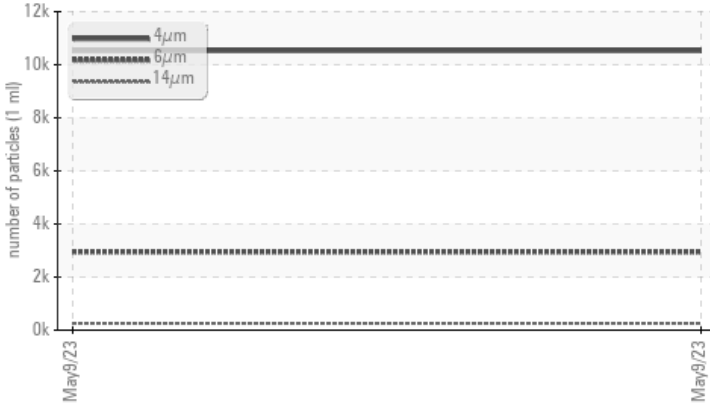

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2948	---	---
Particles >14µm	ASTM D7647	>80	▲ 256	---	---
Particles >21µm	ASTM D7647	>20	▲ 56	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/15	---	---

Customer Id: BRECHANC
 Sample No.: KCP55316
 Lab Number: 05849245
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
KAESER BSD 50 8714003 (S/N 1471)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP55316	---	---
Sample Date	Client Info	09 May 2023	---	---
Machine Age	hrs Client Info	3037	---	---
Oil Age	hrs Client Info	3037	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	0	---	---
Chromium ppm	ASTM D5185m >10	0	---	---
Nickel ppm	ASTM D5185m >3	0	---	---
Titanium ppm	ASTM D5185m >3	<1	---	---
Silver ppm	ASTM D5185m >2	0	---	---
Aluminum ppm	ASTM D5185m >10	<1	---	---
Lead ppm	ASTM D5185m >10	0	---	---
Copper ppm	ASTM D5185m >50	3	---	---
Tin ppm	ASTM D5185m >10	0	---	---
Vanadium ppm	ASTM D5185m	0	---	---
Cadmium ppm	ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	0	---	---
Barium ppm	ASTM D5185m 90	0	---	---
Molybdenum ppm	ASTM D5185m 0	0	---	---
Manganese ppm	ASTM D5185m	<1	---	---
Magnesium ppm	ASTM D5185m 100	43	---	---
Calcium ppm	ASTM D5185m 0	0	---	---
Phosphorus ppm	ASTM D5185m 0	3	---	---
Zinc ppm	ASTM D5185m 0	34	---	---
Sulfur ppm	ASTM D5185m 23500	21285	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	0	---	---
Sodium ppm	ASTM D5185m	9	---	---
Potassium ppm	ASTM D5185m >20	10	---	---
Water %	ASTM D6304 >0.05	0.025	---	---
ppm Water	ASTM D6304 >500	254.9	---	---

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	10526	---	---
Particles >6µm	ASTM D7647 >1300	▲ 2948	---	---
Particles >14µm	ASTM D7647 >80	▲ 256	---	---
Particles >21µm	ASTM D7647 >20	▲ 56	---	---
Particles >38µm	ASTM D7647 >4	3	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/19/15	---	---

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	0.37	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

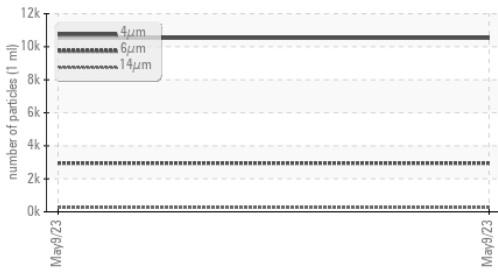


Water (KF)

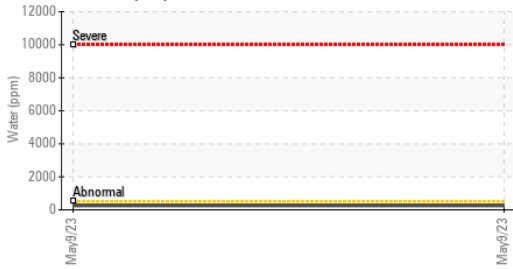


Acid Number

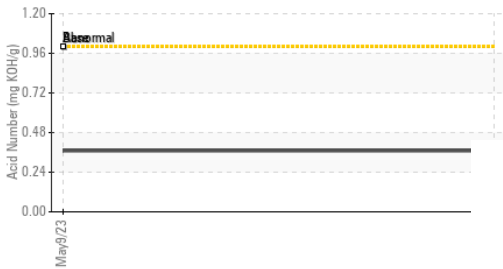

Water (KF)

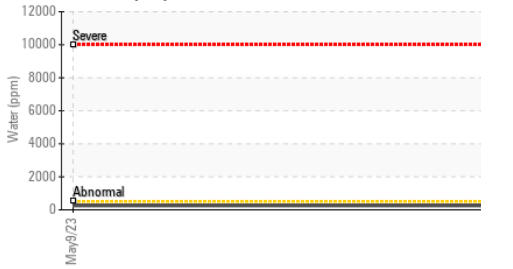

Viscosity @ 40°C

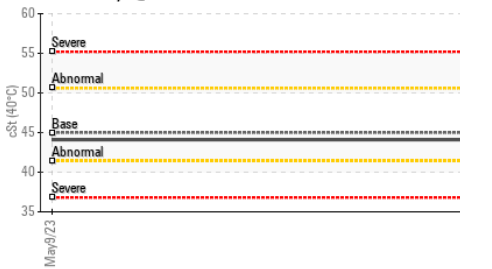

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color		no image	no image
Bottom		no image	no image

GRAPHS

Ferrous Alloys




Non-ferrous Metals

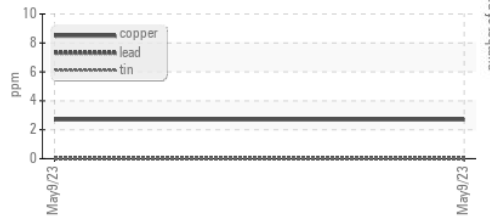

Viscosity @ 40°C



▲ Particle Count

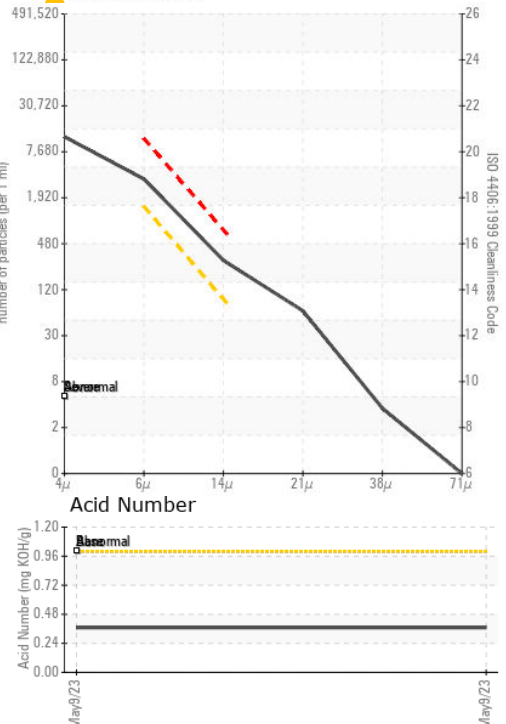

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP55316 **Received** : 16 May 2023
Lab Number : 05849245 **Diagnosed** : 19 May 2023
Unique Number : 10473352 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

BRENTAG
 11750 FRUEHAUF DR
 CHARLOTTE, NC
 US 28273
 Contact: Service Manager
 PITTMANBEACH2016@GMAIL.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: