

PROBLEM SUMMARY

Sample Rating Trend

ISO


7986410 (S/N 1733)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

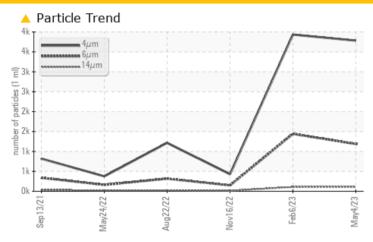

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | | |
|--------------------------|--------------|---------|-----------------|-------------------|----------|--|--|--|--|
| Sample Status | | | ATTENTION | ATTENTION | NORMAL | | | | |
| Particles >14µm | ASTM D7647 | >80 | <u> </u> | <u> </u> | 14 | | | | |
| Particles >21µm | ASTM D7647 | >20 | 4 0 | 15 | 2 | | | | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | 19/17/14 | △ 19/18/14 | 16/14/11 | | | | |

Customer Id: CAVSTP Sample No.: KC102781 Lab Number: 05849729 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|---------------|--------|------|---------|---|
| Change Fluid | | | ? | Oil and filter change at the time of sampling has been noted. |
| Change Filter | | | ? | Oil and filter change at the time of sampling has been noted. |

HISTORICAL DIAGNOSIS

06 Feb 2023 Diag: Angela Borella

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Nov 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

22 Aug 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

7986410 (S/N 1733)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)





DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | Sep2021 | May2022 Aug2022 | . Nov2022 Feb2023 | May2023 | |
|------------------|----------|--------------|-----------------|-------------------|-------------------|-------------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KC102781 | KC103031 | KC107894 |
| Sample Date | | Client Info | | 04 May 2023 | 06 Feb 2023 | 16 Nov 2022 |
| Machine Age | hrs | Client Info | | 12054 | 10938 | 9572 |
| Oil Age | hrs | Client Info | | 5514 | 4398 | 3032 |
| Oil Changed | | Client Info | | Changed | Not Changd | Not Changd |
| Sample Status | | | | ATTENTION | ATTENTION | NORMAL |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | 1 | 0 | 0 |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | 8 | 7 | 13 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 90 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 90 | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 2 | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 3 | 3 | 33 |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | <1 |
| CONTAMINANTS | 3 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | <1 | <1 |
| Sodium | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |
| Water | % | ASTM D6304 | >0.05 | 0.007 | 0.007 | 0.008 |
| ppm Water | ppm | ASTM D6304 | >500 | 79.7 | 79.3 | 87.5 |
| FLUID CLEANLIN | NESS | method | limit/base | current | history1 | history2 |
| Particles >4μm | | ASTM D7647 | | 3782 | 3934 | 428 |
| Particles >6µm | | ASTM D7647 | >1300 | 1188 | <u>▲</u> 1442 | 147 |
| Particles >14μm | | ASTM D7647 | >80 | <u> </u> | <u>▲</u> 108 | 14 |
| Particles >21μm | | ASTM D7647 | >20 | 40 | 15 | 2 |
| Particles >38μm | | ASTM D7647 | >4 | 3 | 1 | 0 |
| Particles >71μm | | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | <u> </u> | △ 19/18/14 | 16/14/11 |
| FLUID DEGRADA | ATION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.31 | 0.31 | 0.32 |



OIL ANALYSIS REPORT

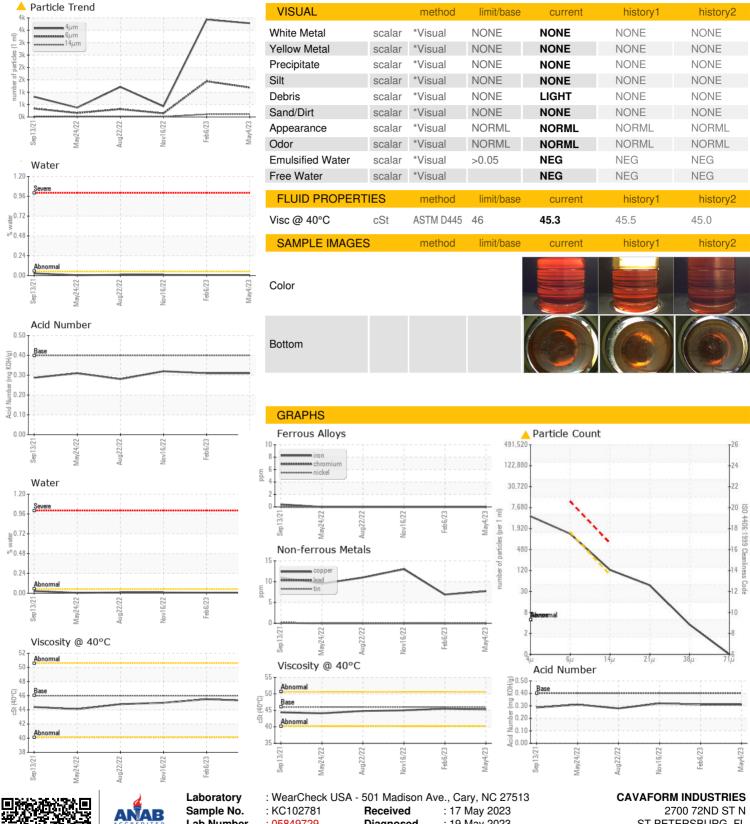





Certificate L2367

Lab Number **Unique Number**

Test Package

: 05849729

: 10479084 : IND 2

Diagnosed Diagnostician

: 19 May 2023 : Don Baldridge ST PETERSBURG, FL

US 33710

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: