


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



KAESER 7361746

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 202	2 Aug2022	Feb 2023 M	ay2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC102757	KC107903	KC98118
Sample Date		Client Info		04 May 2023	08 Feb 2023	05 Aug 2022
Machine Age	hrs	Client Info		3007	2815	2372
Oil Age	hrs	Client Info		635	443	980
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	2	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	3	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	64	81	46
Calcium	ppm	ASTM D5185m	2	<1	2	0
Phosphorus	ppm	ASTM D5185m		8	8	6
Zinc	ppm	ASTM D5185m		0	23	2
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	<1
Sodium	ppm	ASTM D5185m		27	23	18
Potassium	ppm	ASTM D5185m	>20	5	8	7
Water	%	ASTM D6304	>0.05	0.036	0.035	0.026
ppm Water	ppm	ASTM D6304	>500	368.1	355.0	266.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		566	3613	1254
Particles >6µm		ASTM D7647	>1300	174	<u>▲</u> 1305	311
Particles >14μm		ASTM D7647	>80	15	<u>▲</u> 127	18
Particles >21µm		ASTM D7647	>20	4	<u>▲</u> 31	2
Particles >38μm		ASTM D7647	>4	0	2	1
Particles >71µm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/15/11	1 9/18/14	17/15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	1/011/	4 OT1 4 D 00 4 F	0.4		0.00	

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.33

0.29

0.28



OIL ANALYSIS REPORT

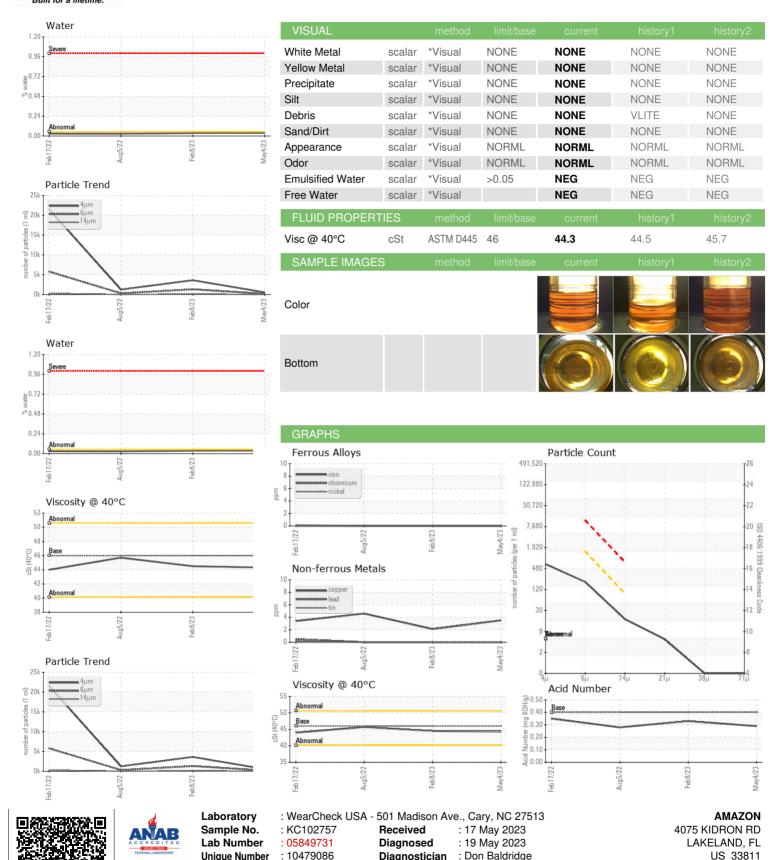

Certificate L2367

Unique Number

Test Package

: 10479086

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 33811

T: F:

Contact: Service Manager