

OIL ANALYSIS REPORT

Sample Rating Trend **NORMAL**

5549461 (S/N 1235)

Component

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2023		
SAMPLE INFORM	AATION	mathad			hiotomil	history/2
	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP52310		
Sample Date		Client Info		01 May 2023		
Machine Age	hrs	Client Info		39443		
Oil Age	hrs	Client Info		7975		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m	500	27		
Zinc	ppm	ASTM D5185m		6		
Sulfur	ppm	ASTM D5185m		1159		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.004		
ppm Water	ppm	ASTM D6304	>500	48.3		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4626		
Particles >6µm		ASTM D7647	>1300	950		
Particles >14µm		ASTM D7647	>80	64		
Particles >21µm		ASTM D7647	>20	16		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A a d Ni wala a w (ANI)	I/OLI/-	ACTM DOOM	1.5	0.20		


Acid Number (AN)

mg KOH/g ASTM D8045 1.5

0.32



OIL ANALYSIS REPORT

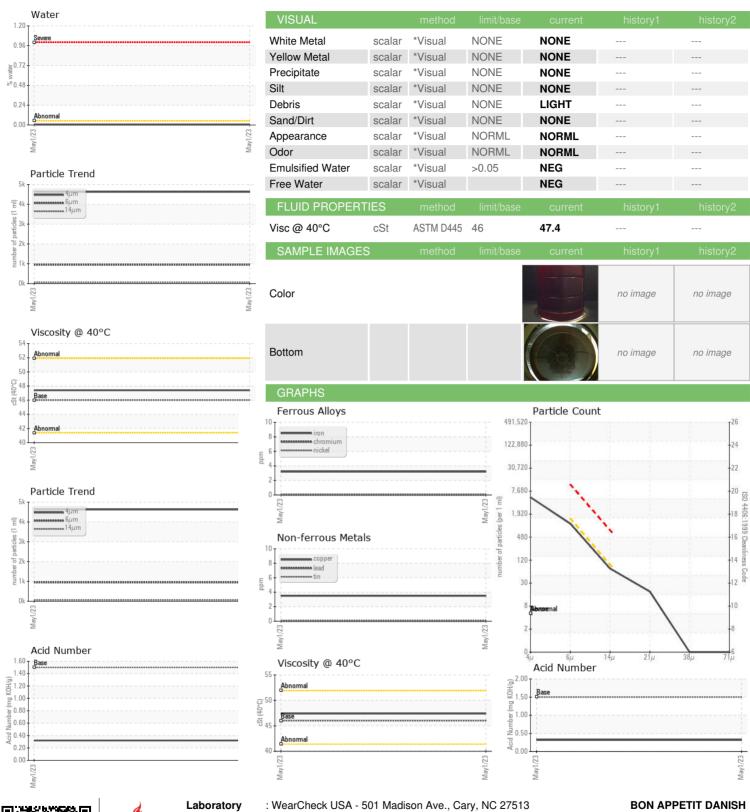





Certificate L2367

Sample No. Lab Number **Unique Number**

: KCP52310

: 05849751 : 10479106

Received Diagnosed

: 19 May 2023 Diagnostician : Don Baldridge

: 17 May 2023

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

4820 E 50TH ST VERNON, CA US 90058

Contact: Service Manager

T:

F: