




PROBLEM SUMMARY

Sample Rating Trend

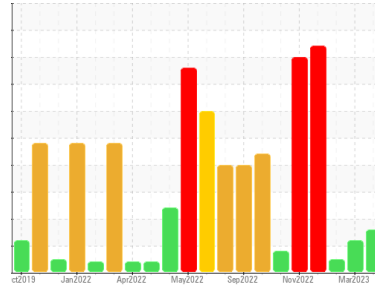


ISO



Machine Id
RECYCLED NH3
 Component
Refrigeration Compressor
 Fluid
USPI ALT-68 SC (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

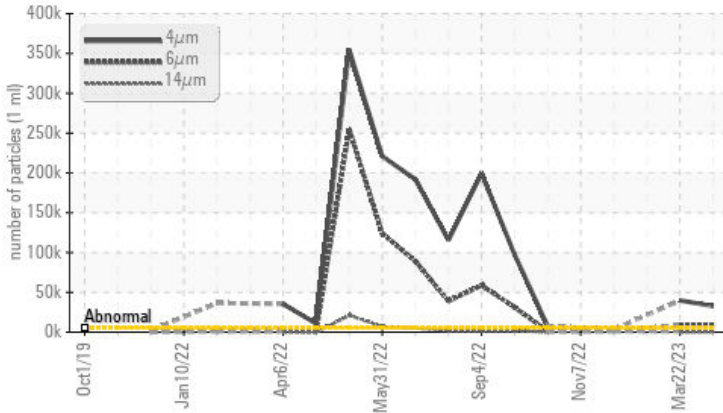

RECOMMENDATION

This is a baseline read-out on the submitted sample.
 5TH BATCH RECLAIMED.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ 32750	▲ 39862	---
Particles >6µm	ASTM D7647	>1300	▲ 9500	▲ 8239	---
Particles >14µm	ASTM D7647	>320	▲ 349	140	---
Oil Cleanliness	ISO 4406 (c)	>19/17/15	▲ 22/20/16	▲ 22/20/14	---

Customer Id: KRANEWUSP
 Sample No.: USP249243
 Lab Number: 05850588
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

22 Mar 2023 Diag: Doug Bogart

ISO



This is a baseline read-out on the submitted sample. 5TH BATCH RECLAIMED OIL POST FILTRATION There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Dec 2022 Diag: Doug Bogart

NORMAL



This is a baseline read-out on the submitted sample. No ester detected.

view report



05 Dec 2022 Diag: Doug Bogart

WEAR



This is a baseline read-out on the submitted sample. The iron level is severe. The aluminum level is marginal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. Appearance is hazy. The AN level is acceptable for this fluid.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

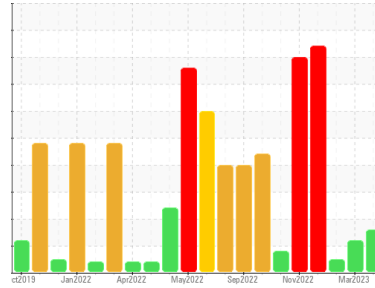

ISO



Machine Id
RECYCLED NH3
 Component
Refrigeration Compressor
 Fluid
USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. 5TH BATCH RECLAIMED.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP249243	USP244074	USP247587
Sample Date	Client Info		15 May 2023	22 Mar 2023	15 Dec 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m	0	0	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >10	2	<1	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	<1	0	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	0	0	---
Calcium	ppm	ASTM D5185m	0	0	---
Phosphorus	ppm	ASTM D5185m	0	<1	---
Zinc	ppm	ASTM D5185m	5	0	---
Sulfur	ppm	ASTM D5185m 50	0	0	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	1	2	---
Sodium	ppm	ASTM D5185m	<1	0	---
Potassium	ppm	ASTM D5185m >20	0	<1	---
Water	%	ASTM D6304 >0.01	0.004	0.004	---
ppm Water	ppm	ASTM D6304 >100	40.3	43.3	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 32750	▲ 39862	---
Particles >6µm	ASTM D7647	>1300	▲ 9500	▲ 8239	---
Particles >14µm	ASTM D7647	>320	▲ 349	140	---
Particles >21µm	ASTM D7647	>80	26	8	---
Particles >38µm	ASTM D7647	>20	0	0	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>19/17/15	▲ 22/20/16	▲ 22/20/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	0.014	0.015	---

OIL ANALYSIS REPORT

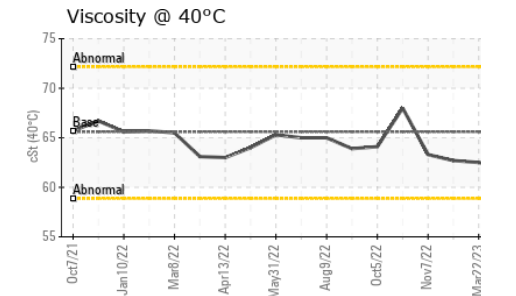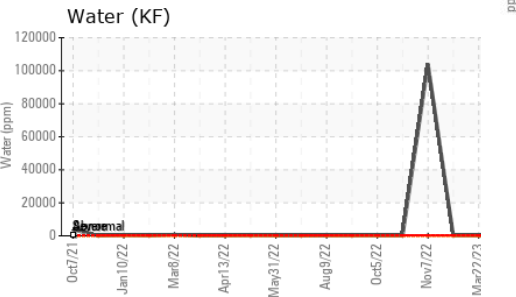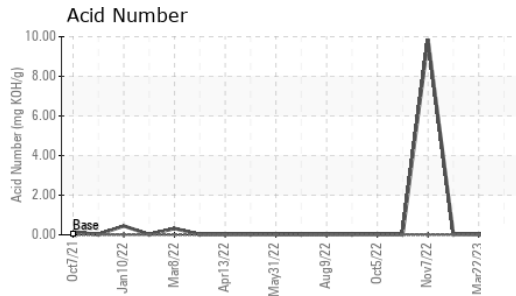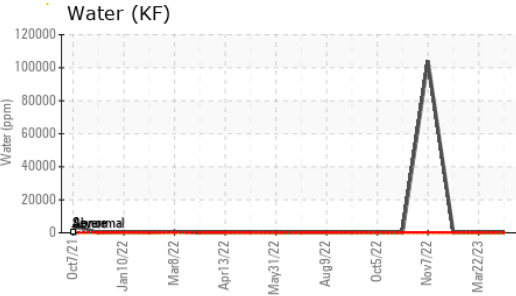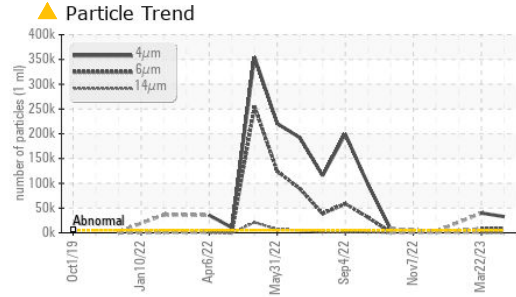






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	62.1	62.5

SAMPLE IMAGES



GRAPHS

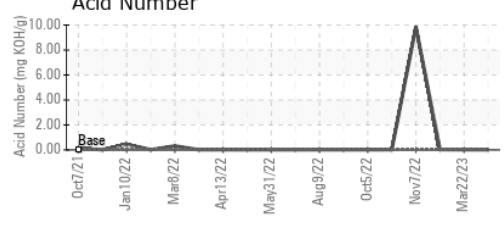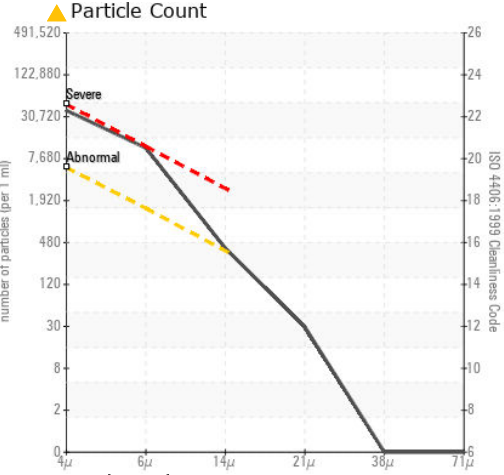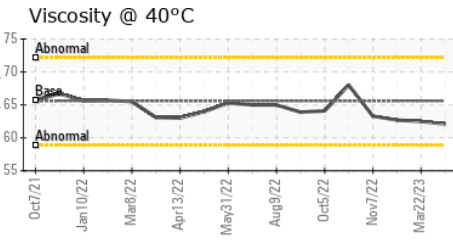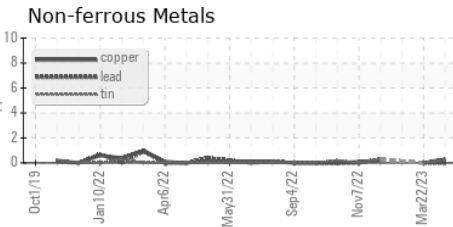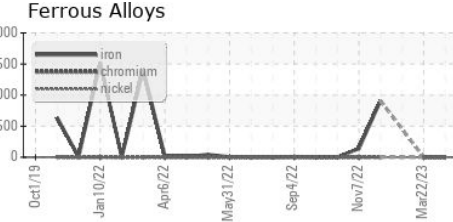

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP249243 **Received** : 18 May 2023
Lab Number : 05850588 **Diagnosed** : 19 May 2023
Unique Number : 10479943 **Diagnostician** : Doug Bogart
Test Package : IND 2

KraftHeinz - Newberry - Plant 8335
 3704 LOUIS RICH DR
 NEWBERRY, SC
 US 29108
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)