




PROBLEM SUMMARY

Sample Rating Trend

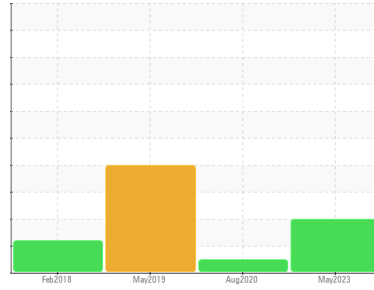

WATER




Machine Id
KAESER SX 5 4456603 (S/N 1088)

Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Water

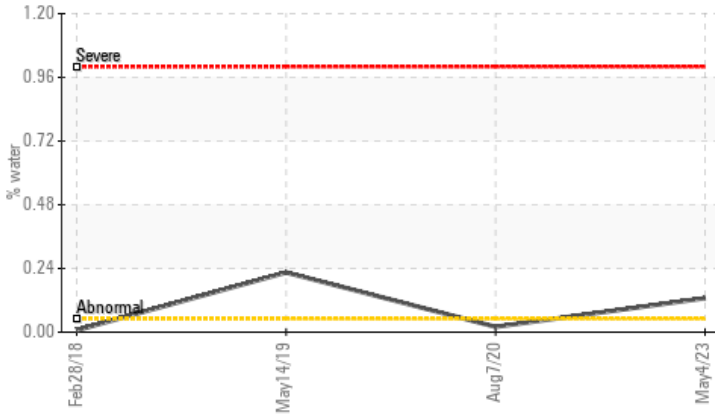

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.128	0.020	▲ 0.225
ppm Water	ppm	ASTM D6304	>500	▲ 1280	206.6	▲ 2250
Debris	scalar	*Visual	NONE	▲ MODER	NONE	LIGHT
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG	▲ 0.2%

Customer Id: OLDLAS
 Sample No.: KCP52319
 Lab Number: 05850652
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldrige +1
don.b505@comcast.net

To change component or sample information:

Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

07 Aug 2020 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



14 May 2019 Diag: Don Baldrige

WATER



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



28 Feb 2018 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER SX 5 4456603 (S/N 1088)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

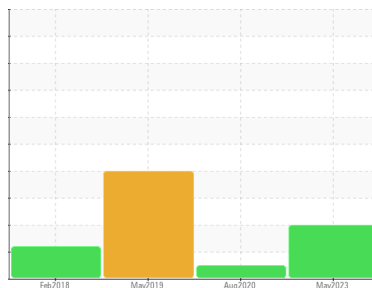

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP52319	KCP10575	KCP13602
Sample Date	Client Info			04 May 2023	07 Aug 2020	14 May 2019
Machine Age	hrs	Client Info		8253	3114	2690
Oil Age	hrs	Client Info		3000	0	640
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	2	1	2
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	13	<1
Barium	ppm	ASTM D5185m	90	0	0	3
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	0	10	43
Calcium	ppm	ASTM D5185m	0	0	<1	0
Phosphorus	ppm	ASTM D5185m	0	0	2	2
Zinc	ppm	ASTM D5185m	0	0	29	22
Sulfur	ppm	ASTM D5185m	23500	22734	16336	21156

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		6	13	12
Potassium	ppm	ASTM D5185m	>20	1	2	2
Water	%	ASTM D6304	>0.05	▲ 0.128	0.020	▲ 0.225
ppm Water	ppm	ASTM D6304	>500	▲ 1280	206.6	▲ 2250

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	4780	2974
Particles >6µm		ASTM D7647	>1300	---	973	▲ 1620
Particles >14µm		ASTM D7647	>80	---	26	▲ 276
Particles >21µm		ASTM D7647	>20	---	6	▲ 93
Particles >38µm		ASTM D7647	>4	---	2	▲ 14
Particles >71µm		ASTM D7647	>3	---	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	17/12	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39	0.291	0.388


OIL ANALYSIS REPORT

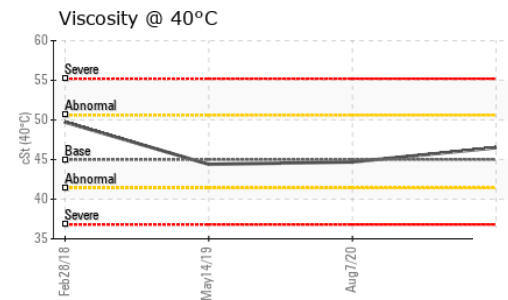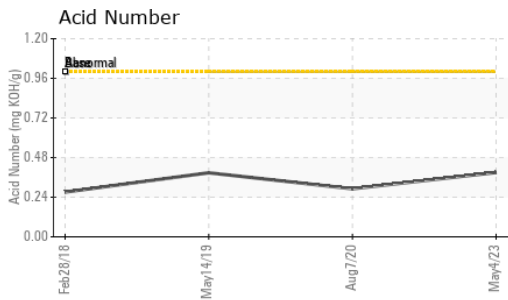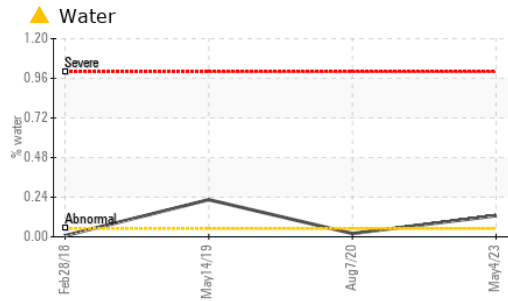





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	46.5	44.7	44.4

SAMPLE IMAGES

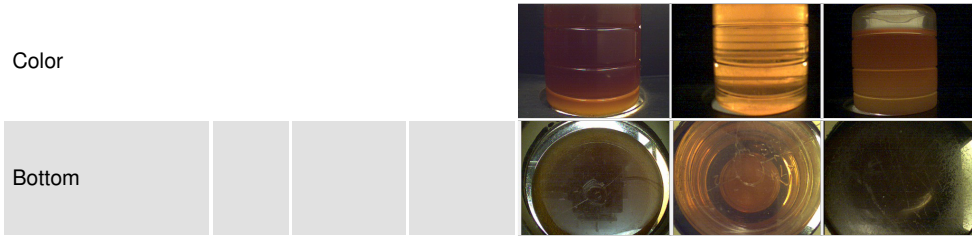

GRAPHS

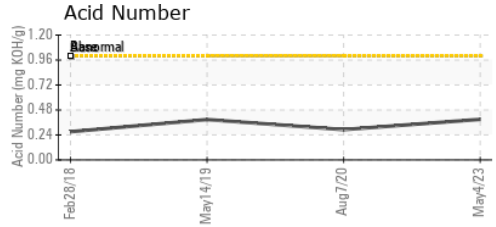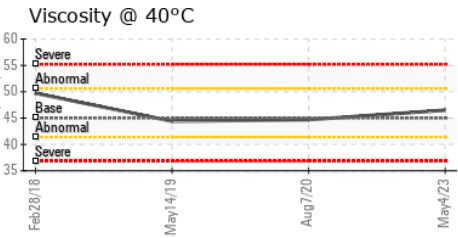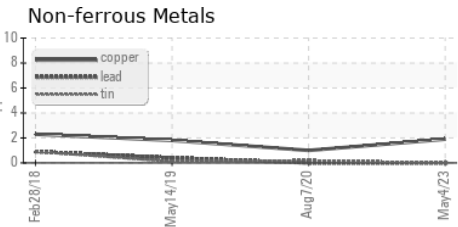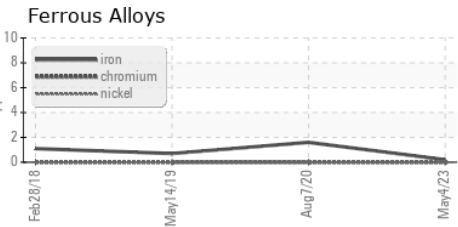

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP52319 **Received** : 18 May 2023
Lab Number : 05850652 **Diagnosed** : 22 May 2023
Unique Number : 10480007 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

OLD DOMINION
 4550 E CHEYENNE AVE
 LAS VEGAS, NV
 US 89115
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: