




PROBLEM SUMMARY

Sample Rating Trend

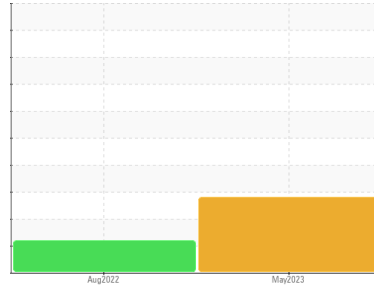

WEAR




Machine Id
BL-43

Component
Drive End Gearbox


Fluid
PETRO CANADA SYNDURO SHB ISO 220 (2 GAL)

COMPONENT CONDITION SUMMARY

▲ Ferrous Alloys

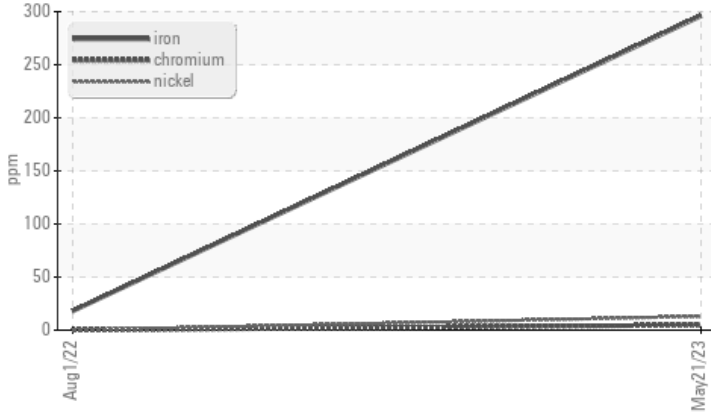

▲ Particle Trend

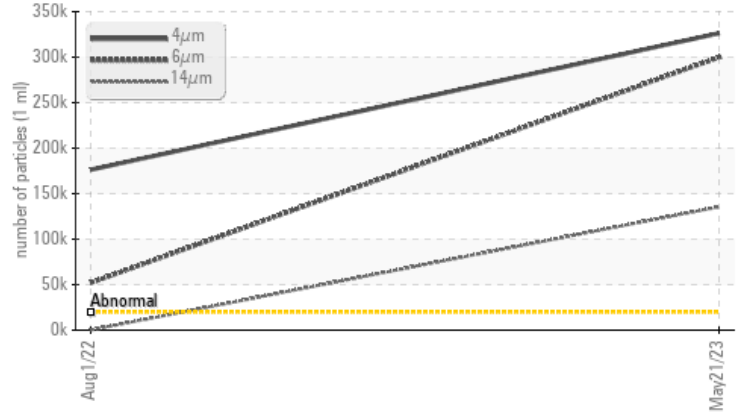

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ABNORMAL	ABNORMAL	---
Iron ppm	ASTM D5185m >200 ▲ 296	18	---
Particles >4µm	ASTM D7647 >20000 ▲ 326263	▲ 176274	---
Particles >6µm	ASTM D7647 >5000 ▲ 299821	▲ 51983	---
Particles >14µm	ASTM D7647 >640 ▲ 135517	25	---
Particles >21µm	ASTM D7647 >160 ▲ 35228	6	---
Oil Cleanliness	ISO 4406 (c) >21/19/16 ▲ 26/25/24	▲ 25/23/12	---

Customer Id: MONHAL
Sample No.: SBP0001779
Lab Number: 05853149
Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

01 Aug 2022 Diag: Don Baldrige

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

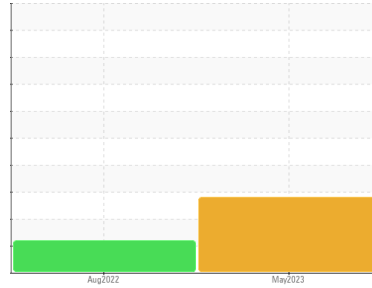

WEAR



Machine Id
BL-43

Component
Drive End Gearbox

Fluid
PETRO CANADA SYNDURO SHB ISO 220 (2 GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

▲ Wear

Gear wear is indicated.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		SBP0001779	SBP0000922	---
Sample Date	Client Info		21 May 2023	01 Aug 2022	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		215	22	---
Iron	ppm	ASTM D5185m >200	▲ 296	18	---
Chromium	ppm	ASTM D5185m >15	5	0	---
Nickel	ppm	ASTM D5185m >15	13	0	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >25	7	<1	---
Lead	ppm	ASTM D5185m >100	0	<1	---
Copper	ppm	ASTM D5185m >200	6	<1	---
Tin	ppm	ASTM D5185m >25	0	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 5.0	0	0	---
Molybdenum	ppm	ASTM D5185m	<1	0	---
Manganese	ppm	ASTM D5185m	2	<1	---
Magnesium	ppm	ASTM D5185m 5.0	1	0	---
Calcium	ppm	ASTM D5185m 5.0	0	0	---
Phosphorus	ppm	ASTM D5185m 100	340	289	---
Zinc	ppm	ASTM D5185m 5.0	55	66	---
Sulfur	ppm	ASTM D5185m 1900	796	656	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	35	5	---
Sodium	ppm	ASTM D5185m	0	0	---
Potassium	ppm	ASTM D5185m >20	2	<1	---
Water	%	ASTM D6304 >0.2	0.014	---	---
ppm Water	ppm	ASTM D6304 >2000	140.7	---	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 326263	▲ 176274	---
Particles >6µm	ASTM D7647	>5000	▲ 299821	▲ 51983	---
Particles >14µm	ASTM D7647	>640	▲ 135517	25	---
Particles >21µm	ASTM D7647	>160	▲ 35228	6	---
Particles >38µm	ASTM D7647	>40	2	2	---
Particles >71µm	ASTM D7647	>10	0	1	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 26/25/24	▲ 25/23/12	---


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.3	0.66	0.70	---



OIL ANALYSIS REPORT


▲ Particle Trend

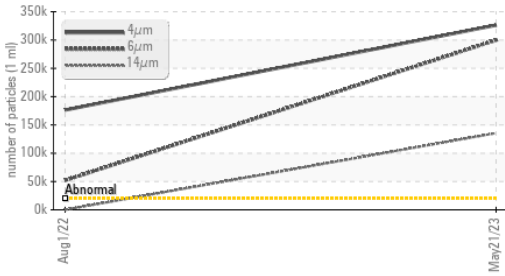


Water




PQ

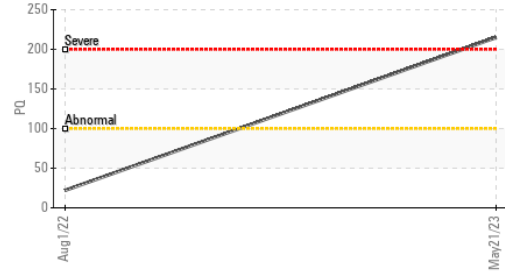

Acid Number

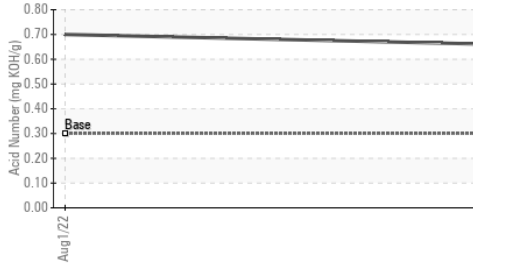


Water

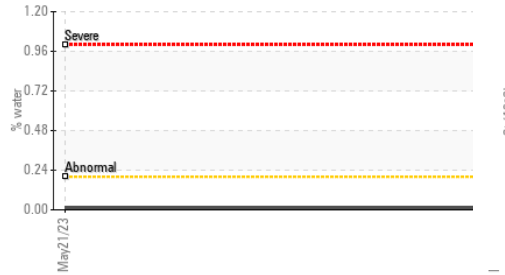

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	219	220	216

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

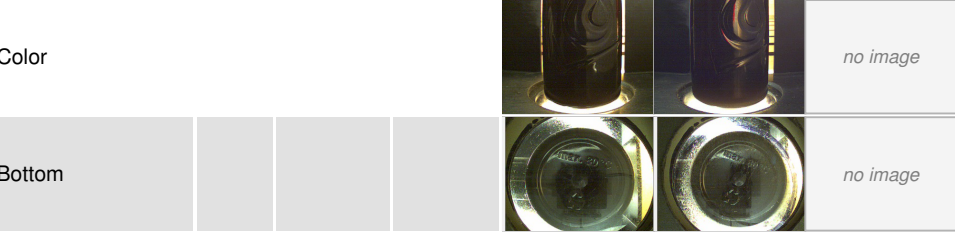


GRAPHS


▲ Ferrous Alloys

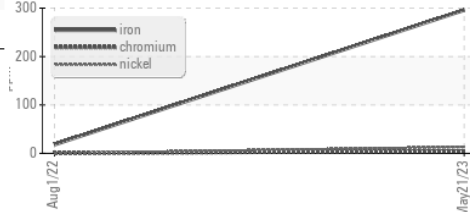


Non-ferrous Metals

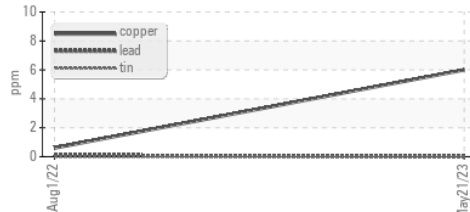


Viscosity @ 40°C

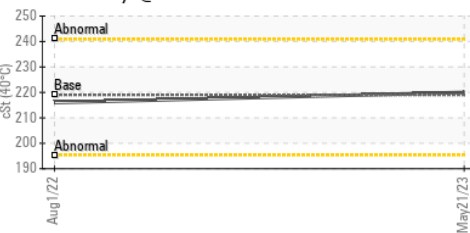

▲ Particle Count

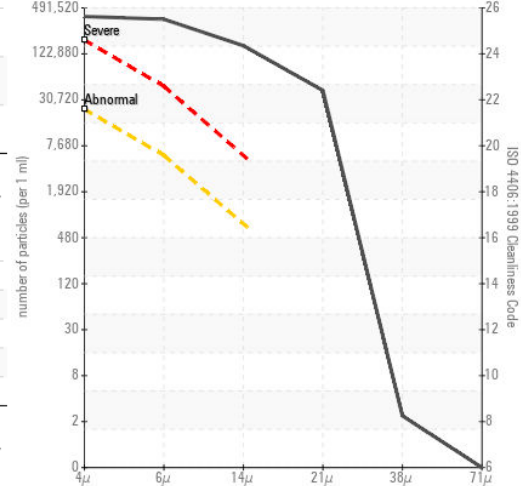

Acid Number

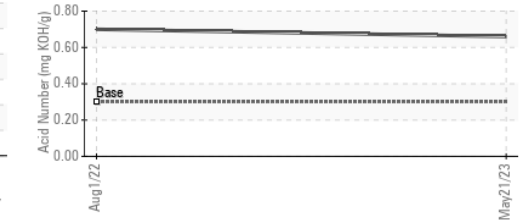

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : SBP0001779 **Received** : 22 May 2023
Lab Number : 05853149 **Diagnosed** : 24 May 2023
Unique Number : 10482504 **Diagnostician** : Don Baldrige
Test Package : PLANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MONOLITH
 27077 SW 42ND ST
 HALLAM, NE
 US 68368
 Contact: ALANA WALLACE
 alana.wallace@monolith-corp.com

T:
F: