

PROBLEM SUMMARY

Sample Rating Trend


ISO

Machine Id KAESER 8487212 (S/N 1964)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

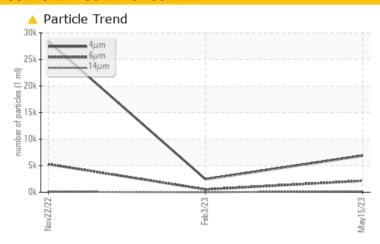

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	NORMAL	ABNORMAL			
Particles >6µm	ASTM D7647	>1300	<u>^</u> 2170	532	<u>▲</u> 5283			
Particles >14µm	ASTM D7647	>80	199	9	<u> </u>			
Particles >21µm	ASTM D7647	>20	4 39	2	16			
Oil Cleanliness	ISO 4406 (c)	>/17/13	20/18/15	18/16/10	22/20/14			

Customer Id: CHACHAMIKC Sample No.: KC106531 Lab Number: 05853242 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 ihester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

03 Feb 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



22 Nov 2022 Diag: Don Baldridge

150



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

KAESER 8487212 (S/N 1964)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)





DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		No	v2022	Feb 2023 May 20	23	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC106531	KC96789	KC106548
Sample Date		Client Info		15 May 2023	03 Feb 2023	22 Nov 2022
Machine Age	hrs	Client Info		4117	3244	2519
Oil Age	hrs	Client Info		2000	725	2519
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	5	4	10
Tin	ppm	ASTM D5185m	>10	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	68	75	34
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	77	79	44
Calcium	ppm	ASTM D5185m	2	15	<1	2
Phosphorus	ppm	ASTM D5185m		14	4	20
Zinc	ppm	ASTM D5185m		75	0	11
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	2
Sodium	ppm	ASTM D5185m		11	12	20
Potassium	ppm	ASTM D5185m	>20	6	6	13
Water	%	ASTM D6304	>0.05	0.020	0.019	0.008
ppm Water	ppm	ASTM D6304	>500	206.4	199.2	89.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		6888	2445	28397
Particles >6µm		ASTM D7647	>1300	<u> </u>	532	<u>▲</u> 5283
Particles >14μm		ASTM D7647	>80	<u> </u>	9	1 01
Particles >21µm		ASTM D7647	>20	△ 39	2	16
Particles >38µm		ASTM D7647	>4	1	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/15	18/16/10	△ 22/20/14
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.44	0.38	0.32



OIL ANALYSIS REPORT

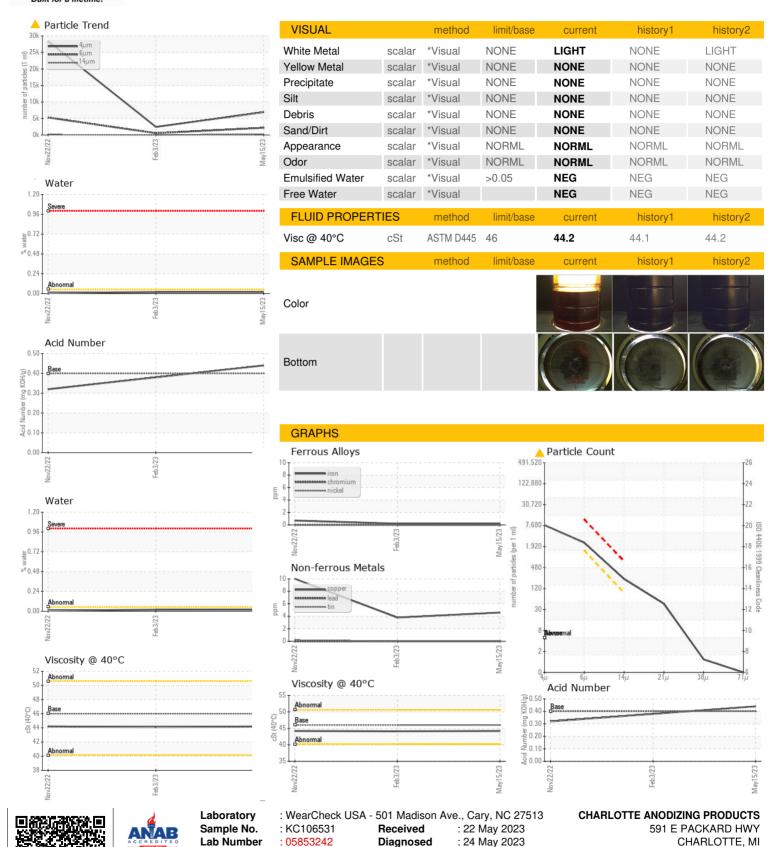

Certificate L2367

Unique Number

Test Package

: 10482597

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

: Jonathan Hester

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 48813

T: F:

Contact: PRODUCTION

production@charlotte-anodizing.com