




OIL ANALYSIS REPORT

Sample Rating Trend

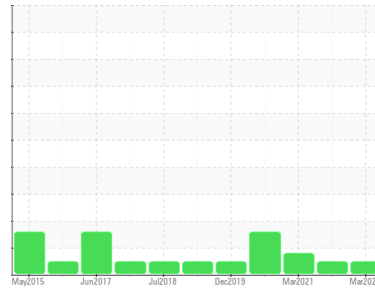

NORMAL



Area
13

Machine Id

ECHESA WTG-1302 (S/N 4836490-0020-6)

Component

Wind Turbine Gearbox

Fluid

SHELL OMALA 320 (340 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Analytical Ferrography: Results indicate normal operation, with typical amounts of ferrous rubbing wear and contamination. There is a single ferrous sliding wear particle that does not appear to be related to any active wear issue.

Wear

All component wear rates are normal.

Contaminants

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Oil Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0804443	WC05504504	WC0547200
Sample Date	Client Info		04 Mar 2023	07 Feb 2022	04 Mar 2021
Machine Age	mths	Client Info	101	0	120
Oil Age	mths	Client Info	101	0	65
Oil Changed	Client Info		Not Chngd	N/A	Not Chngd
Sample Status			NORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184	>50	24	21	25
Iron	ppm	ASTM D5185m	>65	51	43
Chromium	ppm	ASTM D5185m	>3	<1	<1
Nickel	ppm	ASTM D5185m	>3	<1	0
Titanium	ppm	ASTM D5185m	>10	0	0
Silver	ppm	ASTM D5185m		0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	0
Lead	ppm	ASTM D5185m	>5	<1	1
Copper	ppm	ASTM D5185m	>10	0	<1
Tin	ppm	ASTM D5185m	>10	<1	0
Antimony	ppm	ASTM D5185m	>5	---	---
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5.5	4	0
Barium	ppm	ASTM D5185m	0.4	0	0
Molybdenum	ppm	ASTM D5185m	0.5	0	0
Manganese	ppm	ASTM D5185m		<1	<1
Magnesium	ppm	ASTM D5185m	23	<1	0
Calcium	ppm	ASTM D5185m	13	7	9
Phosphorus	ppm	ASTM D5185m	450	380	400
Zinc	ppm	ASTM D5185m	9.9	35	41
Sulfur	ppm	ASTM D5185m	8181	6149	4594

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	1
Sodium	ppm	ASTM D5185m		6	3
Potassium	ppm	ASTM D5185m	>20	2	0
Water	%	ASTM D6304	>0.03	0.018	0.022
ppm Water	ppm	ASTM D6304	>300	185.6	223.1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		910	1967	---
Particles >6µm	ASTM D7647	>5000	109	358	---
Particles >14µm	ASTM D7647	>640	10	31	---
Particles >21µm	ASTM D7647	>160	1	6	---
Particles >38µm	ASTM D7647	>40	0	1	---
Particles >71µm	ASTM D7647	>10	0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/19/16	17/14/10	18/16/12	---



OIL ANALYSIS REPORT

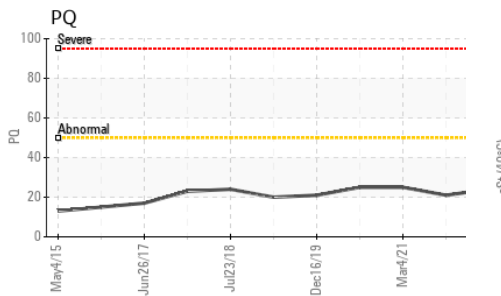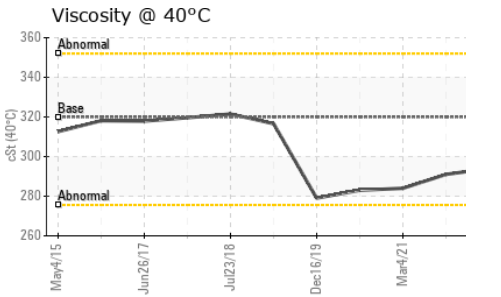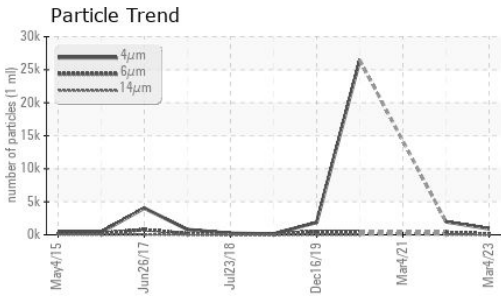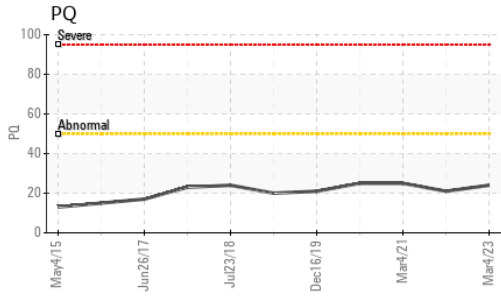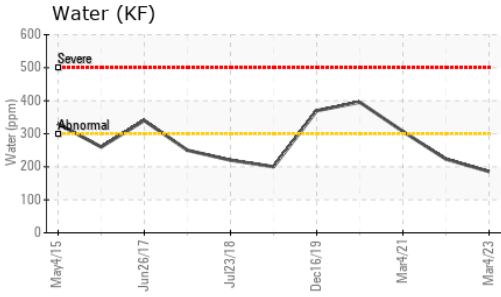


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		1.23	1.27	1.075






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	294	291	284

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

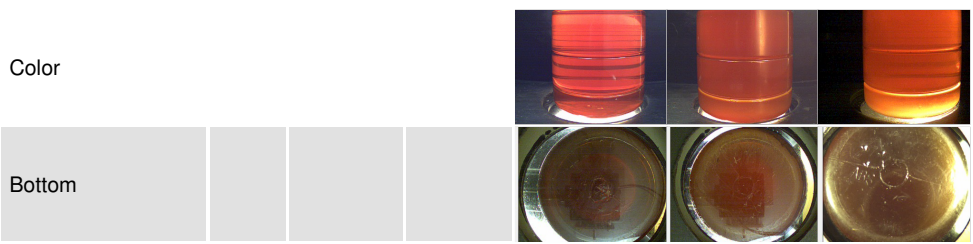

GRAPHS

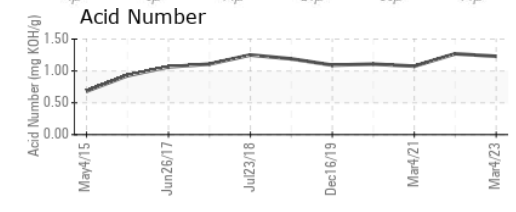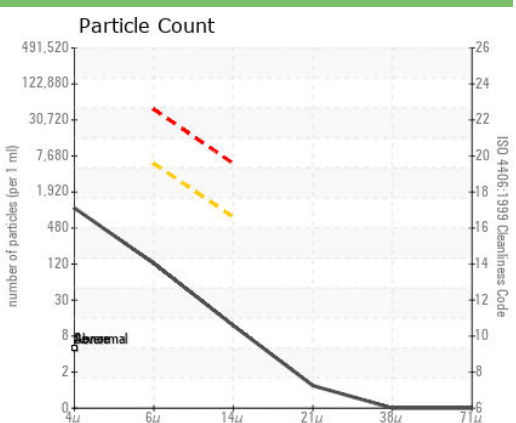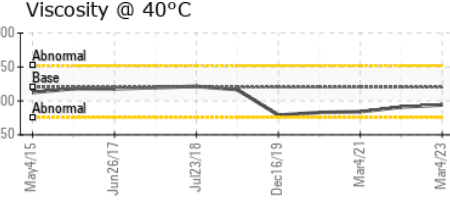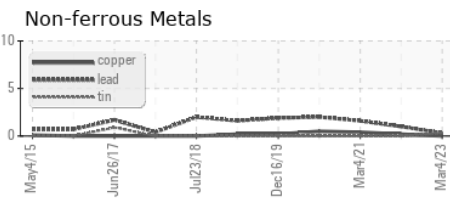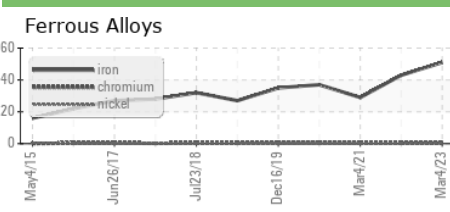

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0804443 **Received** : 26 May 2023
Lab Number : 05857859 **Diagnosed** : 08 Jun 2023
Unique Number : 10492324 **Diagnostician** : Aaron Black
Test Package : IND 3 (Additional Tests: KF, PrtCount)





ENERGIA EOLICA
 STA ANA KM25 CARRETERA AL SUR, A 1KM DEL CRUCE
 FRANCISCO MORAZAN, ZZ
 HN
 Contact: SANTOS DEL CID
 sdelcid@dennci.com
 T: x:
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)



FERROGRAPHY REPORT

Area
13
 Machine Id
ECHESA WTG-1302 (S/N 4836490-0020-6)
 Component
Wind Turbine Gearbox
 Fluid
SHELL OMALA 320 (340 LTR)

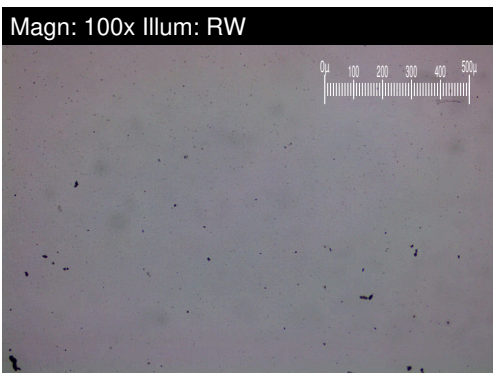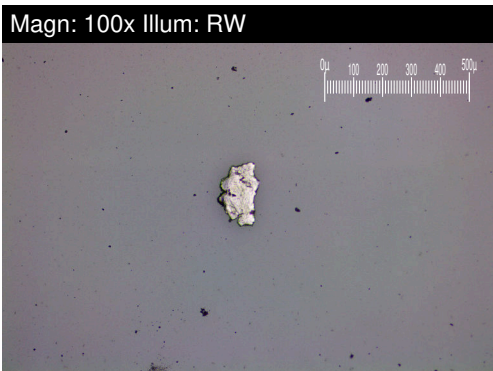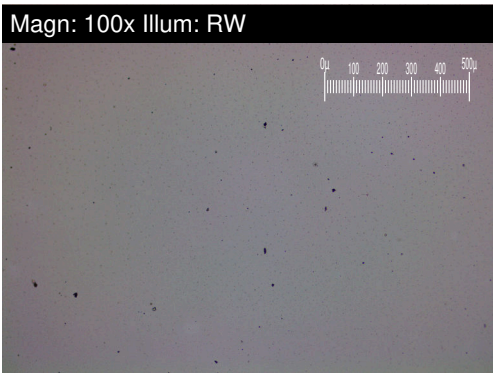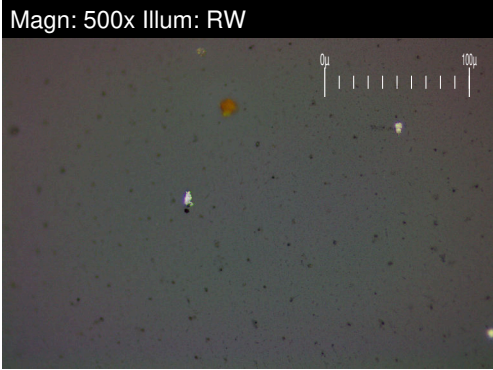

FERROGRAPHY	method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	*ASTM D7684	1		
Ferrous Sliding	Scale 0-10	*ASTM D7684	1		
Ferrous Cutting	Scale 0-10	*ASTM D7684			
Ferrous Rolling	Scale 0-10	*ASTM D7684			
Ferrous Break-in	Scale 0-10	*ASTM D7684			
Ferrous Spheres	Scale 0-10	*ASTM D7684			
Ferrous Black Oxides	Scale 0-10	*ASTM D7684			
Ferrous Red Oxides	Scale 0-10	*ASTM D7684			
Ferrous Corrosive	Scale 0-10	*ASTM D7684			
Ferrous Other	Scale 0-10	*ASTM D7684			
Nonferrous Rubbing	Scale 0-10	*ASTM D7684			
Nonferrous Sliding	Scale 0-10	*ASTM D7684			
Nonferrous Cutting	Scale 0-10	*ASTM D7684			
Nonferrous Rolling	Scale 0-10	*ASTM D7684			
Nonferrous Other	Scale 0-10	*ASTM D7684			
Carbonaceous Material	Scale 0-10	*ASTM D7684			
Lubricant Degradation	Scale 0-10	*ASTM D7684			
Sand/Dirt	Scale 0-10	ASTM D7684			
Fibres	Scale 0-10	*ASTM D7684			
Spheres	Scale 0-10	*ASTM D7684			
Other	Scale 0-10	*ASTM D7684	1		

WEAR

All component wear rates are normal.

This page left intentionally blank