




OIL ANALYSIS REPORT

Sample Rating Trend

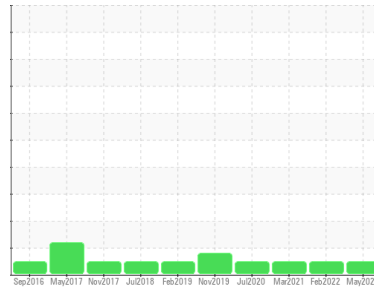

NORMAL



Area
9
 Machine Id
WTG-906
 Component
Hydraulic System
 Fluid
SHELL TELLUS 32 (300 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0804512	WC05504468	WC0547237
Sample Date	Client Info		25 May 2023	02 Feb 2022	10 Mar 2021
Machine Age	mths	Client Info	0	69	120
Oil Age	mths	Client Info	0	5	0
Oil Changed	Client Info		Not Changed	Not Changd	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		12	20	---
Iron	ppm	ASTM D5185m >20	11	10	11
Chromium	ppm	ASTM D5185m >20	9	8	10
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	<1	0
Aluminum	ppm	ASTM D5185m >20	<1	0	0
Lead	ppm	ASTM D5185m >20	0	0	<1
Copper	ppm	ASTM D5185m >20	2	3	3
Tin	ppm	ASTM D5185m >20	<1	0	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	<1	<1
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 11	19	9	7
Calcium	ppm	ASTM D5185m 35	25	27	26
Phosphorus	ppm	ASTM D5185m 259	280	281	265
Zinc	ppm	ASTM D5185m 277	293	262	255
Sulfur	ppm	ASTM D5185m 1865	3531	3368	4141

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	<1	<1
Sodium	ppm	ASTM D5185m	1	0	0
Potassium	ppm	ASTM D5185m >20	<1	0	<1
Water	%	ASTM D6304 >0.05	0.004	0.010	0.014
ppm Water	ppm	ASTM D6304 >500	44.3	108.8	147.5

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	198	4536	4276
Particles >6µm	ASTM D7647	>1300	35	1078	1031
Particles >14µm	ASTM D7647	>160	4	123	92
Particles >21µm	ASTM D7647	>40	1	36	24
Particles >38µm	ASTM D7647	>10	0	4	4
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	15/12/9	19/17/14	19/17/14



OIL ANALYSIS REPORT

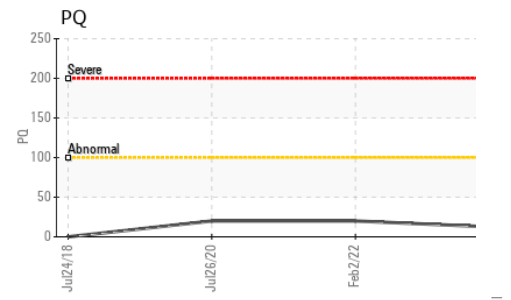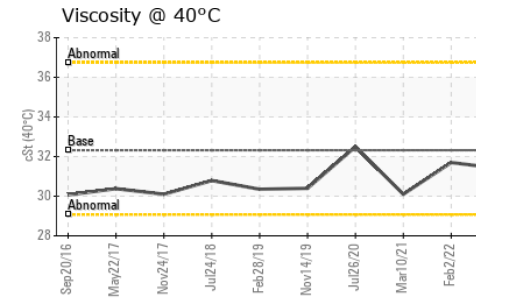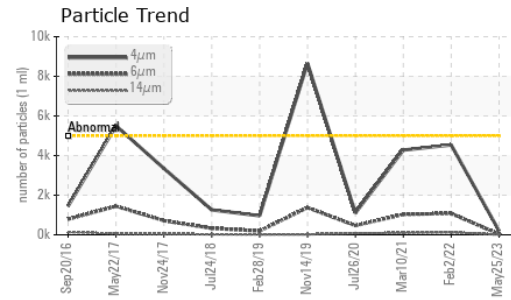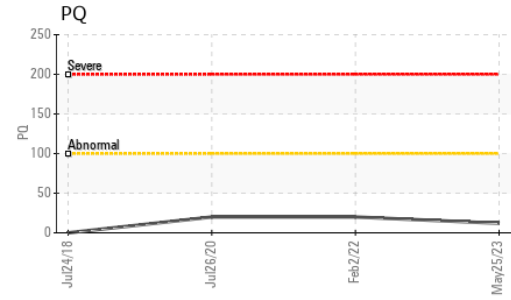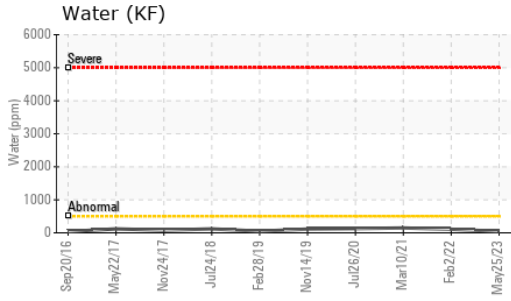

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.32	0.25	0.28	0.227


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.32	31.4	31.7	30.1






SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color

Bottom

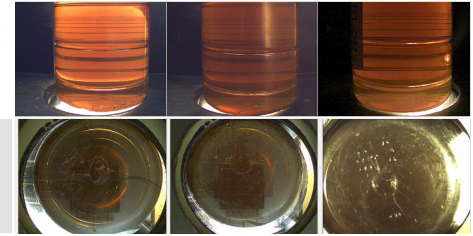

GRAPHS

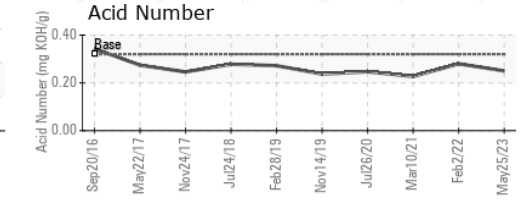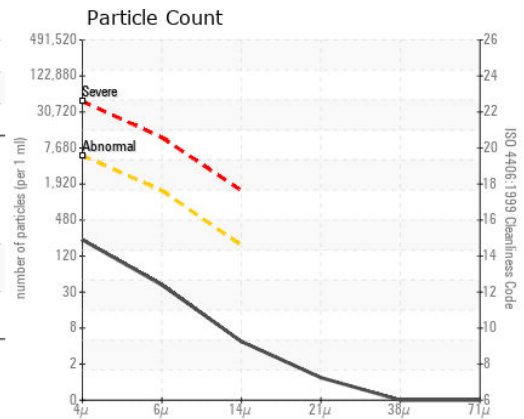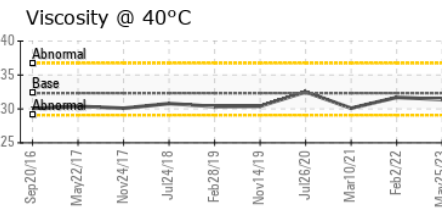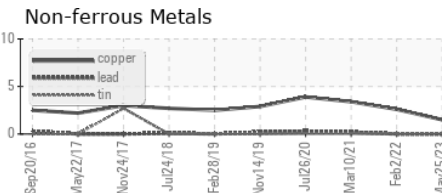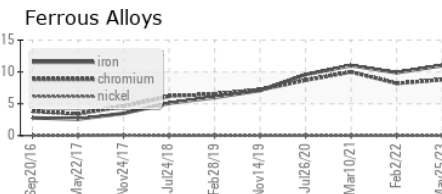

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0804512 Received : 26 May 2023
 Lab Number : 05857904 Diagnosed : 30 May 2023
 Unique Number : 10492369 Diagnostician : Jonathan Hester
 Test Package : IND 2 (Additional Tests: KF, PQ)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ENERGIA EOLICA
 STA ANA KM25 CARRETERA AL SUR, A 1KM DEL CRUCE
 FRANCISCO MORAZAN, ZZ
 HN
 Contact: SANTOS DEL CID
 sdelcid@dennci.com

T: x:
 F: x: