



# PROBLEM SUMMARY

Area

**2**

Machine Id

**WINERGY GEARBOX WTG-102 (S/N 4836489-0020-6)**


Component

**Wind Turbine Gearbox**

Fluid

**FUCHS RENOLIN UNISYN CKC ISO 320 (340 LTR)**

Sample Rating Trend

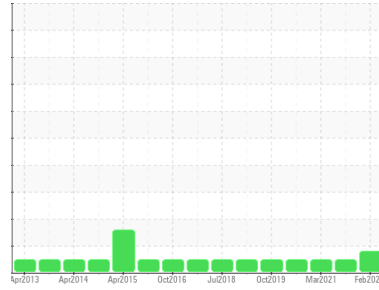

**SEDIMENT**



## COMPONENT CONDITION SUMMARY

No relevant graphs to display

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	NORMAL	NORMAL
Silt	scalar	*Visual	NONE	▲ <b>HEAVY</b>	NONE	NONE

**Customer Id:** ENEFRA  
**Sample No.:** WC0804455  
**Lab Number:** 05857922  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

## HISTORICAL DIAGNOSIS

### 26 Jan 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 01 Mar 2021 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 23 Jul 2020 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The condition of the oil is suitable for further service.

view report





# OIL ANALYSIS REPORT

## Sample Rating Trend

**SEDIMENT**



Area


**2**  
Machine Id  
**WINERGY GEARBOX WTG-102 (S/N 4836489-0020-6)**

Component

**Wind Turbine Gearbox**

Fluid

**FUCHS RENOLIN UNISYN CKC ISO 320 (340 LTR)**

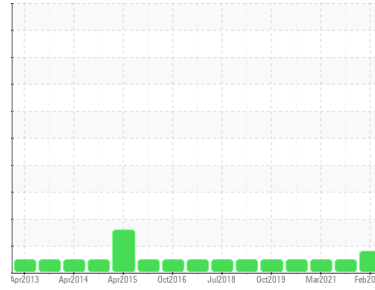

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of visible silt present in the sample.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0804455</b>	WC05504522	WC0547136
Sample Date	Client Info		<b>27 Feb 2023</b>	26 Jan 2022	01 Mar 2021
Machine Age	mths	Client Info	<b>90</b>	74	120
Oil Age	mths	Client Info	<b>90</b>	0	65
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	Not Chngd
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>50	<b>8</b>	16	21	
Iron	ppm	ASTM D5185m	>65	<b>36</b>	37	39
Chromium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	25	<b>3</b>	0	5
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	17	<b>14</b>	16	19
Phosphorus	ppm	ASTM D5185m	200	<b>222</b>	221	211
Zinc	ppm	ASTM D5185m		<b>31</b>	31	16
Sulfur	ppm	ASTM D5185m	5000	<b>5485</b>	4307	4055

### CONTAMINANTS





	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>4</b>	2	6
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	1
Water	%	ASTM D6304	>0.03	<b>0.008</b>	0.013	0.020
ppm Water	ppm	ASTM D6304	>300	<b>85.7</b>	134.5	203.1

### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>---</b>	2147	180
Particles >6µm	ASTM D7647	>5000	<b>---</b>	262	57
Particles >14µm	ASTM D7647	>640	<b>---</b>	31	10
Particles >21µm	ASTM D7647	>160	<b>---</b>	7	5
Particles >38µm	ASTM D7647	>40	<b>---</b>	2	0
Particles >71µm	ASTM D7647	>10	<b>---</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>---</b>	18/15/12	15/13/10



# OIL ANALYSIS REPORT

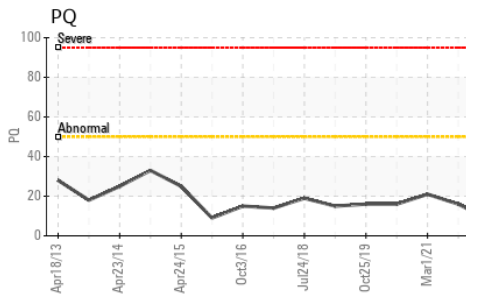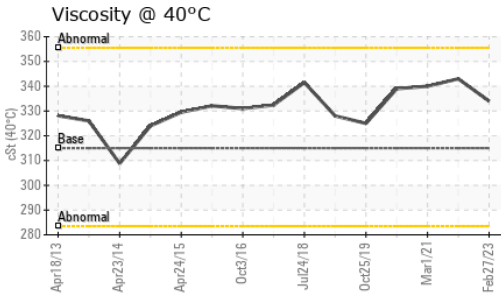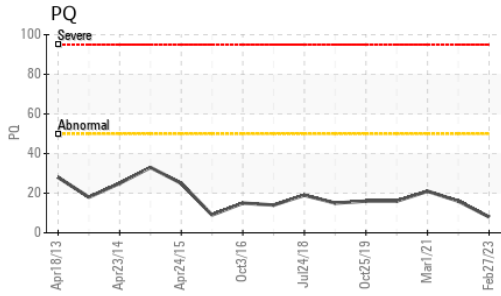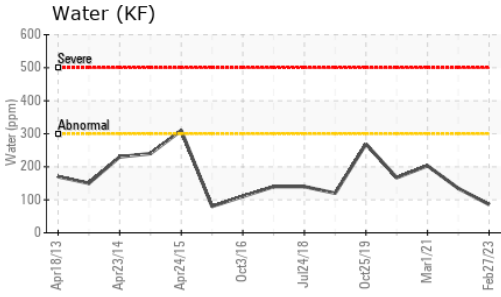


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.9	<b>0.86</b>	1.02	1.090





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>▲ HEAVY</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	315	<b>334</b>	343	340

### SAMPLE IMAGES

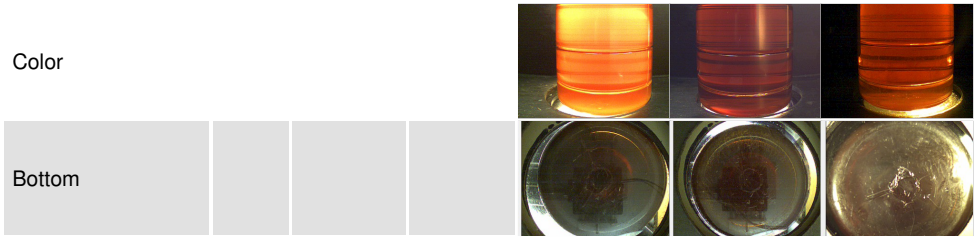

### GRAPHS

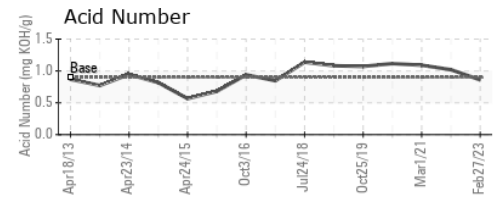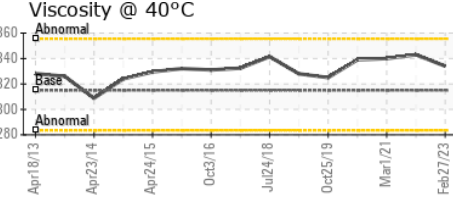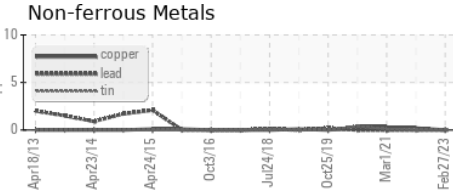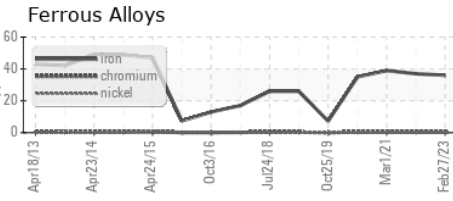

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0804455 **Received** : 26 May 2023  
**Lab Number** : 05857922 **Diagnosed** : 30 May 2023  
**Unique Number** : 10492387 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**ENERGIA EOLICA**  
 STA ANA KM25 CARRETERA AL SUR, A 1KM DEL CRUCE  
 FRANCISCO MORAZAN, ZZ  
 HN  
 Contact: SANTOS DEL CID  
 sdelcid@dennci.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:  
 F: x: