




# PROBLEM SUMMARY

Sample Rating Trend

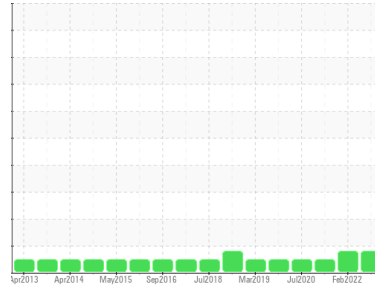

Area

7

Machine Id

**WINERGY GEARBOX WTG-702 (S/N 4834564-0020-3)**

Component


**Wind Turbine Gearbox**

Fluid

**FUCHS RENOLIN UNISYN CKC ISO 320 (340 LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Ferrous Alloys

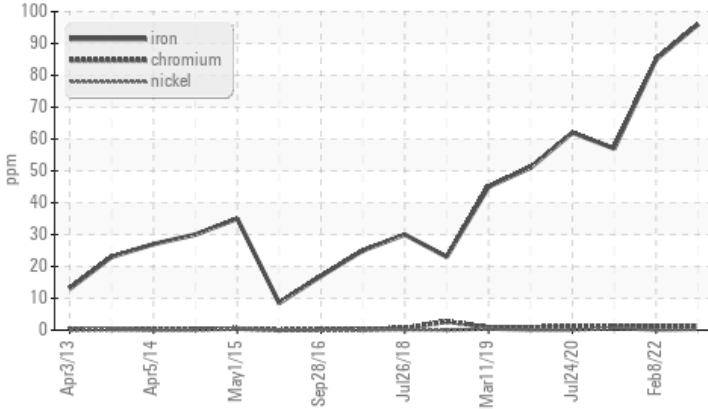

## RECOMMENDATION

No corrective action is recommended at this time.  
Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	ABNORMAL	NORMAL
Iron	ppm	ASTM D5185m	>65	<b>▲ 96</b>	▲ 85	57

Customer Id: ENEFRA  
 Sample No.: WC0804469  
 Lab Number: 05857932  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 08 Feb 2022 Diag: Don Baldrige

#### WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The iron level is abnormal. All other component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 05 Mar 2021 Diag: Don Baldrige

#### NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 24 Jul 2020 Diag: Doug Bogart

#### NORMAL



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time. All ferrographic tests and evaluation performed at WC Canada laboratory. An increase in the iron level is noted. All other component wear rates are normal. The direct-reading & analytical ferrographic results are normal indicating no abnormal wear in the system. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





# OIL ANALYSIS REPORT

Sample Rating Trend

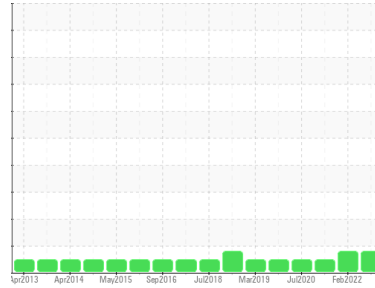

**WEAR**



Area

**7**

Machine Id

**WINERGY GEARBOX WTG-702 (S/N 4834564-0020-3)**

Component

**Wind Turbine Gearbox**

Fluid

**FUCHS RENOLIN UNISYN CKC ISO 320 (340 LTR)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### ▲ Wear

The iron level is abnormal. All other component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0804469</b>	WC05504498	WC0547243
Sample Date	Client Info		<b>04 Mar 2023</b>	08 Feb 2022	05 Mar 2021
Machine Age	mths	Client Info	<b>94</b>	78	120
Oil Age	mths	Client Info	<b>94</b>	0	65
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	Not Chngd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>50	<b>15</b>	20	19	
Iron	ppm	ASTM D5185m	>65	<b>▲ 96</b>	▲ 85	57
Chromium	ppm	ASTM D5185m	>3	<b>1</b>	1	1
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>5	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	25	<b>&lt;1</b>	0	3
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	17	<b>5</b>	11	10
Phosphorus	ppm	ASTM D5185m	200	<b>161</b>	175	128
Zinc	ppm	ASTM D5185m		<b>32</b>	45	33
Sulfur	ppm	ASTM D5185m	5000	<b>5245</b>	4207	3099

## CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>4</b>	2	3
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	4
Water	%	ASTM D6304	>0.03	<b>0.013</b>	0.017	0.018
ppm Water	ppm	ASTM D6304	>300	<b>133.6</b>	173.2	186.7

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>102</b>	2627	248
Particles >6µm	ASTM D7647	>5000	<b>22</b>	265	45
Particles >14µm	ASTM D7647	>640	<b>4</b>	22	9
Particles >21µm	ASTM D7647	>160	<b>1</b>	5	4
Particles >38µm	ASTM D7647	>40	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>14/12/9</b>	19/15/12	15/13/10



# OIL ANALYSIS REPORT

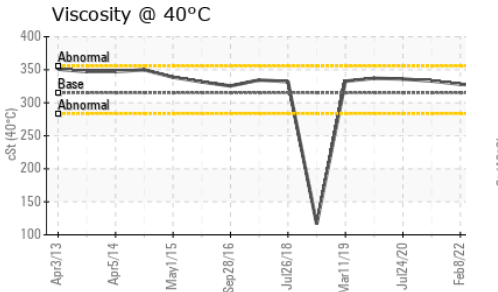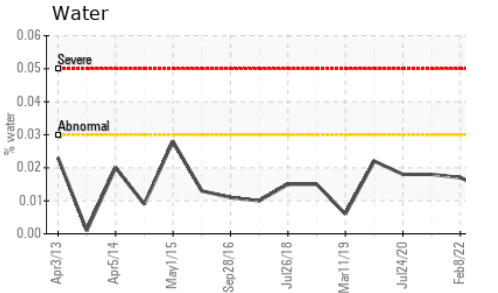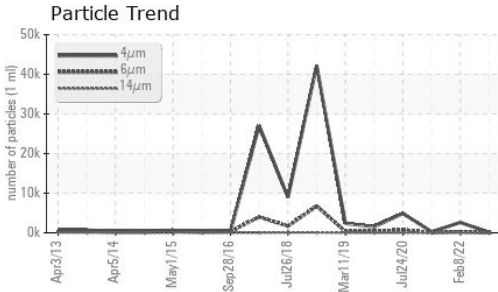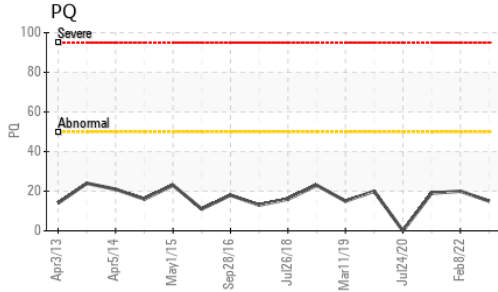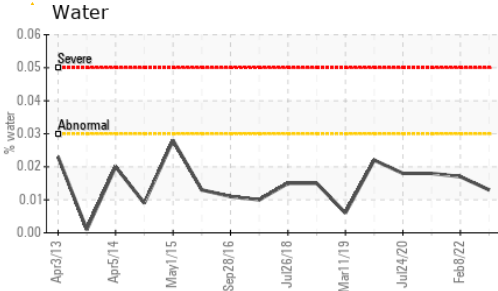


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.9	<b>0.80</b>	0.90	0.917






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	315	<b>325</b>	328	333

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

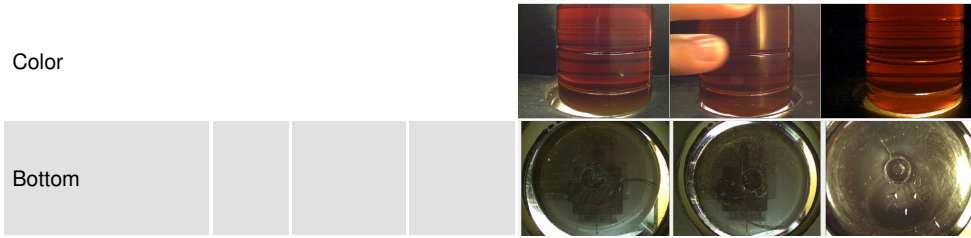

## GRAPHS

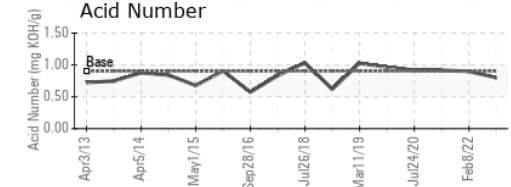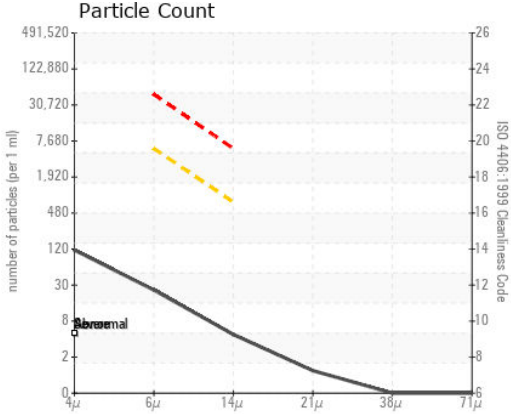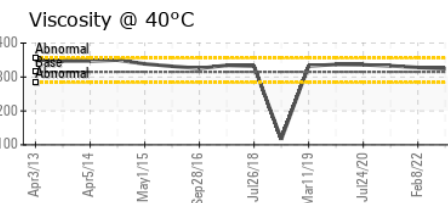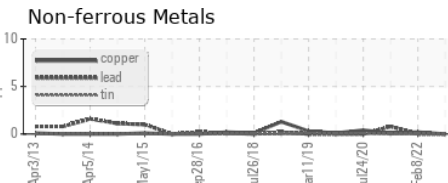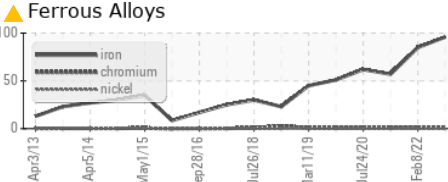

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0804469 **Received** : 26 May 2023  
**Lab Number** : 05857932 **Diagnosed** : 30 May 2023  
**Unique Number** : 10492397 **Diagnostician** : Don Baldrige

**ENERGIA EOLICA**  
 STA ANA KM25 CARRETERA AL SUR, A 1KM DEL CRUCE  
 FRANCISCO MORAZAN, ZZ  
 HN  
 Contact: SANTOS DEL CID  
 sdelcid@dennci.com

**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T : x  
 F : x