




# OIL ANALYSIS REPORT

Sample Rating Trend

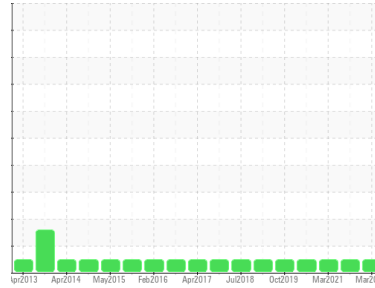

**NORMAL**



Area  
**10**  
Machine Id  
**WINERGY GEARBOX WTG-1001 (S/N 4836491-0020-4)**  
Component  
**Wind Turbine Gearbox**  
Fluid  
**FUCHS RENOLIN UNISYN CKC ISO 320 (340 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>WC0804480</b>   | WC05504497  | WC0547219   |
| Sample Date   | Client Info |             | <b>06 Mar 2023</b> | 27 Jan 2022 | 12 Mar 2021 |
| Machine Age   | mths        | Client Info | <b>103</b>         | 88          | 120         |
| Oil Age       | mths        | Client Info | <b>103</b>         | 0           | 65          |
| Oil Changed   | Client Info |             | <b>Not Chngd</b>   | N/A         | Not Chngd   |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | NORMAL      |

## WEAR METALS

|          | method     | limit/base  | current   | history1     | history2 |    |
|----------|------------|-------------|-----------|--------------|----------|----|
| PQ       | ASTM D8184 | >50         | <b>14</b> | 16           | 16       |    |
| Iron     | ppm        | ASTM D5185m | >65       | <b>25</b>    | 26       | 24 |
| Chromium | ppm        | ASTM D5185m | >3        | <b>&lt;1</b> | 0        | <1 |
| Nickel   | ppm        | ASTM D5185m | >3        | <b>0</b>     | 0        | <1 |
| Titanium | ppm        | ASTM D5185m | >10       | <b>0</b>     | 0        | 0  |
| Silver   | ppm        | ASTM D5185m |           | <b>0</b>     | <1       | 0  |
| Aluminum | ppm        | ASTM D5185m | >10       | <b>1</b>     | 0        | 0  |
| Lead     | ppm        | ASTM D5185m | >5        | <b>0</b>     | <1       | 0  |
| Copper   | ppm        | ASTM D5185m | >10       | <b>0</b>     | <1       | <1 |
| Tin      | ppm        | ASTM D5185m | >10       | <b>0</b>     | 0        | 0  |
| Antimony | ppm        | ASTM D5185m | >5        | <b>---</b>   | ---      | 0  |
| Vanadium | ppm        | ASTM D5185m |           | <b>0</b>     | 0        | 0  |
| Cadmium  | ppm        | ASTM D5185m |           | <b>0</b>     | 0        | <1 |

## ADDITIVES






|            | method | limit/base  | current | history1     | history2 |      |
|------------|--------|-------------|---------|--------------|----------|------|
| Boron      | ppm    | ASTM D5185m | 25      | <b>1</b>     | 0        | 3    |
| Barium     | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | 0    |
| Molybdenum | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | 0    |
| Manganese  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | 0        | 0    |
| Magnesium  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | 0        | 0    |
| Calcium    | ppm    | ASTM D5185m | 17      | <b>7</b>     | 7        | 8    |
| Phosphorus | ppm    | ASTM D5185m | 200     | <b>155</b>   | 166      | 134  |
| Zinc       | ppm    | ASTM D5185m |         | <b>27</b>    | 38       | 45   |
| Sulfur     | ppm    | ASTM D5185m | 5000    | <b>4061</b>  | 3088     | 2304 |

## CONTAMINANTS

|           | method | limit/base  | current | history1     | history2 |       |
|-----------|--------|-------------|---------|--------------|----------|-------|
| Silicon   | ppm    | ASTM D5185m | >15     | <b>0</b>     | 0        | 0     |
| Sodium    | ppm    | ASTM D5185m |         | <b>2</b>     | <1       | 2     |
| Potassium | ppm    | ASTM D5185m | >20     | <b>&lt;1</b> | 0        | 8     |
| Water     | %      | ASTM D6304  | >0.03   | <b>0.010</b> | 0.016    | 0.016 |
| ppm Water | ppm    | ASTM D6304  | >300    | <b>105.1</b> | 168.0    | 167.4 |

## FLUID CLEANLINESS

|                 | method       | limit/base | current        | history1 | history2 |
|-----------------|--------------|------------|----------------|----------|----------|
| Particles >4µm  | ASTM D7647   |            | <b>148</b>     | 686      | 185      |
| Particles >6µm  | ASTM D7647   | >5000      | <b>40</b>      | 141      | 35       |
| Particles >14µm | ASTM D7647   | >640       | <b>4</b>       | 21       | 8        |
| Particles >21µm | ASTM D7647   | >160       | <b>1</b>       | 3        | 3        |
| Particles >38µm | ASTM D7647   | >40        | <b>0</b>       | 0        | 0        |
| Particles >71µm | ASTM D7647   | >10        | <b>0</b>       | 0        | 0        |
| Oil Cleanliness | ISO 4406 (c) | >--/19/16  | <b>14/12/9</b> | 17/14/12 | 15/12/10 |

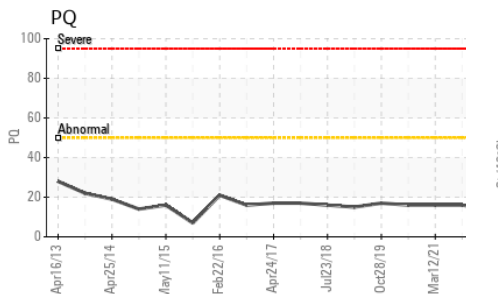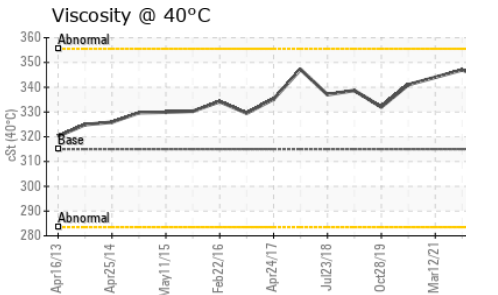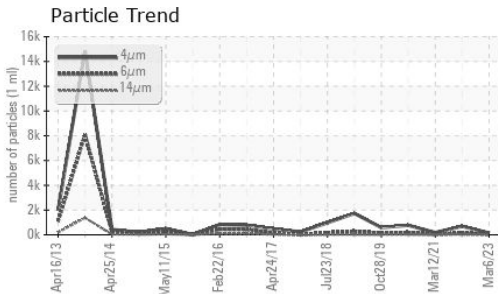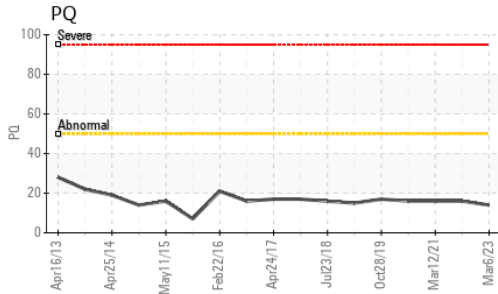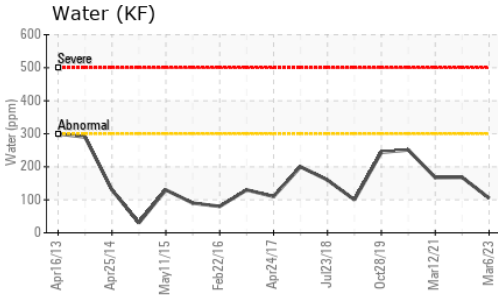


| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 | 0.9        | <b>1.00</b> | 1.09     | 1.091    |






| VISUAL           |        | method  | limit/base | current      | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Precipitate      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Silt             | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Debris           | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Appearance       | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Odor             | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Emulsified Water | scalar | *Visual | >0.03      | <b>NEG</b>   | NEG      | NEG      |
| Free Water       | scalar | *Visual |            | <b>NEG</b>   | NEG      | NEG      |

| FLUID PROPERTIES |     | method    | limit/base | current    | history1 | history2 |
|------------------|-----|-----------|------------|------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D445 | 315        | <b>343</b> | 347      | 344      |

| SAMPLE IMAGES |  | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
|---------------|--|--------|------------|---------|----------|----------|

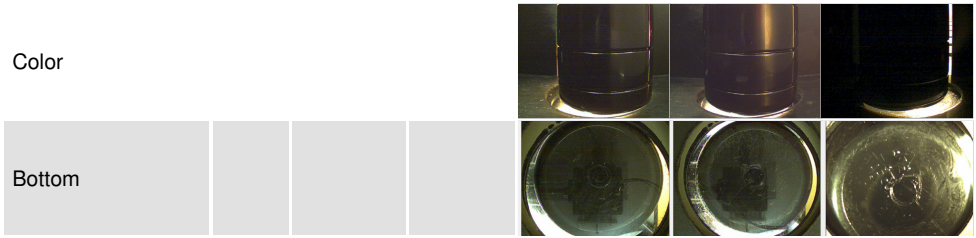

## GRAPHS

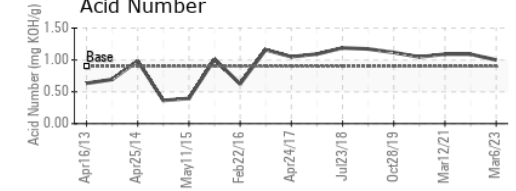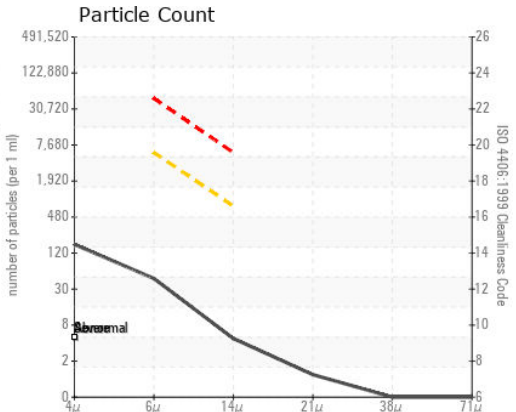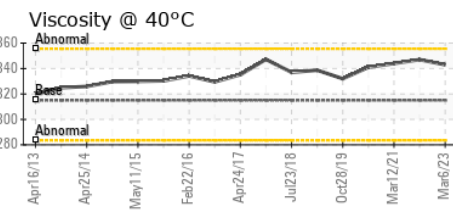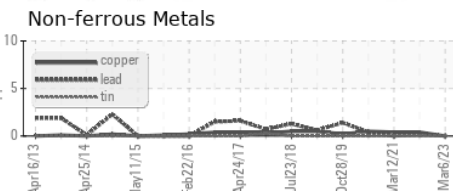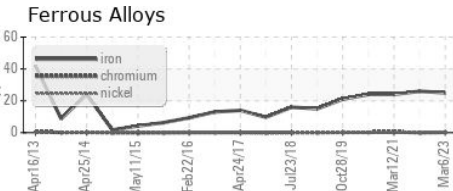

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0804480 **Received** : 26 May 2023  
**Lab Number** : 05857945 **Diagnosed** : 30 May 2023  
**Unique Number** : 10492410 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**ENERGIA EOLICA**  
 STA ANA KM25 CARRETERA AL SUR, A 1KM DEL CRUCE  
 FRANCISCO MORAZAN, ZZ  
 HN  
 Contact: SANTOS DEL CID  
 sdelcid@denemi.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: x:  
 F: x: