




PROBLEM SUMMARY


Sample Rating Trend

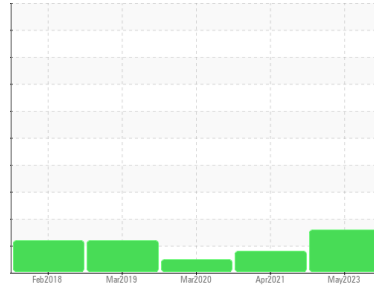

Machine Id
KAESER SK 15 AIRCENTER 5957579 (S/N 2187)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

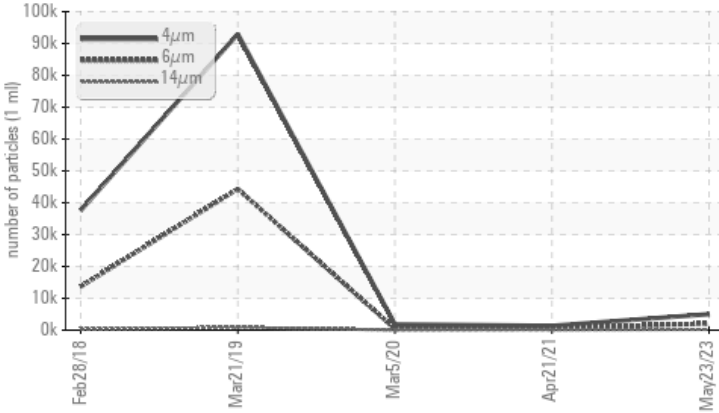

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 2071	594	471
Particles >14µm	ASTM D7647	>80	▲ 230	▲ 109	38
Particles >21µm	ASTM D7647	>20	▲ 47	▲ 28	13
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 16/14	16/12

Customer Id: FREDROY
 Sample No.: KC107820
 Lab Number: 05860862
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

21 Apr 2021 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



05 Mar 2020 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



21 Mar 2019 Diag: Doug Bogart

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

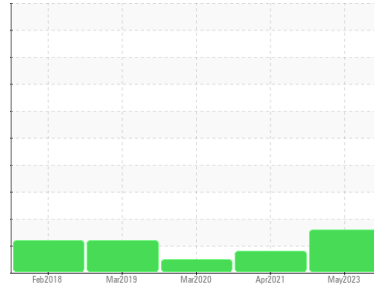

ISO



Machine Id
KAESER SK 15 AIRCENTER 5957579 (S/N 2187)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC107820	KC64539	KC72491
Sample Date	Client Info		23 May 2023	21 Apr 2021	05 Mar 2020
Machine Age	hrs	Client Info	11846	7333	5076
Oil Age	hrs	Client Info	2422	2257	1803
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ABNORMAL	ATTENTION	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	3	2	1
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	14	<1
Barium	ppm	ASTM D5185m 90	<1	0	5
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	44	57	78
Calcium	ppm	ASTM D5185m 2	1	0	2
Phosphorus	ppm	ASTM D5185m	<1	<1	2
Zinc	ppm	ASTM D5185m	6	2	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	2	2
Sodium	ppm	ASTM D5185m	9	18	19
Potassium	ppm	ASTM D5185m >20	2	1	2
Water	%	ASTM D6304 >0.05	0.024	0.031	0.029
ppm Water	ppm	ASTM D6304 >500	244.4	316.6	294.4






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5024	1358	1874
Particles >6µm	ASTM D7647 >1300		▲ 2071	594	471
Particles >14µm	ASTM D7647 >80		▲ 230	▲ 109	38
Particles >21µm	ASTM D7647 >20		▲ 47	▲ 28	13
Particles >38µm	ASTM D7647 >4		2	2	0
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 16/14	16/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.37	0.363	0.411

OIL ANALYSIS REPORT

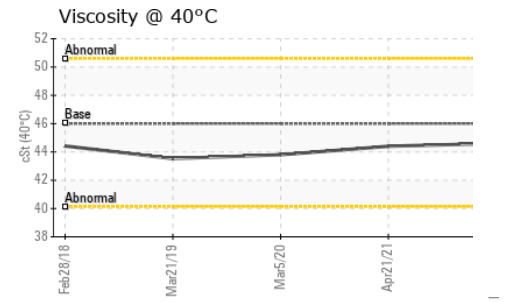
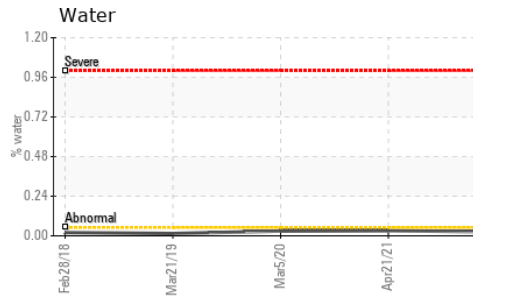
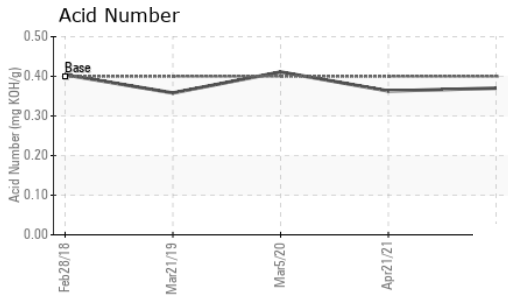
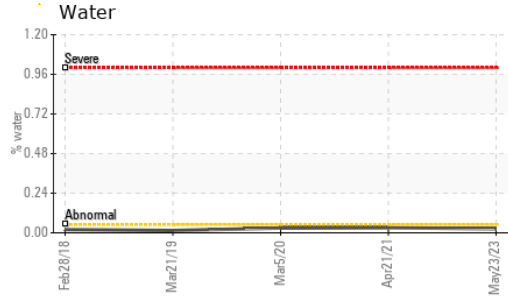
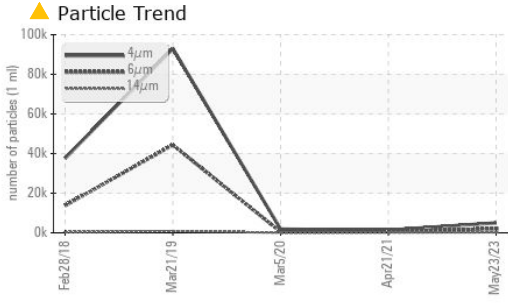


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.6	44.4	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

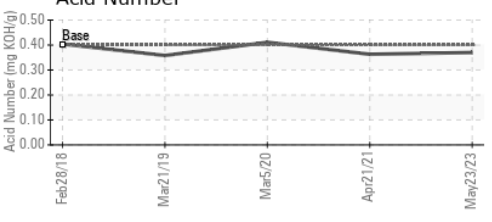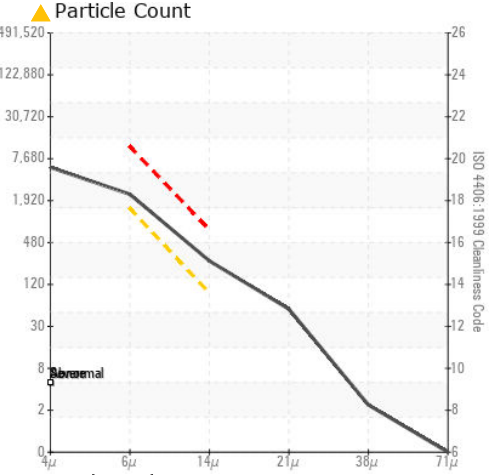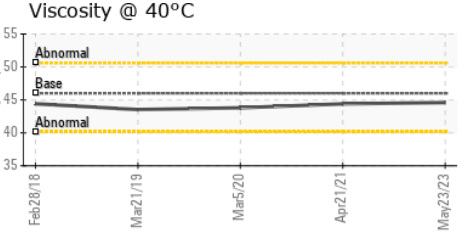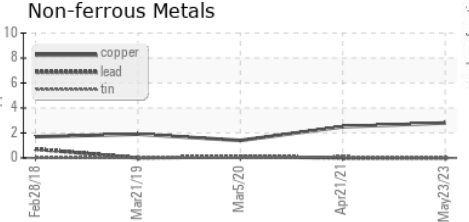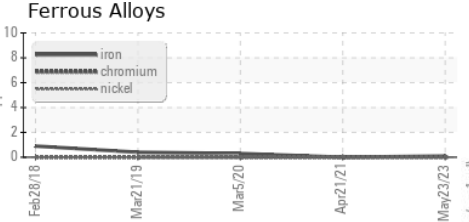

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC107820 **Received** : 31 May 2023
Lab Number : 05860862 **Diagnosed** : 02 Jun 2023
Unique Number : 10495327 **Diagnostician** : Jonathan Hester
Test Package : IND 2

FRED BEANS
 3960 AIRPORT BLVD
 DOYLESTOWN, PA
 US 18902
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: