




# FUEL REPORT

Sample Rating Trend

**NORMAL**

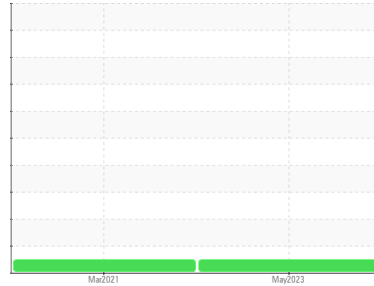

Area  
**PDM**  
 Machine Id  
**PDM UNITED DIESEL TOTE**  
 Component  
**Diesel Fuel**  
 Fluid  
**NOT GIVEN (275 GAL)**

## DIAGNOSIS

### Recommendation

This is a baseline read-out on the submitted sample.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

### Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0035118</b>	RP0013492	---
Sample Date	Client Info			<b>30 May 2023</b>	31 Mar 2021	---
Machine Age	mls	Client Info		<b>0</b>	0	---
Sample Status				<b>NORMAL</b>	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		<b>2.95</b>	2.14	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Water	%	ASTM D6304	<0.05	<b>0.002</b>	0.003	---
ppm Water	ppm	ASTM D6304	<500	<b>19.8</b>	36.9	---





HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Iron	ppm	ASTM D5185m	<0.1	<b>2</b>	0	---
Calcium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	0	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color						no image
Bottom						no image

# FUEL REPORT

## GRAPHS

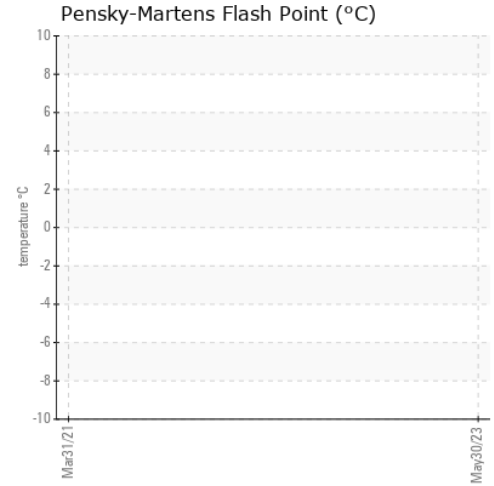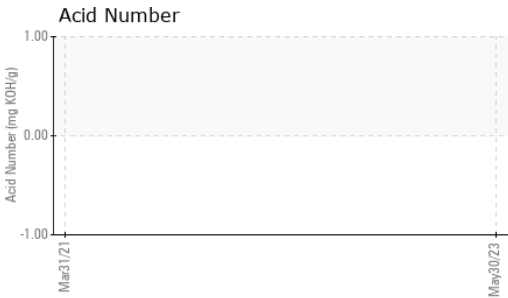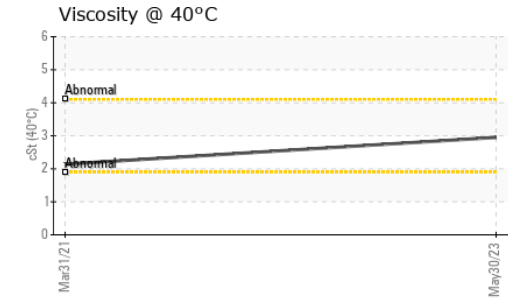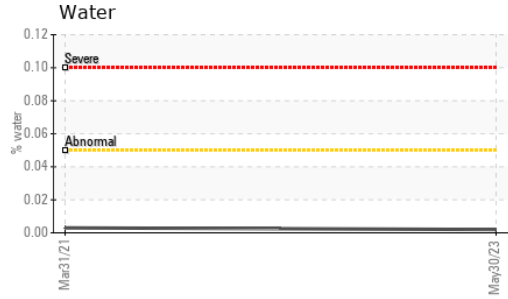

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0035118 **Received** : 31 May 2023  
**Lab Number** : **05861135** **Diagnosed** : 02 Jun 2023  
**Unique Number** : 10495600 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**OUTOKUMPU STAINLESS USA**  
 HWY 43 N  
 CALVERT, AL  
 US 36513  
 Contact: MARIO JOHNSON  
 Mario.johnson@outokumpu.com  
 T: (251)321-4105  
 F: x: