




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

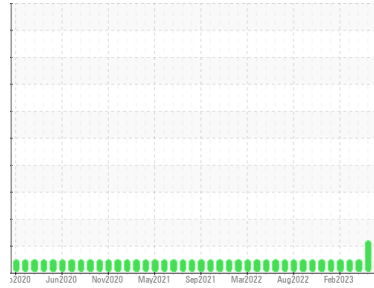

Area  
**MELT SHOP - CRANES**  
 Machine Id  
**LOWER HYD UNIT E-CRANE**  
 Component  
**Hydraulic System**  
 Fluid  
**AW HYDRAULIC OIL ISO 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0035169</b>	RP0034587	RP0030521
Sample Date	Client Info		<b>31 May 2023</b>	02 May 2023	30 Mar 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	0	1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	6	<1
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	1
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 5	<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 25	<b>1</b>	5	1
Calcium	ppm	ASTM D5185m 200	<b>52</b>	45	56
Phosphorus	ppm	ASTM D5185m 300	<b>350</b>	315	377
Zinc	ppm	ASTM D5185m 370	<b>442</b>	416	450

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	0	3
Sodium	ppm	ASTM D5185m	<b>2</b>	0	1
Potassium	ppm	ASTM D5185m >20	<b>3</b>	0	<1
Water	%	ASTM D6304 >0.05	<b>0.006</b>	0.010	0.007
ppm Water	ppm	ASTM D6304 >500	<b>61.2</b>	104.8	71.2






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>69</b>	▲ 8005	311
Particles >6µm	ASTM D7647	>1300	<b>22</b>	▲ 1453	61
Particles >14µm	ASTM D7647	>160	<b>4</b>	57	7
Particles >21µm	ASTM D7647	>40	<b>1</b>	15	2
Particles >38µm	ASTM D7647	>10	<b>0</b>	3	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	2	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>13/12/9</b>	▲ 20/18/13	15/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	<b>0.30</b>	0.32	0.38


# OIL ANALYSIS REPORT

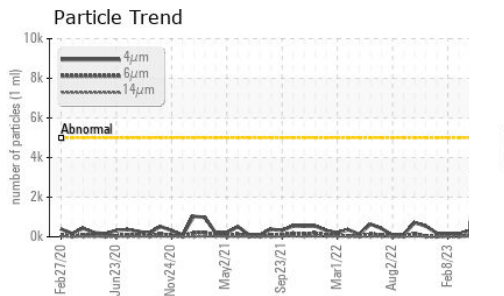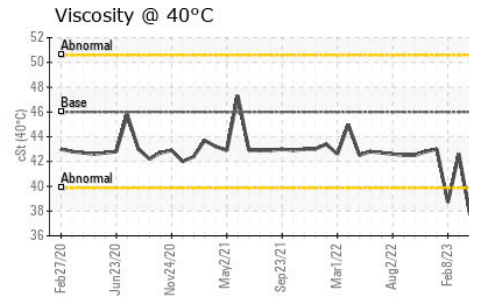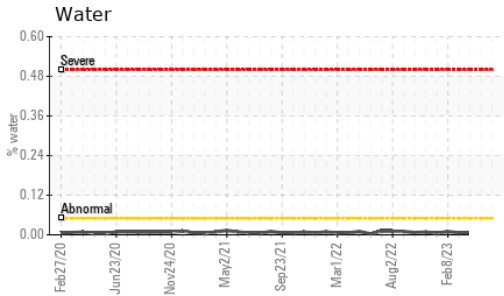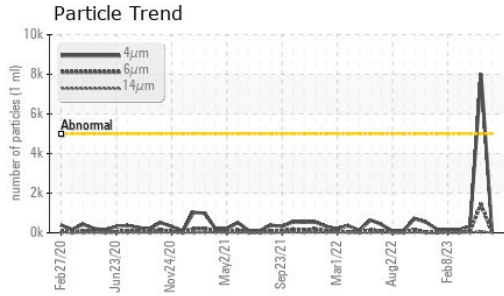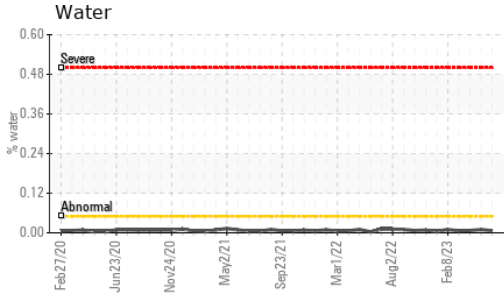






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	42.6	42.9	37.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

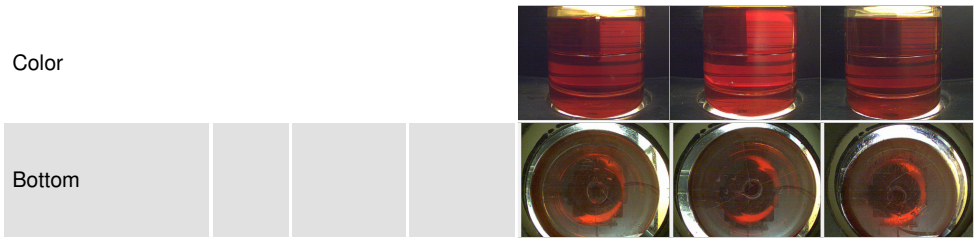

## GRAPHS

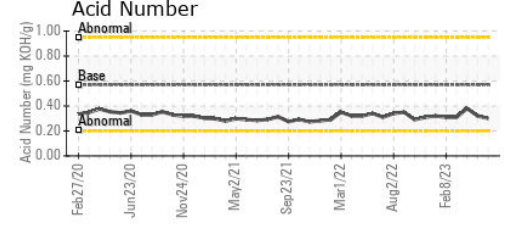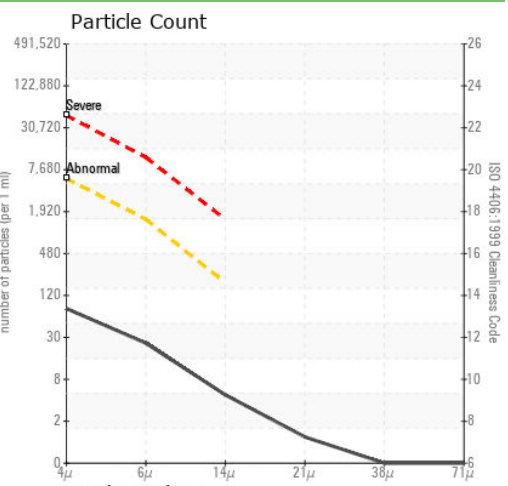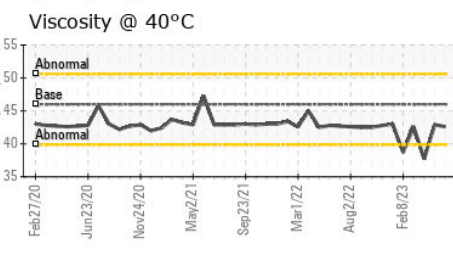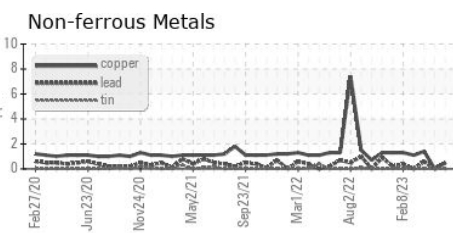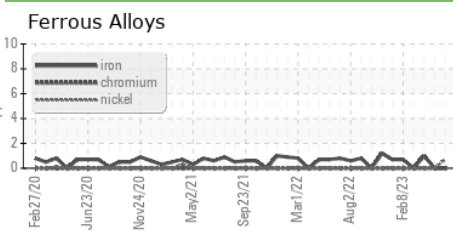

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0035169 **Received** : 02 Jun 2023  
**Lab Number** : 05862989 **Diagnosed** : 05 Jun 2023  
**Unique Number** : 10497454 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**OUTOKUMPU STAINLESS USA**  
 HWY 43 N  
 CALVERT, AL  
 US 36513  
 Contact: MARIO JOHNSON  
 Mario.johnson@outokumpu.com  
 T: (251)321-4105  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)