



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
NOT GIVEN KFS0000221

Component
Hydraulic System

Fluid
AW HYDRAULIC OIL ISO 100 (--- GAL)

DIAGNOSIS

Recommendation

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We recommend you service the filters on this component. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a light amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KFS0000221	---	---
Sample Date	Client Info		01 Jun 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ATTENTION	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<1	---	---
Chromium	ppm	ASTM D5185m >20	0	---	---
Nickel	ppm	ASTM D5185m >20	0	---	---
Titanium	ppm	ASTM D5185m	<1	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >20	<1	---	---
Lead	ppm	ASTM D5185m >20	0	---	---
Copper	ppm	ASTM D5185m >20	9	---	---
Tin	ppm	ASTM D5185m >20	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	---	---
Barium	ppm	ASTM D5185m 5	0	---	---
Molybdenum	ppm	ASTM D5185m 5	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m 25	0	---	---
Calcium	ppm	ASTM D5185m 200	37	---	---
Phosphorus	ppm	ASTM D5185m 300	358	---	---
Zinc	ppm	ASTM D5185m 370	409	---	---
Sulfur	ppm	ASTM D5185m 2500	1006	---	---


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	---	---
Sodium	ppm	ASTM D5185m	<1	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	4498	---	---
Particles >6µm	ASTM D7647	>1300	1363	---	---
Particles >14µm	ASTM D7647	>160	86	---	---
Particles >21µm	ASTM D7647	>40	21	---	---
Particles >38µm	ASTM D7647	>10	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	19/18/14	---	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	0.27	---	---

OIL ANALYSIS REPORT

Particle Trend

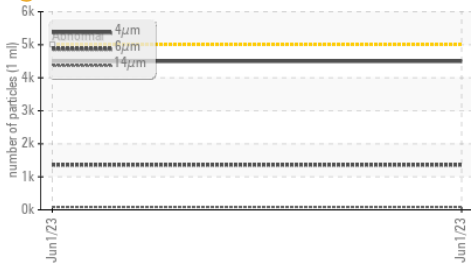


Particle Trend

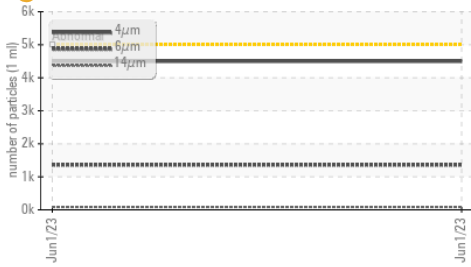

Acid Number



Viscosity @ 40°C

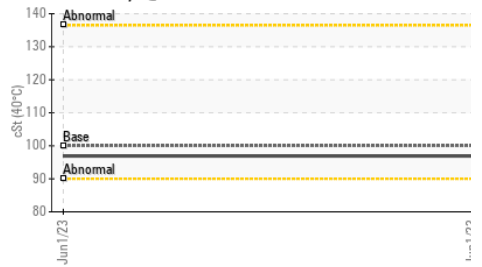





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	96.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

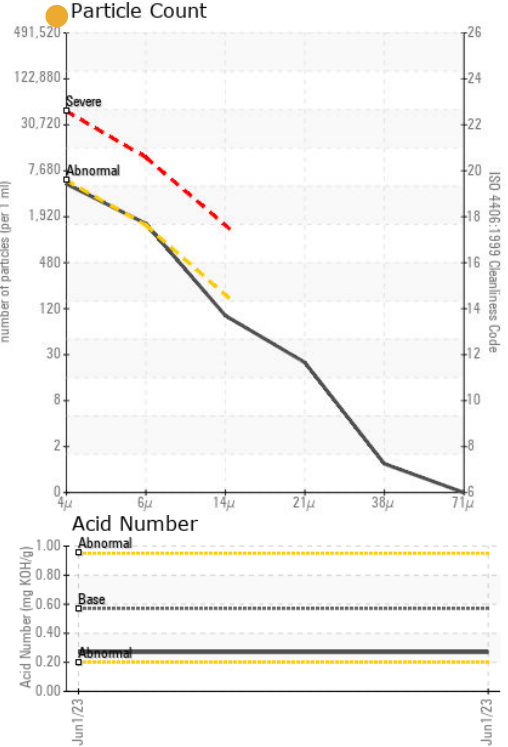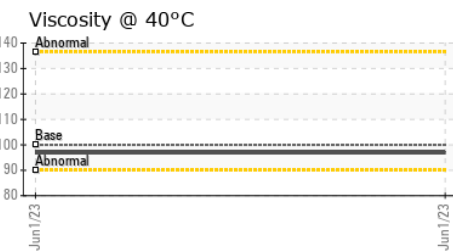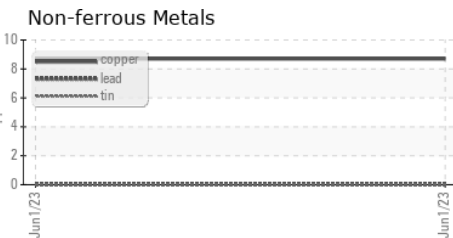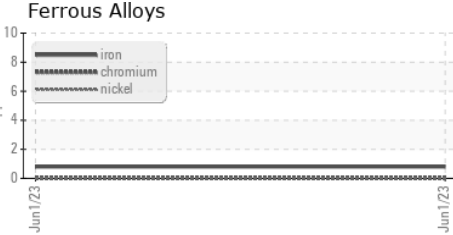

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KFS0000221 **Received** : 05 Jun 2023
Lab Number : 05864230 **Tested** : 06 Jun 2023
Unique Number : 10498695 **Diagnosed** : 06 Jun 2023 - Wes Davis
Test Package : IND 2

KIMBRO OIL COMPANY
 2200 CLIFTON AVE
 NASHVILLE, TN
 US 37203
 Contact: CHRIS HIGGINS
 chiggins@kimbrooil.com
 T: (270)305-1347
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)