


PROBLEM SUMMARY

Sample Rating Trend




ADDITIVES

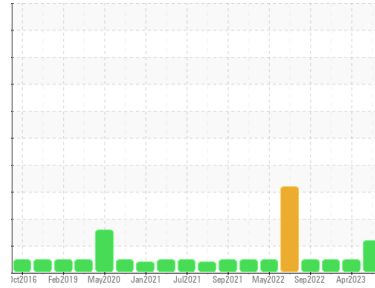

Area
MELT SHOP - BAGHOUSE FANS
Machine Id
M/S BAGHOUSE FAN 151A B/S (S/N 15-6400-2000-1010)
Component
Outboard Journal Bearing
Fluid
MOBIL SHC 627 (--- GAL)

COMPONENT CONDITION SUMMARY

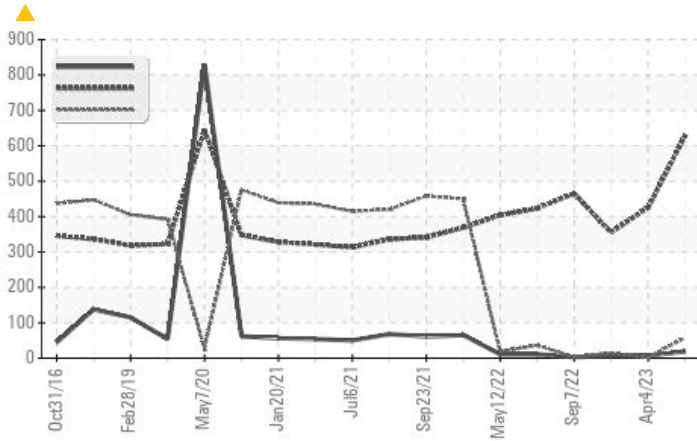

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	NORMAL
Molybdenum	ppm	ASTM D5185m	▲ 269	0	0
Calcium	ppm	ASTM D5185m	▲ 19	7	7
Zinc	ppm	ASTM D5185m	▲ 57	1	14

Customer Id: OUTCALAL
Sample No.: RP0035059
Lab Number: 05865702
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

04 Apr 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



06 Dec 2022 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. All component wear rates are normal. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Sep 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

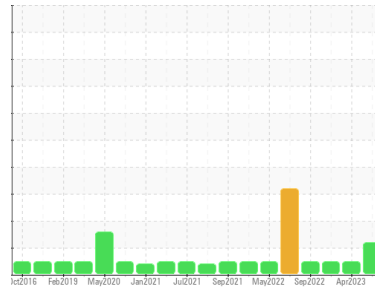

ADDITIVES



Area
MELT SHOP - BAGHOUSE FANS
 Machine Id
M/S BAGHOUSE FAN 151A B/S (S/N 15-6400-2000-1010)
 Component
Outboard Journal Bearing
 Fluid
MOBIL SHC 627 (--- GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

▲ Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0035059	RP0029656	RP0030824
Sample Date	Client Info		05 Jun 2023	04 Apr 2023	06 Dec 2022
Machine Age	Client Info		0	0	0
Oil Age	Client Info		0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		27	16	16
Iron	ppm ASTM D5185m	>200	40	16	14
Chromium	ppm ASTM D5185m	>15	<1	0	<1
Nickel	ppm ASTM D5185m	>15	0	0	2
Titanium	ppm ASTM D5185m		0	0	0
Silver	ppm ASTM D5185m		0	0	0
Aluminum	ppm ASTM D5185m	>25	<1	<1	0
Lead	ppm ASTM D5185m	>100	0	0	0
Copper	ppm ASTM D5185m	>200	<1	0	0
Tin	ppm ASTM D5185m	>25	0	0	0
Vanadium	ppm ASTM D5185m		0	<1	<1
Cadmium	ppm ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m		6	0	0
Barium	ppm ASTM D5185m		3	0	1
Molybdenum	ppm ASTM D5185m		▲ 269	0	0
Manganese	ppm ASTM D5185m		2	1	<1
Magnesium	ppm ASTM D5185m		7	5	1
Calcium	ppm ASTM D5185m		▲ 19	7	7
Phosphorus	ppm ASTM D5185m		628	425	355
Zinc	ppm ASTM D5185m		▲ 57	1	14






CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m	>50	4	<1	<1
Sodium	ppm ASTM D5185m		<1	0	2
Potassium	ppm ASTM D5185m	>20	<1	2	<1
Water	% ASTM D6304	>0.2	0.005	0.007	0.007
ppm Water	ppm ASTM D6304	>2000	52.7	70.5	74.4

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045		0.90	0.25	0.30

OIL ANALYSIS REPORT

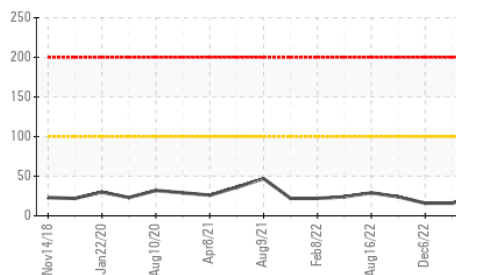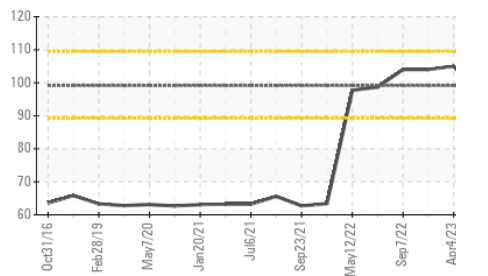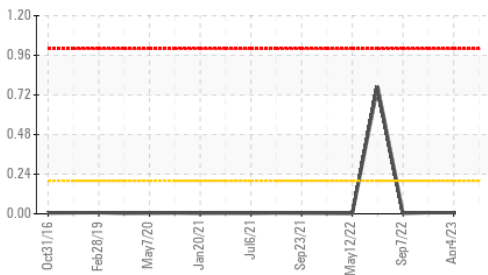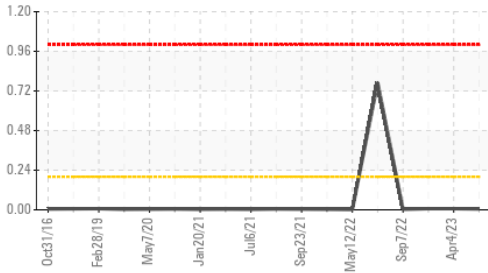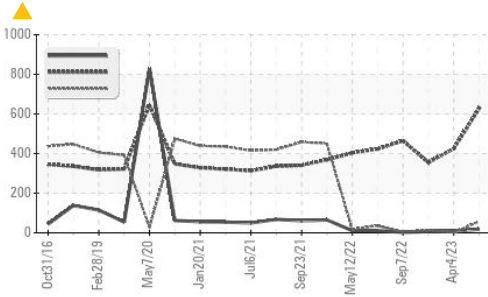






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	MODER	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	99.1	96.4	105

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



GRAPHS

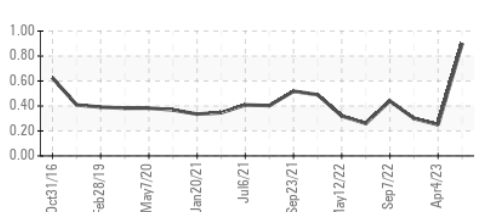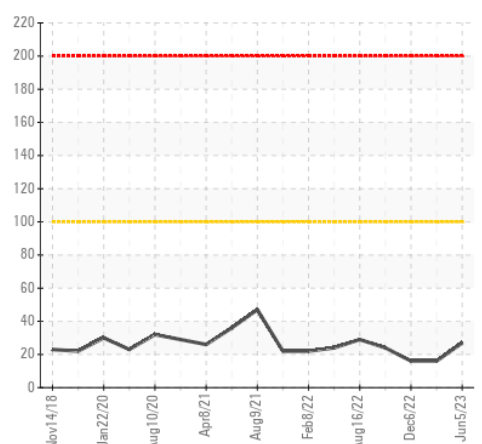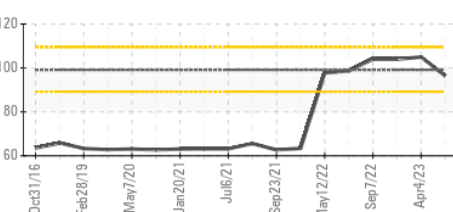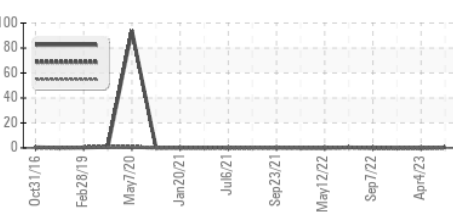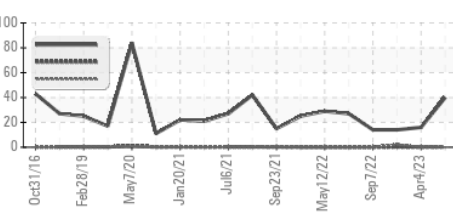

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0035059 **Received** : 06 Jun 2023
Lab Number : **05865702** **Diagnosed** : 08 Jun 2023
Unique Number : 10500167 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: PQ)

OUTOKUMPU STAINLESS USA
 HWY 43 N
 CALVERT, AL
 US 36513
 Contact: MARIO JOHNSON
 Mario.johnson@outokumpu.com
 T: (251)321-4105
 F: x:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)