




PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
Paper Machine
 Machine Id
Dry End Lubrication System
 Component
Bearing Lube
 Fluid
MOBIL DTE PM 220 (20000 LTR)

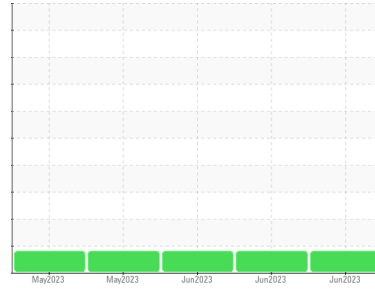

COMPONENT CONDITION SUMMARY

▲ Particle Trend

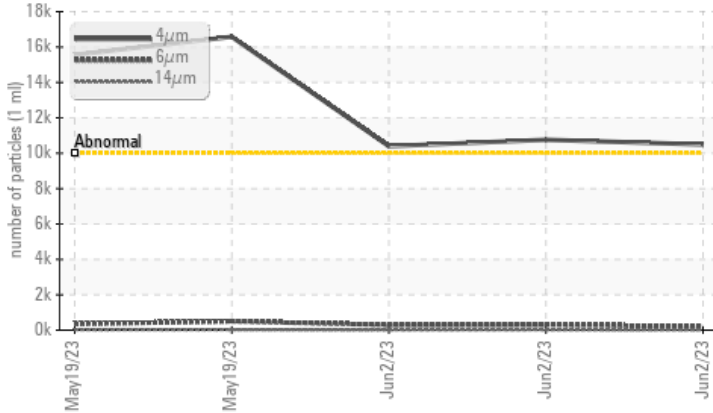

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor. (Customer Sample Comment: Sample #3 Before Vacuum Dehydrator)

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ATTENTION	ATTENTION
Particles >4µm	ASTM D7647 >10000	▲ 10395	▲ 10758	▲ 10492
Oil Cleanliness	ISO 4406 (c) >20/18/14	▲ 21/15/11	▲ 21/15/11	▲ 21/15/11

Customer Id: CASASH
 Sample No.: WC0776620
 Lab Number: 05867290
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

02 Jun 2023 Diag: Angela Borella

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



02 Jun 2023 Diag: Angela Borella

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 May 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report






OIL ANALYSIS REPORT

Sample Rating Trend

ISO

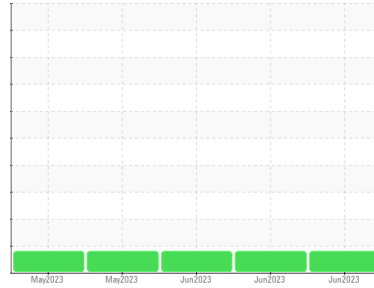

Area
Paper Machine
 Machine Id
Dry End Lubrication System
 Component
Bearing Lube
 Fluid
MOBIL DTE PM 220 (20000 LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (Customer Sample Comment: Sample #3 Before Vacuum Dehydrator)

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The water content is negligible.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0776620	WC0776618	WC0776619
Sample Date	Client Info			02 Jun 2023	02 Jun 2023	02 Jun 2023
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ATTENTION	ATTENTION	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>120	28	28	28
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>4	0	0	0
Lead	ppm	ASTM D5185m	>30	0	0	0
Copper	ppm	ASTM D5185m	>17	2	1	1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	<1	<1
Molybdenum	ppm	ASTM D5185m		<1	<1	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		2	1	1
Calcium	ppm	ASTM D5185m		128	128	125
Phosphorus	ppm	ASTM D5185m		881	883	870
Zinc	ppm	ASTM D5185m		1179	1185	1172
Sulfur	ppm	ASTM D5185m		15097	15191	15033






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	3	3
Sodium	ppm	ASTM D5185m		2	2	2
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.2	0.019	0.016	0.016
ppm Water	ppm	ASTM D6304	>2000	195.9	164.4	162.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 10395	▲ 10758	▲ 10492
Particles >6µm		ASTM D7647	>2500	292	302	215
Particles >14µm		ASTM D7647	>160	12	18	14
Particles >21µm		ASTM D7647	>40	2	2	4
Particles >38µm		ASTM D7647	>10	1	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/14	▲ 21/15/11	▲ 21/15/11	▲ 21/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		1.57	1.54	1.58




OIL ANALYSIS REPORT

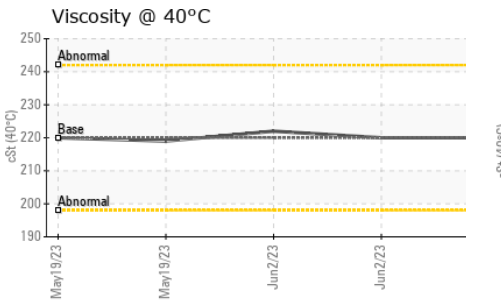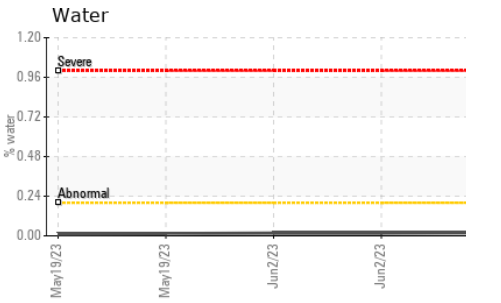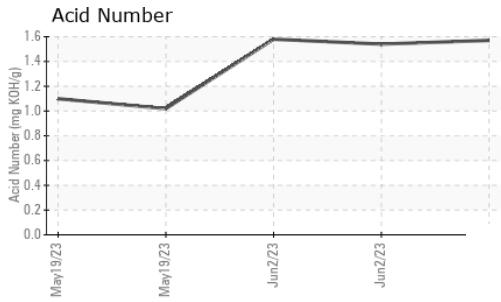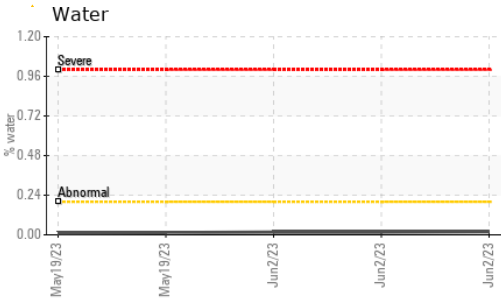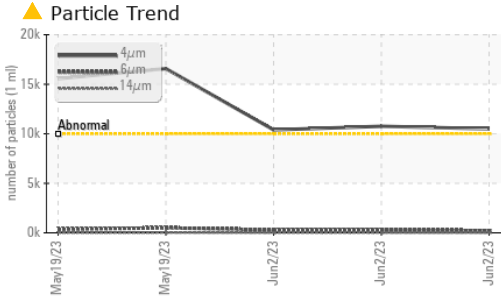






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	220	222

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

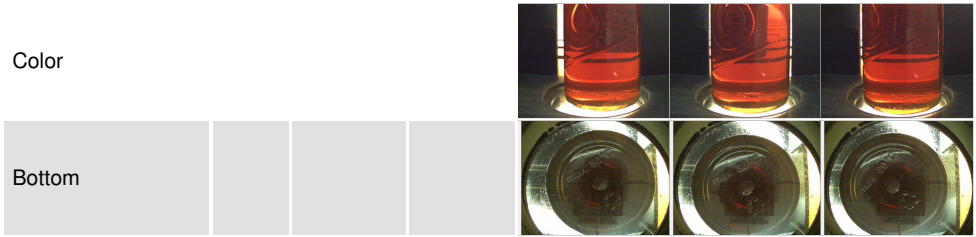

GRAPHS

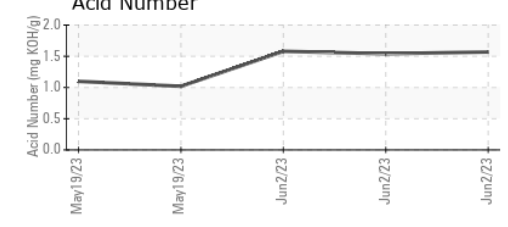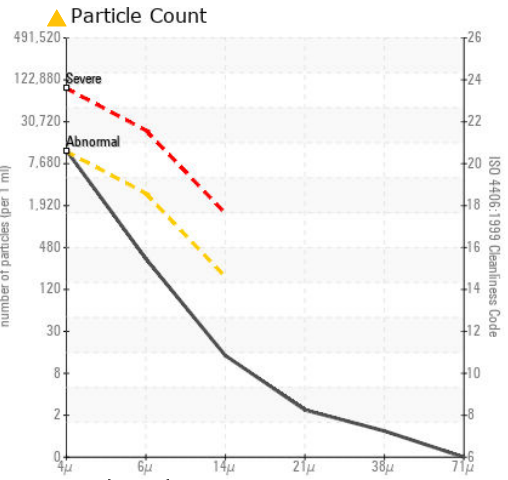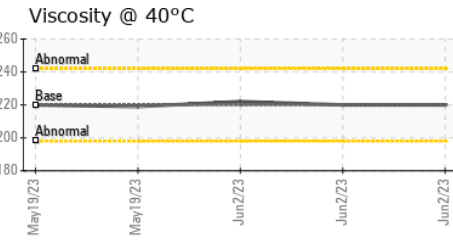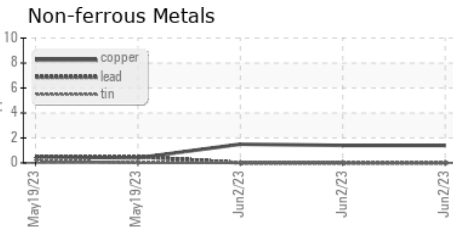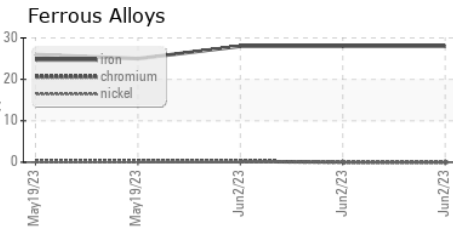

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0776620 **Received** : 07 Jun 2023
Lab Number : 05867290 **Diagnosed** : 09 Jun 2023
Unique Number : 10507074 **Diagnostician** : Angela Borella
Test Package : PLANT

CASCADES CONTAINERBOARD PACKAGING - BEARPACK PROJECT
 10026 OLD RIDGE ROAD
 ASHLAND, VA
 US 23005
 Contact: MARC-ANDRE HUBERT
 marc-andre_hubert@cascades.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)