




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

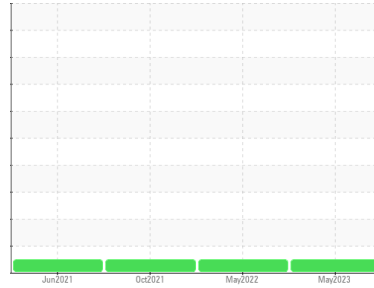

Area
FRONTIER II [200006776]
 Machine Id
39WEA86892
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN CLP ISO 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	NX05867861	NX05565465	NX05391873	
Sample Date	Client Info	16 May 2023	16 May 2022	09 Oct 2021	
Machine Age	hrs	Client Info	13468	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A	
Sample Status		NORMAL	NORMAL	NORMAL	

WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184	>80	17	19	18	
Iron	ppm	ASTM D5185m	>150	21	12	8
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m	>10	0	<1	<1
Titanium	ppm	ASTM D5185m	>10	0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>20	0	<1	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m	>5	---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		4	5	11
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		0	<1	<1
Calcium	ppm	ASTM D5185m		6	9	11
Phosphorus	ppm	ASTM D5185m		158	187	91
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		6209	4846	4550

CONTAMINANTS






method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>50	9	3	3
Sodium	ppm	ASTM D5185m	>20	4	1	1
Potassium	ppm	ASTM D5185m	>20	0	<1	<1
Water	%	ASTM D6304	>0.05	0.006	0.004	0.009
ppm Water	ppm	ASTM D6304	>500	68.6	45.0	90.9

FLUID CLEANLINESS

method	limit/base	current	history1	history2		
Particles >4µm	ASTM D7647			8285	2267	2157
Particles >6µm	ASTM D7647	>2500		1897	84	334
Particles >14µm	ASTM D7647	>320		135	8	24
Particles >21µm	ASTM D7647	>80		29	3	4
Particles >38µm	ASTM D7647	>20		2	0	0
Particles >71µm	ASTM D7647	>4		1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15		20/18/14	18/14/10	18/16/12



OIL ANALYSIS REPORT

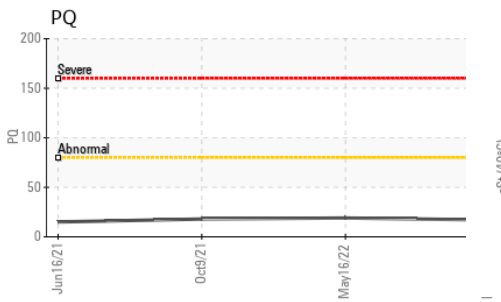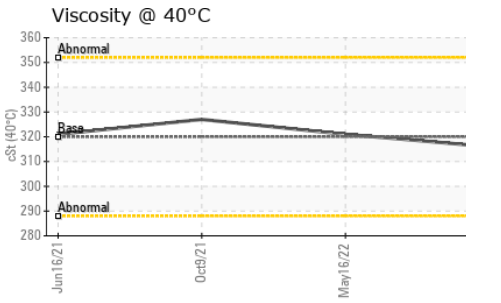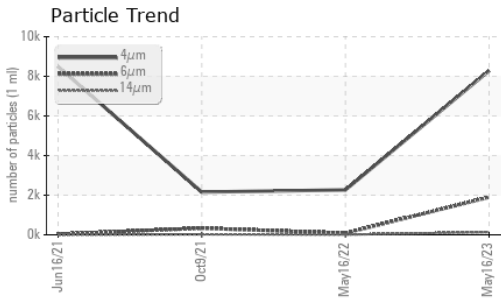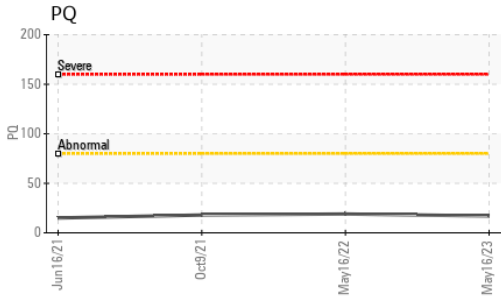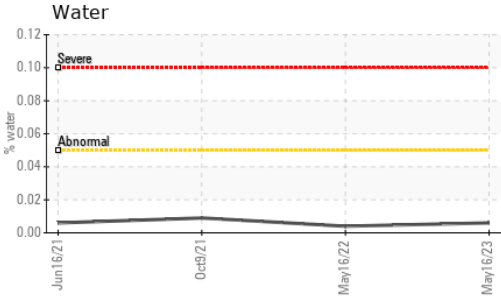

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.58	0.55	0.509


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	316	321	327






SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color

Bottom

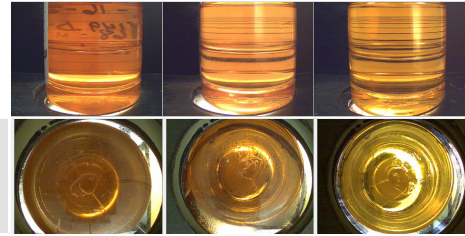

GRAPHS

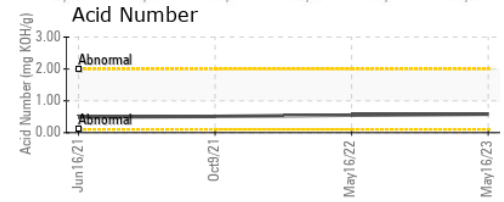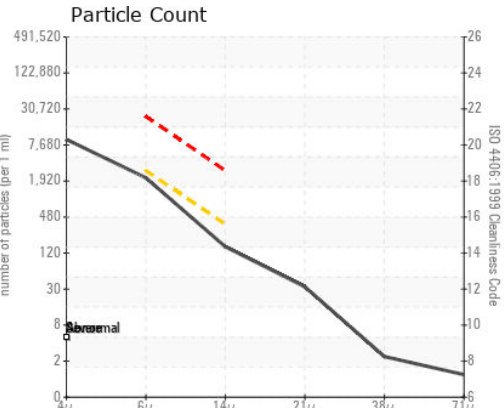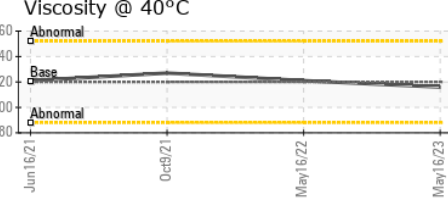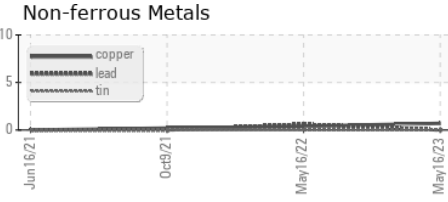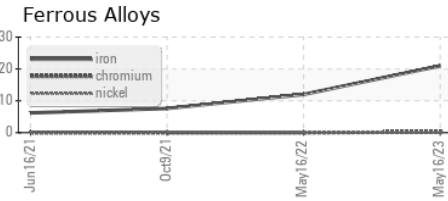

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX05867861 **Received** : 08 Jun 2023
Lab Number : **05867861** **Diagnosed** : 11 Jun 2023
Unique Number : 10507645 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)