

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id

FRICK B-4 RDB134B (S/N S0146NFMFT0AA3)

Component

Refrigeration Compressor

FRICK COMPRESSOR OIL #9 (40 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


Oct2017 Feb.2019 Dec2019 Apr2020 Oct2020 Apr2021 Nov2021 Meg2022 Dec2022 Jun2023						
SAMPLE INFORM	//ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0818869	WC0746969	WC0680048
Sample Date		Client Info		05 Jun 2023	01 Dec 2022	10 May 2022
Machine Age	hrs	Client Info		30768	26539	24281
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	7	19	16
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		0	23	2
Zinc	ppm	ASTM D5185m		2	0	0
Sulfur	ppm	ASTM D5185m		11	0	39
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	2	2
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.01	0.001	0.005	0.001
ppm Water	ppm	ASTM D6304	>100	9.4	57.7	10.0
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.023	0.014	0.014





OIL ANALYSIS REPORT

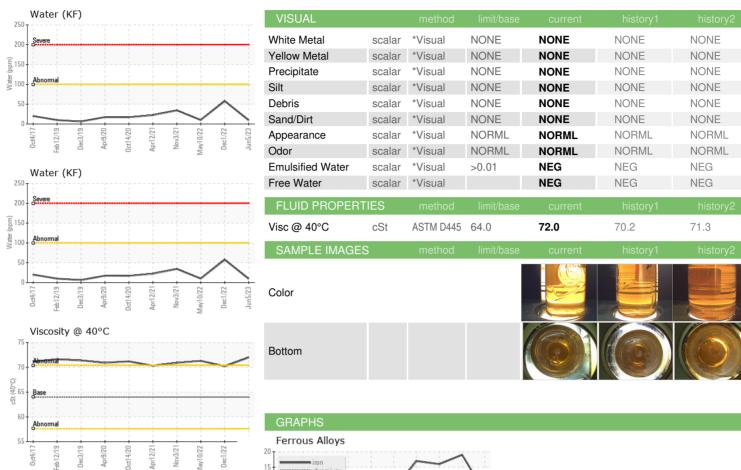













Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0818869 : 05867958 : 10507742

Recieved Diagnosed

: 08 Jun 2023 : 13 Jun 2023 Diagnostician : Don Baldridge

PIGGLY WIGGLY 2400 TERRELL WOOTEN DR

BESSEMER, AL US 35020

Contact: MYRON HALL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (205)767-6343 F: