




PROBLEM SUMMARY

Sample Rating Trend

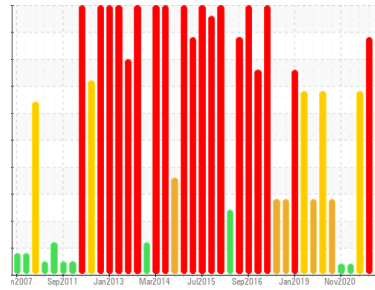

VIS DEBRIS



Area
TM 11
 Machine Id
TM 11 REEL DRUM REDUCER
 Component
Gearbox
 Fluid
ROYAL PURPLE SYNERGY 90/220 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We recommend you filter the oil on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	SEVERE	SEVERE
Debris	scalar	*Visual	NONE	▲ MODER	NONE	VLITE

Customer Id: KIMMOBTM11
 Sample No.: RP0023584
 Lab Number: 05870306
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

30 Mar 2022 Diag: Doug Bogart

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Oct 2021 Diag: Doug Bogart

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 Apr 2021 Diag: Doug Bogart

VIS DEBRIS




We recommend you filter the oil on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

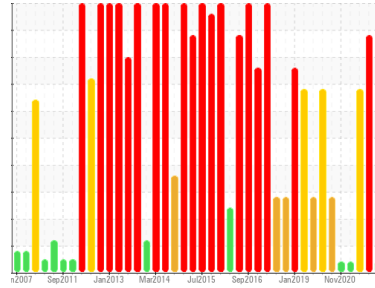

VIS DEBRIS



Area
TM 11
Machine Id
TM 11 REEL DRUM REDUCER
Component
Gearbox
Fluid
ROYAL PURPLE SYNERGY 90/220 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you filter the oil on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0023584	RP0016696	RP0016653
Sample Date	Client Info		05 May 2023	30 Mar 2022	08 Oct 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			ABNORMAL	SEVERE	SEVERE

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		22	---	---
Iron	ppm	ASTM D5185m >200	18	26	34
Chromium	ppm	ASTM D5185m >15	0	<1	<1
Nickel	ppm	ASTM D5185m >15	0	0	0
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m	0	<1	0
Aluminum	ppm	ASTM D5185m >25	<1	<1	2
Lead	ppm	ASTM D5185m >100	0	<1	<1
Copper	ppm	ASTM D5185m >200	<1	<1	1
Tin	ppm	ASTM D5185m >25	0	<1	0
Antimony	ppm	ASTM D5185m >5	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	15	18	15
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	2	8	8
Phosphorus	ppm	ASTM D5185m 370	411	418	347
Zinc	ppm	ASTM D5185m	12	52	72

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	6	12	14
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	0	0	0
Water	%	ASTM D6304 >0.2	0.010	0.007	0.010
ppm Water	ppm	ASTM D6304 >2000	103.1	70.2	106.4





FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	---	86794	113436
Particles >6µm	ASTM D7647	>5000	---	18634	22908
Particles >14µm	ASTM D7647	>640	---	2932	1763
Particles >21µm	ASTM D7647	>160	---	890	381
Particles >38µm	ASTM D7647	>40	---	89	32
Particles >71µm	ASTM D7647	>10	---	5	2
Oil Cleanliness	ISO 4406 (c)	>21/19/16	---	24/21/19	24/22/18

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.33	1.10	0.88	0.870


OIL ANALYSIS REPORT

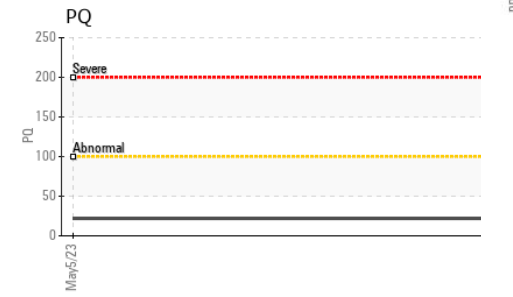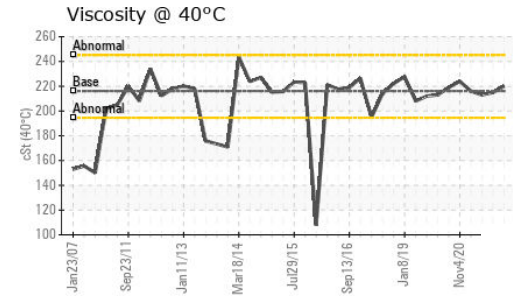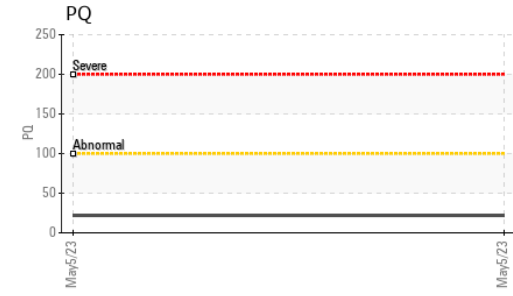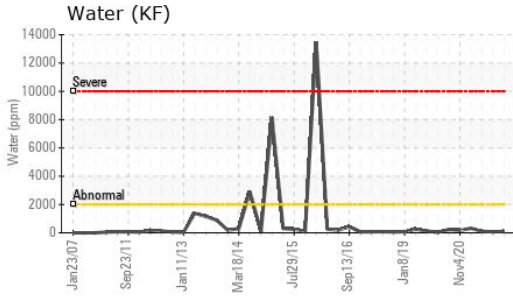





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	216.1	220	215

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

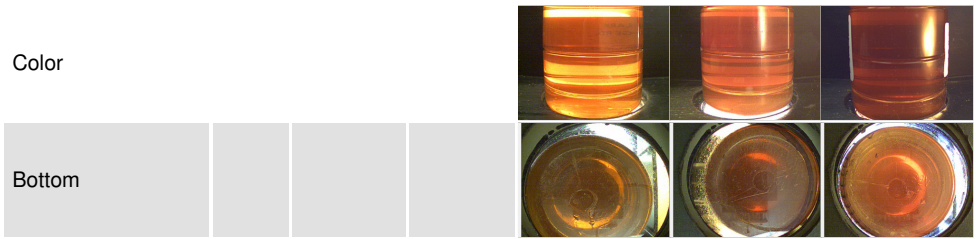

GRAPHS

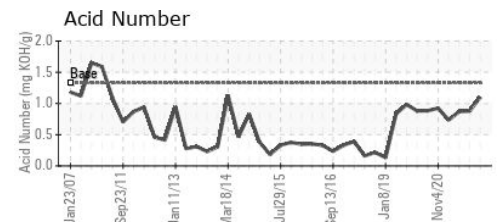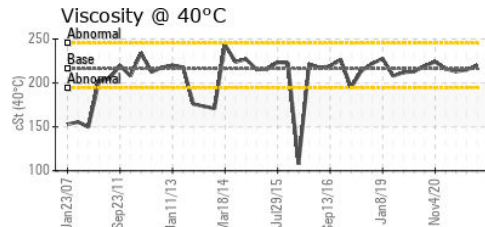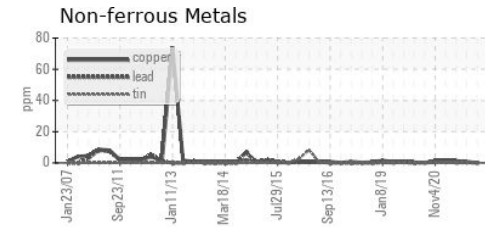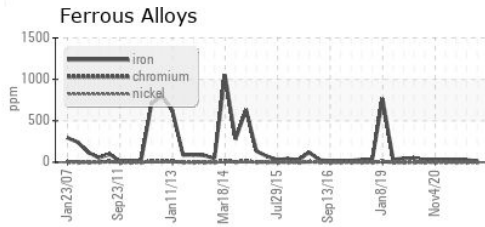

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0023584 **Received** : 09 Jun 2023
Lab Number : 05870306 **Diagnosed** : 13 Jun 2023
Unique Number : 10510090 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PQ, PrtCount)

Kimberly-Clark - Mobile - TM 11
 200 BAYBRIDGE RD
 MOBILE, AL
 US 36610
 Contact: LARRY WEAVER
 Larry.D.Weaver@kcc.com
 T:
 F: (251)452-6335

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)