




OIL ANALYSIS REPORT

Sample Rating Trend

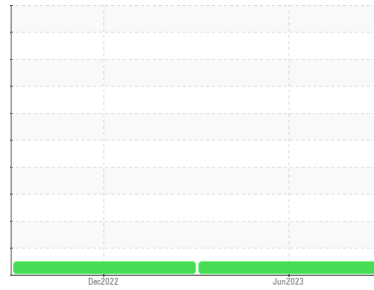

NORMAL



Machine Id
MYCOM S-1 (S/N 1653585)
 Component
Refrigeration Compressor
 Fluid
MYCOM MYCOLD AB68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please note that this is a corrected copy for data entry updates.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			USP241198	USP241201	---
Sample Date	Client Info			09 Jun 2023	21 Dec 2022	---
Machine Age	hrs	Client Info		64162	64161	---
Oil Age	hrs	Client Info		64162	64161	---
Oil Changed		Client Info		Not Chngd	Not Chngd	---
Sample Status				NORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	<1	---
Chromium	ppm	ASTM D5185m	>2	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>3	0	0	---
Lead	ppm	ASTM D5185m	>2	0	0	---
Copper	ppm	ASTM D5185m	>8	0	0	---
Tin	ppm	ASTM D5185m	>4	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		0	0	---
Phosphorus	ppm	ASTM D5185m	2.3	0	<1	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m	26	5	35	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	0	---
Sodium	ppm	ASTM D5185m		0	0	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.01	0.003	0.00	---
ppm Water	ppm	ASTM D6304	>100	31.6	0.00	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	4447	5721	---
Particles >6µm		ASTM D7647	>2500	402	527	---
Particles >14µm		ASTM D7647	>320	8	12	---
Particles >21µm		ASTM D7647	>80	2	2	---
Particles >38µm		ASTM D7647	>20	0	0	---
Particles >71µm		ASTM D7647	>4	0	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/16/10	20/16/11	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.01	0.015	0.015	---




OIL ANALYSIS REPORT

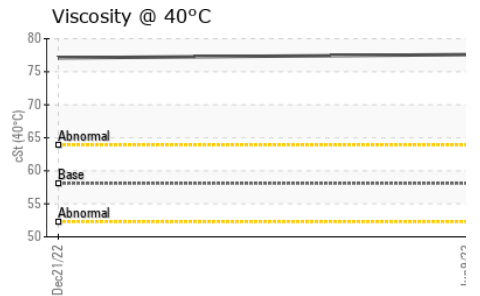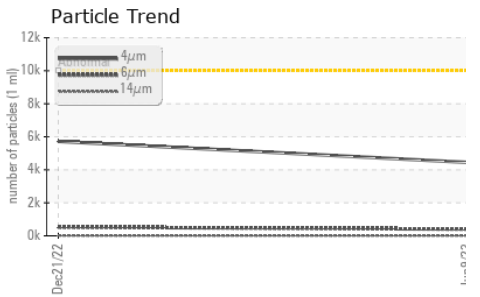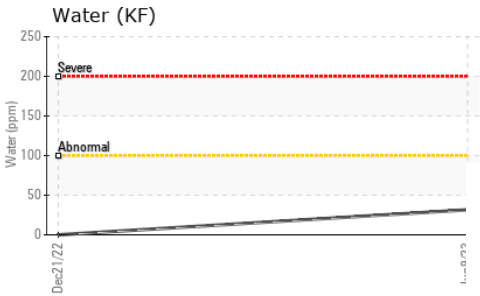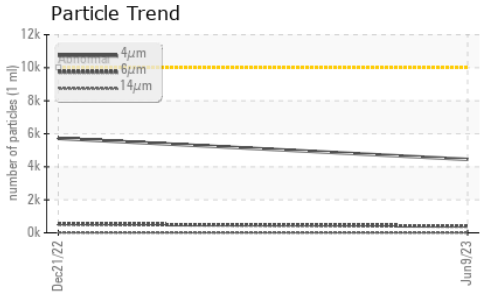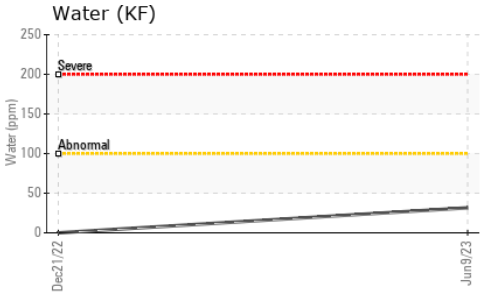






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	58.09	77.6	77.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

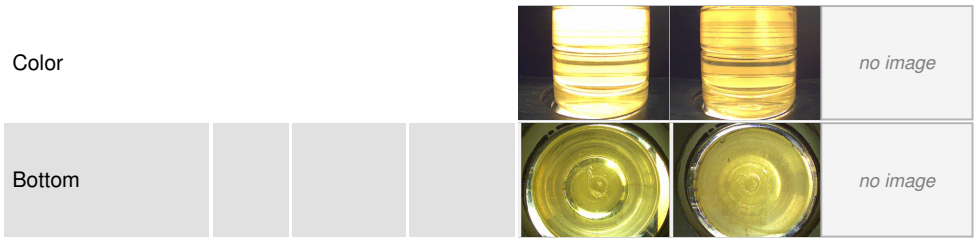

GRAPHS

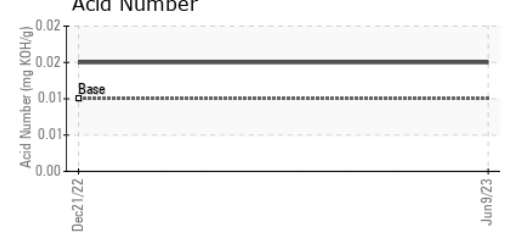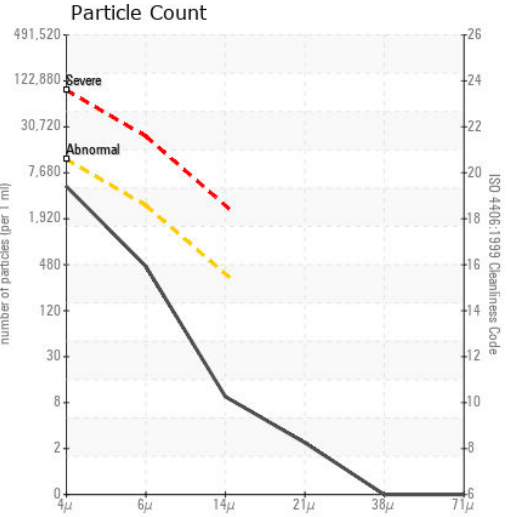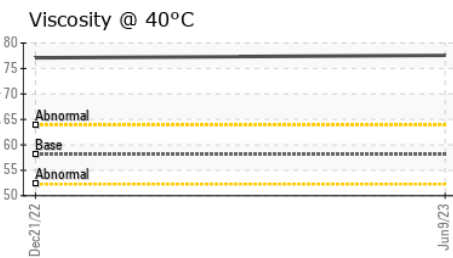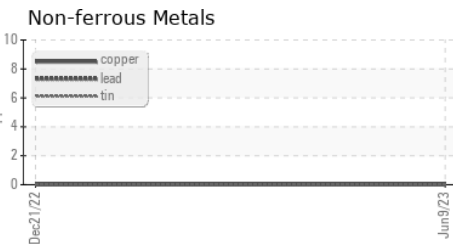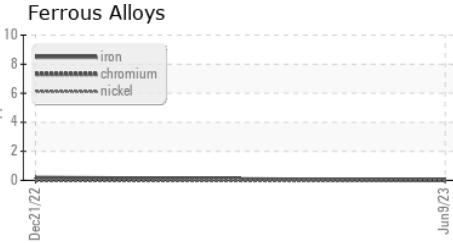

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP241198
Lab Number : 05871583
Unique Number : 10511367
Test Package : IND 2
Received : 12 Jun 2023
Tested : 14 Jun 2023
Diagnosed : 23 May 2024 - Doug Bogart

HENNINGSEN COLD STORAGE - 17400
 17400 NE SACRAMENTO ST
 PORTLAND, OR
 US 97230
 Contact: ANDREY BEREZHNOY
 andrey.berzhnoy@henningesen.com
 T: (503)256-2525
 F: (503)252-5257

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)