




# OIL ANALYSIS REPORT

Sample Rating Trend

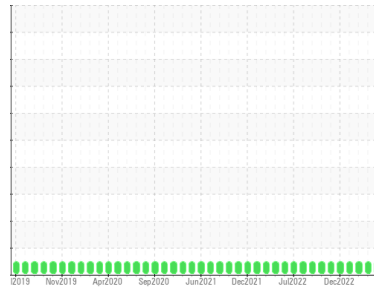

**NORMAL**



Area  
**GEORGE N**  
 Machine Id  
**[GEORGE N] 008 571099-8**  
 Component  
**Starboard Genset**  
 Fluid  
**CHEVRON DELO 400 LE 15W40 (4 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>MW0051271</b>	MW0051296	MW0051138
Sample Date	Client Info			<b>01 Jun 2023</b>	03 Apr 2023	02 Mar 2023
Machine Age	hrs	Client Info		<b>42380</b>	41701	41341
Oil Age	hrs	Client Info		<b>224</b>	309	312
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>25	<b>6</b>	5	2
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	2	3
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>316</b>	352	386
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>126</b>	121	129
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>633</b>	683	734
Calcium	ppm	ASTM D5185m		<b>1542</b>	1640	1690
Phosphorus	ppm	ASTM D5185m	1200	<b>663</b>	685	725
Zinc	ppm	ASTM D5185m	1300	<b>826</b>	842	920
Sulfur	ppm	ASTM D5185m	3200	<b>2576</b>	3066	3265

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>9</b>	10	8
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	<1


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.7</b>	7.0	4.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>23.4</b>	23.2	22.1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>18.1</b>	16.9	14.5
Base Number (BN)	mg KOH/g	ASTM D2896	9.6	<b>8.4</b>	8.9	9.9




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

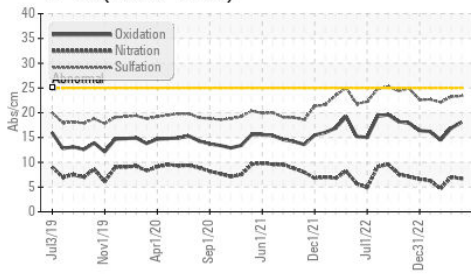

Base Number

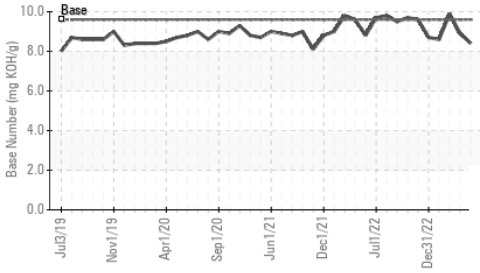

Viscosity @ 100°C

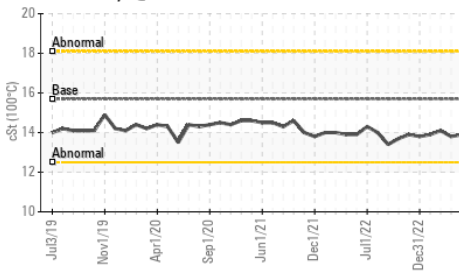


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.7	<b>13.9</b>	13.8	14.1

## GRAPHS


Ferrous Alloys

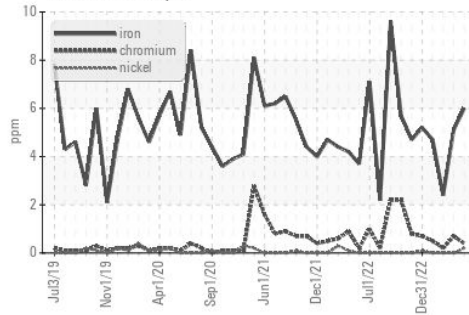


Non-ferrous Metals

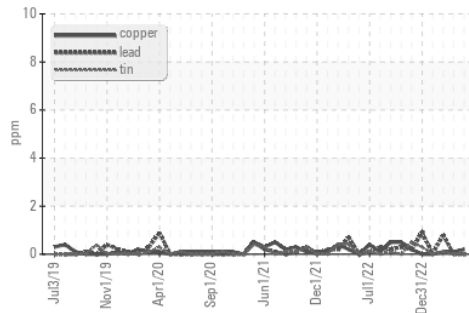

Viscosity @ 100°C

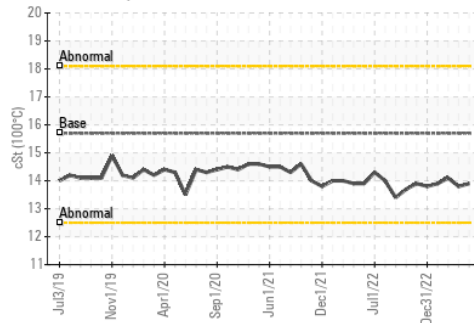

Base Number

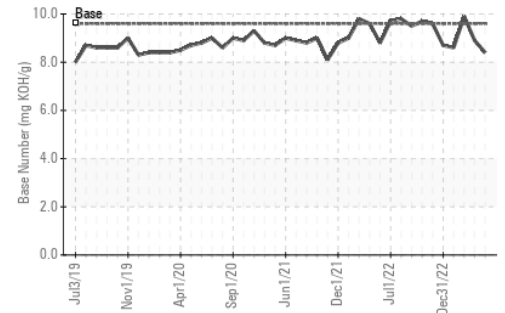

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : MW0051271  
 Lab Number : **05872610**  
 Unique Number : 10512394  
 Test Package : MAR 2

Received : 13 Jun 2023  
 Tested : 14 Jun 2023  
 Diagnosed : 14 Jun 2023 - Wes Davis

**INGRAM BARGE**  
 900 S 3RD ST  
 PADUCAH, KY  
 US 42003

Contact: ANTHONY VAN CURA  
 anthony.vancura@ingrambarge.com

T: (270)415-4467  
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)