

No relevant graphs to display

DEOON	ATION	
RECON		

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS						
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Debris	scalar	*Visual	NONE	🔺 HEAVY	▲ MODER	A MODER

Customer Id: OWEGOD Sample No.: KCPA002301 Lab Number: 05874532 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS				
Action	Status	Date	Done By	
Alert			?	

Description

We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

14 Jun 2023 Diag: Don Baldridge



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

25 Aug 2022 Diag: Doug Bogart



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



02 Feb 2022 Diag: Angela Borella

No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







OIL ANALYSIS REPORT





Machine Id 7428784 (S/N 1041) Component Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

High concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA002301	KCPA005919	KCP48123
Sample Date		Client Info		14 Jun 2023	14 Jun 2023	25 Aug 2022
Machine Age	hrs	Client Info		10176	12026	6807
Oil Age	hrs	Client Info		0	0	3530
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	13	0	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	1	1	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	<1	3
Lead	ppm	ASTM D5185m		<1	0	<1
Copper	ppm	ASTM D5185m	>50	15	11	14
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	2	0	2
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	10	<1	5
Calcium	ppm	ASTM D5185m	2	2	0	0
Phosphorus	ppm	ASTM D5185m		3	0	3
Zinc	ppm	ASTM D5185m		50	21	44
Sulfur	ppm	ASTM D5185m		23972	21308	18547
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m		1	0	<1
Sodium	ppm	ASTM D5185m	>20		2	1
Potassium	ppm	ASTM D5185m	>20	5 4	2	3
Water	ppm %	ASTM D5185m ASTM D6304		4 0.014	0.015	0.007
ppm Water	ppm	ASTM D6304 ASTM D6304		148.5	150.2	77.6
FLUID CLEANLIN		method	limit/base	current		
					history1	history2
Particles >4µm Particles >6µm		ASTM D7647 ASTM D7647	<1300			
Particles >6µm Particles >14µm		ASTM D7647 ASTM D7647				
-			>80			
Particles >21µm		ASTM D7647				
Particles >38µm		ASTM D7647 ASTM D7647	>4			
Particles >71µm Oil Cleanliness		ASTM D7647 ISO 4406 (c)	>3			
		()				
FLUID DEGRADA Acid Number (AN)		method	limit/base	current	history1	history2
	mg KOH/g	ASTM D8045	0.4	0.35	0.15	0.34


Report Id: OWEGOD [WUSCAR] 05874532 (Generated: 07/13/2023 11:02:11) Rev: 1

Contact/Location: Service Manager - OWEGOD




OIL ANALYSIS REPORT

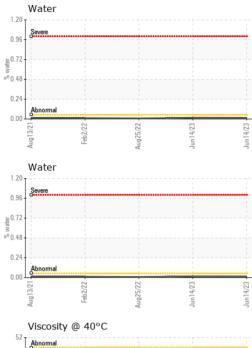

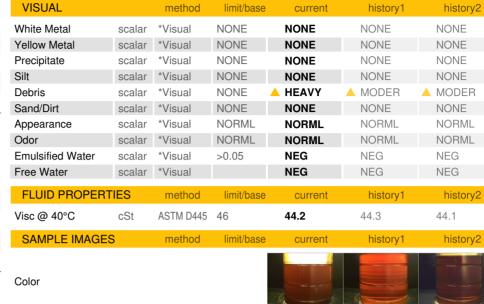

50 48 (D-04) -53 44 42 Ab 40 38 Aug13/21-Feb2/22 Aug25/22 Jun14/23

Bottom

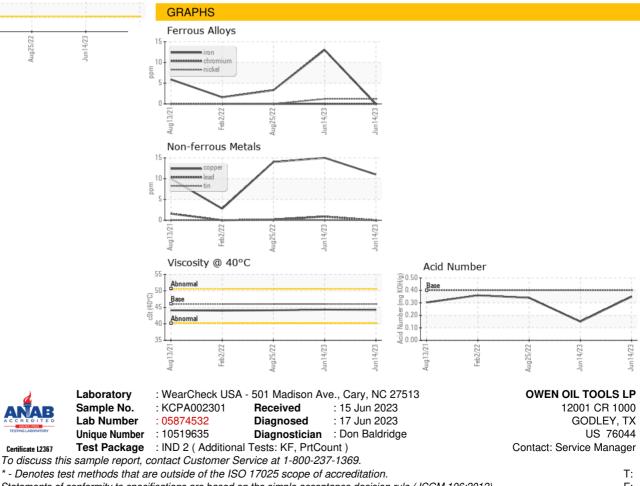

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - OWEGOD