




FUEL REPORT

Sample Rating Trend

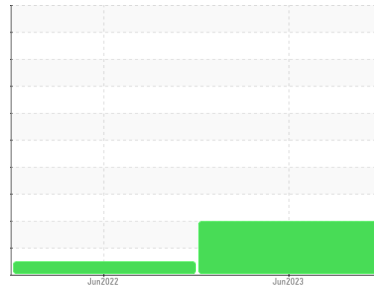

ISO



SILVER BLUFF MAIN BUILDING

Machine Id
 Component
Diesel Fuel
 Fluid
DIESSEL FUEL No. 1 (--- LTR)

DIAGNOSIS

Recommendation

Recommend pre-filtering before use. All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of particulates present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number	Client Info			WC0814514	WC0591323	---
Sample Date	Client Info			07 Jun 2023	16 Jun 2022	---
Machine Age	mls	Client Info		0	0	---
Sample Status				ATTENTION	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history 1	history 2
ASTM Color	scalar	*ASTM D1500		L4.5	5.0	---
Visc @ 40°C	cSt	ASTM D445	2.4	2.5	2.46	---

SULFUR CONTENT		method	limit/base	current	history 1	history 2
Sulfur	ppm	ASTM D5185m		40	19	---
Sulfur (UVF)	ppm	ASTM D5453		37	32	---

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	<1.0	0	0	---
Sodium	ppm	ASTM D5185m	<0.1	<1	0	---
Potassium	ppm	ASTM D5185m	<0.1	0	<1	---
Water	%	ASTM D6304	<0.05	0.003	0.003	---
ppm Water	ppm	ASTM D6304	<500	28.8	27.8	---
% Gasoline	%	*In-House	<0.50	0.0	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	0.0	---

FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647	>2500	▲ 11030	28832	---
Particles >6µm		ASTM D7647	>640	▲ 3389	7970	---
Particles >14µm		ASTM D7647	>80	▲ 220	605	---
Particles >21µm		ASTM D7647	>20	▲ 39	131	---
Particles >38µm		ASTM D7647	>4	1	9	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ 21/19/15	22/20/16	---





HEAVY METALS		method	limit/base	current	history 1	history 2
Aluminum	ppm	ASTM D5185m	<0.1	0	<1	---
Nickel	ppm	ASTM D5185m	<0.1	<1	0	---
Lead	ppm	ASTM D5185m	<0.1	0	<1	---
Vanadium	ppm	ASTM D5185m	<0.1	0	0	---
Iron	ppm	ASTM D5185m	<0.1	0	0	---
Calcium	ppm	ASTM D5185m	<0.1	0	0	---
Magnesium	ppm	ASTM D5185m	<0.1	<1	<1	---
Phosphorus	ppm	ASTM D5185m	<0.1	2	2	---
Zinc	ppm	ASTM D5185m	<0.1	0	0	---

SAMPLE IMAGES		method	limit/base	current	history 1	history 2
---------------	--	--------	------------	---------	-----------	-----------


Color						no image
Bottom						no image



FUEL REPORT

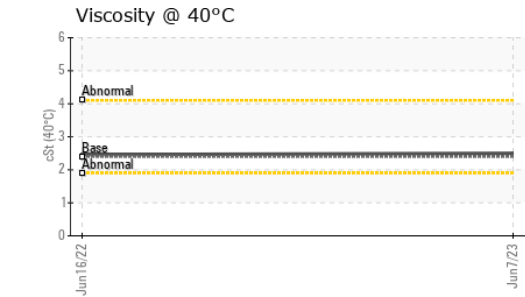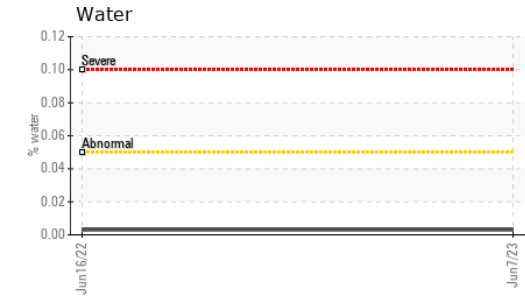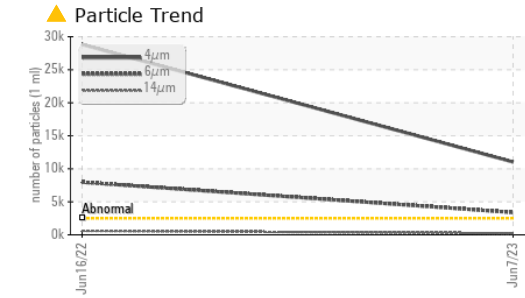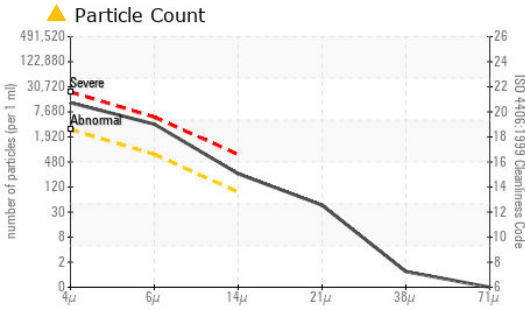

GRAPHS

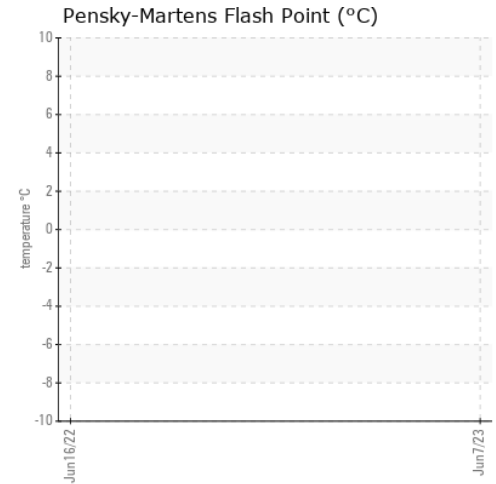

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0814514 **Received** : 15 Jun 2023
Lab Number : 05874726 **Diagnosed** : 22 Jun 2023
Unique Number : 10519829 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

STARTEK ELECTRIC
 20407 GREAT SMOKEY MOUNTAIN EXPRESS
 WAYNESVILLE, NC
 US 28786

Contact: TRACEY RICH
traceyrich18@yahoo.com

T: (828)456-3386

F: