



# FUEL REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**JSD 209 LIFT STATION**

Component  
**Diesel Fuel**  
Fluid  
**DIESEL FUEL No. 1 (--- LTR)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history 1	history 2
Sample Number	Client Info			<b>WC0824236</b>	---	---
Sample Date	Client Info			<b>01 Jun 2023</b>	---	---
Machine Age	mls	Client Info		<b>0</b>	---	---
Sample Status				<b>NORMAL</b>	---	---


PHYSICAL PROPERTIES		method	limit/base	current	history 1	history 2
ASTM Color	scalar	*ASTM D1500		<b>L4.5</b>	---	---
Visc @ 40°C	cSt	ASTM D445	2.4	<b>2.44</b>	---	---

SULFUR CONTENT		method	limit/base	current	history 1	history 2
Sulfur	ppm	ASTM D5185m		<b>30</b>	---	---
Sulfur (UVF)	ppm	ASTM D5453		<b>21</b>	---	---

CONTAMINANTS		method	limit/base	current	history 1	history 2
Silicon	ppm	ASTM D5185m	<1.0	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Water	%	ASTM D6304	<0.05	<b>0.005</b>	---	---
ppm Water	ppm	ASTM D6304	<500	<b>51.6</b>	---	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	---	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	---	---





FLUID CLEANLINESS		method	limit/base	current	history 1	history 2
Particles >4µm		ASTM D7647	>2500	<b>688</b>	---	---
Particles >6µm		ASTM D7647	>640	<b>242</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>15</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>3</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>17/15/11</b>	---	---

HEAVY METALS		method	limit/base	current	history 1	history 2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Iron	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	<0.1	<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>3</b>	---	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---


SAMPLE IMAGES		method	limit/base	current	history 1	history 2
Color					no image	no image
Bottom					no image	no image



# FUEL REPORT

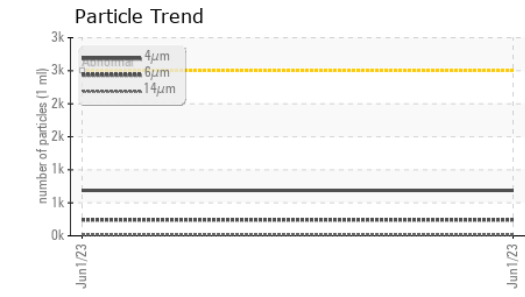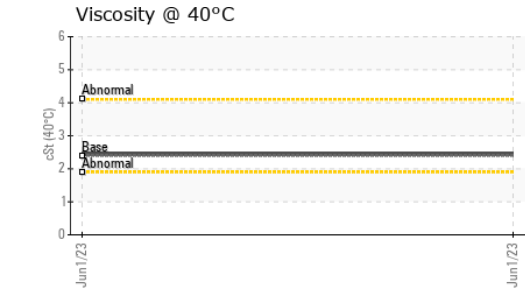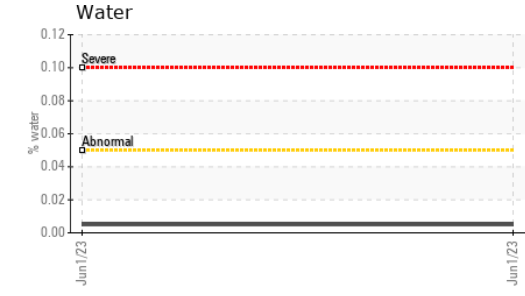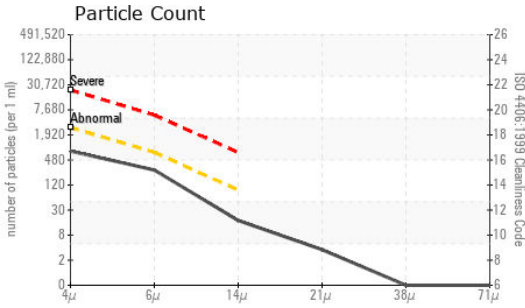

## GRAPHS

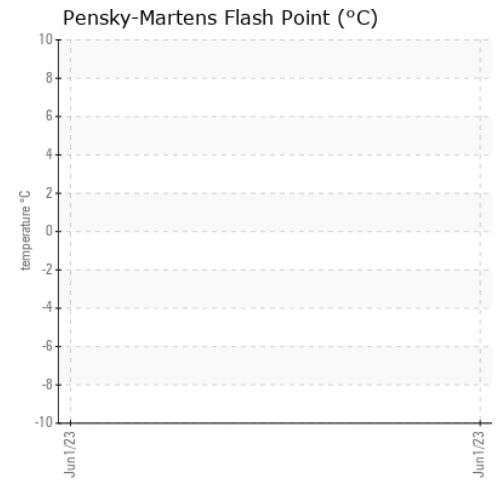

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0824236 **Received** : 15 Jun 2023  
**Lab Number** : 05875175 **Diagnosed** : 22 Jun 2023  
**Unique Number** : 10520278 **Diagnostician** : Doug Bogart  
**Test Package** : DF-5 ( Additional Tests: Screen )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**STARTEK ELECTRIC**  
 20407 GREAT SMOKEY MOUNTAIN EXPRESS  
 WAYNESVILLE, NC  
 US 28786  
 Contact: TRACEY RICH  
 traceyrich18@yahoo.com  
 T: (828)456-3386  
 F: